



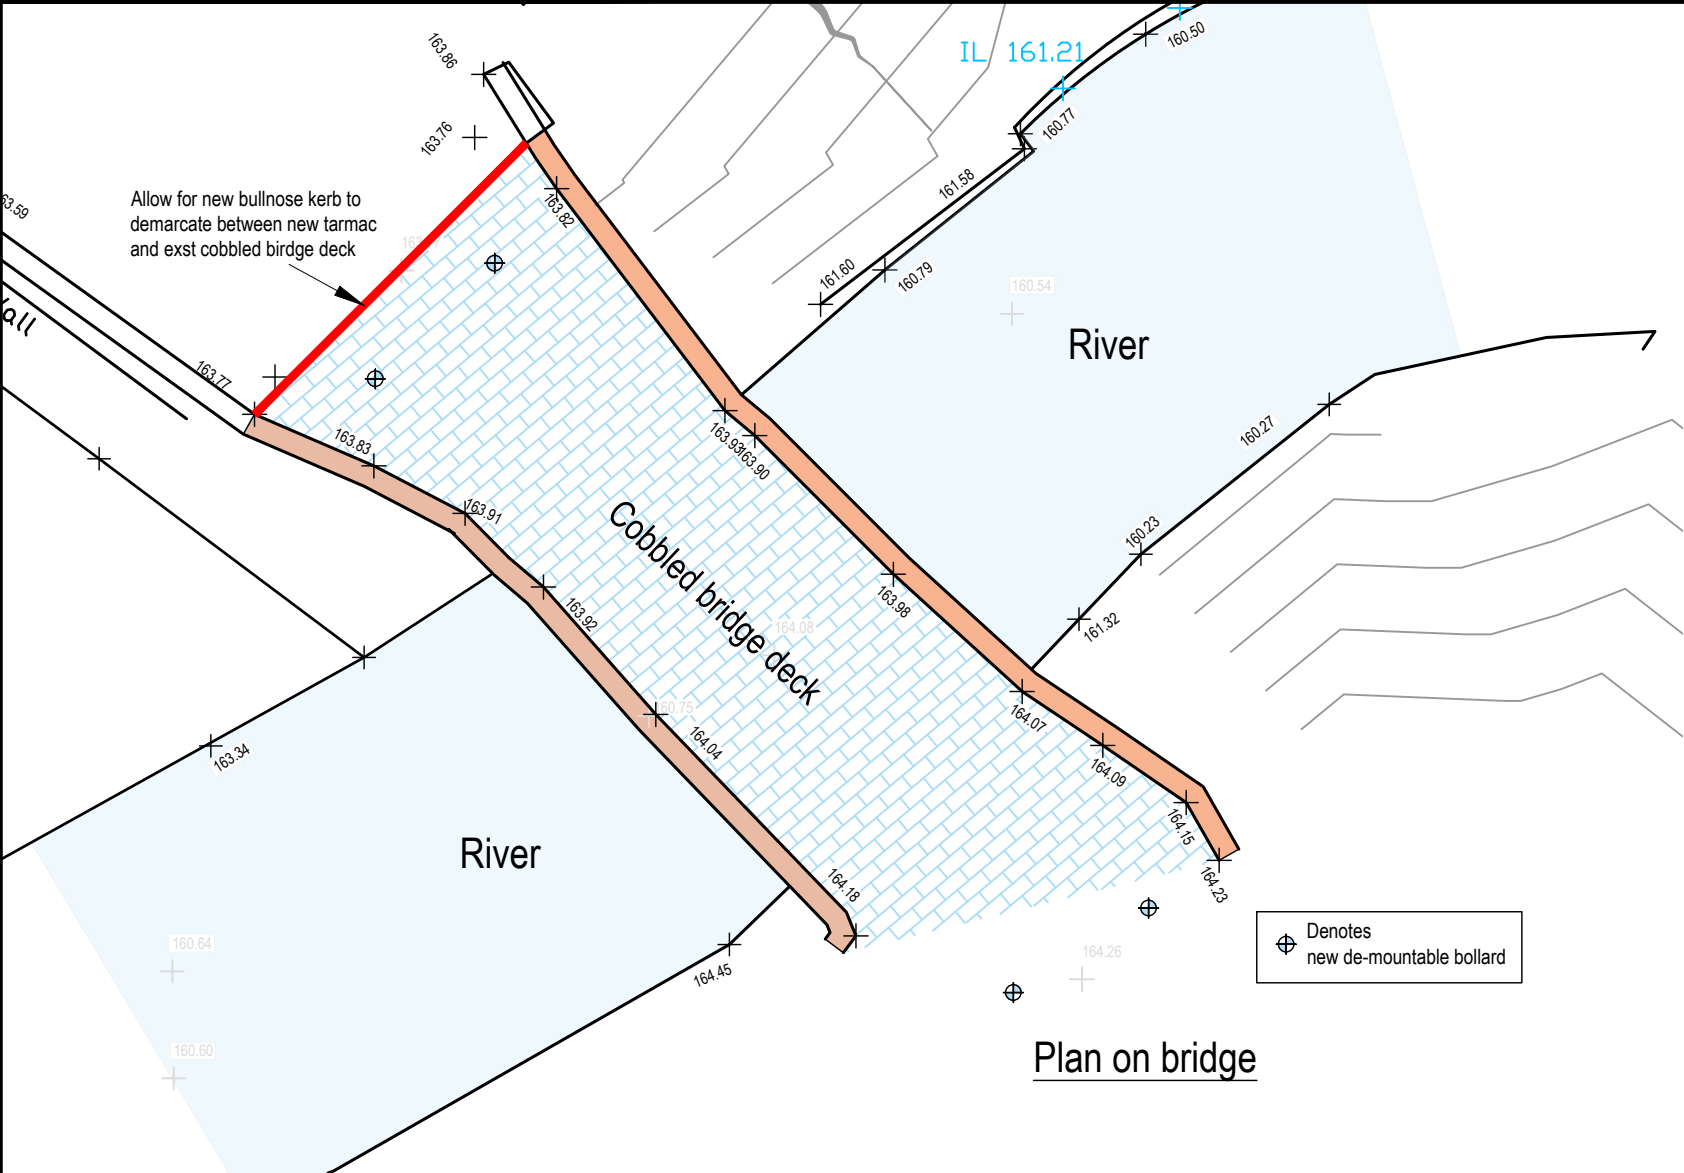

Plan on bridge

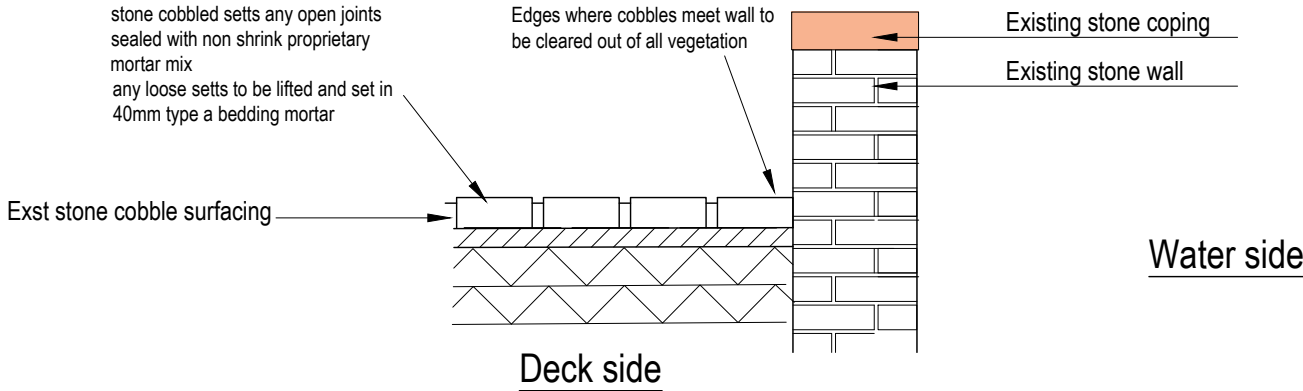

- General notes:**
- Wall to be thoroughly cleaned of all moss and vegetation
 - Joints to be raked out back to solid mortar (min 20mm)
 - Joints to be cleaned out to ensure clean key for new mortar
 - Dampen joint prior to repointing to avoid drawign moisture out of the new mortar to quickly.
 - Pack the mortar firmly into the joint, ensuring there are no voids or gaps. Tool the surface to the desired finish once the mortar has set to the right consistency.
 - Avoid repointing in adverse weather conditions such as heavy rain, strong winds, or temperatures below 5°C (41°F) and above 30°C (86°F), as these can affect the curing process and the final quality of the mortar.
 - Protect the newly repointed joints from rapid drying by covering them with damp hessian or plastic sheeting, especially in hot or windy conditions.
 - Any cracked stonework is to be replaced.

						PROJECT:	EDENFIELD ROAD - ROCHDALE			SCALE @ A3: 1:100	DESIGNED: KOB	DRAWN EG	CHECKED: KOB	APPROVED: KOB	DATE: MAY 24
						TITLE:	EXISTING BRIDGE REMEDIALS			AJP est. 1978 consulting engineers 0151 227 1462 info@ajpltd.co.uk 91 Dale Street, Liverpool, L2 2ET					
						STATUS:	PROJECT No:	DRAWING No:	REV:						
						S2	223-100	EDE-AJP-XX-00-DR-C-9000	A						
A	May24	Bollard Positions Added				KOB	KOB								
REV	DATE	DESCRIPTION				BY	APP								