
In all cases figured dimensions shall be taken in preference to scaled dimensions. All relevant dimensions shall be checked on site before any fabricated work is put in hand.	Revision Notes altered Planning comments added	Date 28/03/22 08/05/22	No. A B



FRONT ELEVATION 1:50

▪ INDICATED LOCATION OF TIE BARS TO STRUCTURAL ENGINEERS DETAILS

General.
All materials and workmanship to comply with the recommendations and requirements of all current relevant British Codes of Practice, British Standards and Building Regulations. All proprietary products to be utilised fully in accordance with the manufacturers instructions. All structural timber to be C16 or C24 graded in accordance with BS EN 1995-1-1:2004+A2:2014 with pressure impregnated treatment. Any discrepancies on the drawings to be reported to the Architect/Technologist prior to the commencement of construction. Written dimensions only to be taken. Do not scale any drawings.

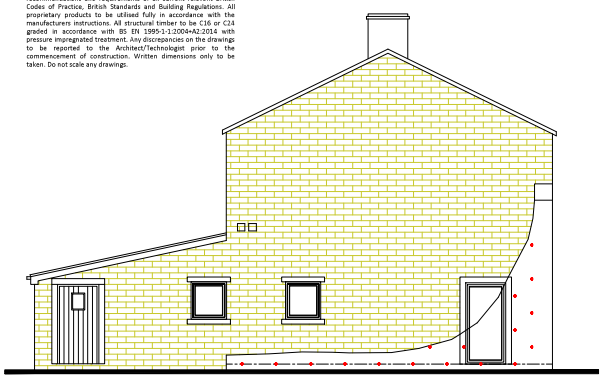


SIDE ELEVATION 1:50

Method Statement for Existing External wall.

1. Clear existing site of all loose stone debris. The existing ground floor construction to be cleared of debris and left insitu at this time.
2. The remaining walls will need to be cleared of any loose surface rubble. No further demolition is to take place.
3. The remaining walls are to be inspected by a Structural Engineer and a representative from the Planning Authority. This may be a Conservation Officer, Building Control Office, both or another.
4. At this stage, existing ground floor slab(s) will need to be carefully removed from the footprint. A new concrete slab containing appropriate thickenings will need to be cast on approved strata/hardcore. The thickening will act as a foundation to the new inner leaf. The new inner leaf will become the load bearing element of the structure.
5. Where the existing random stone inner leaf and the rubble fill remains, this cannot be relied on to provide a suitable tie to the new proposed inner leaf. It is therefor intended that a stainless steel bar is inserted through the wall, drilled from the inside, such that it is anchored into the outer stone face. This will either be a resin fix or mechanical fix. Drilling from the inside will ensure that this outer face remains visually undisturbed. The bar may need to be purpose made to suit the wall thickness, the cavity width and the new inner leaf. The bar will have a clip on drip and will serve as a wall tie. these ties will be fixed at 450mm max centres vertically and 900mm max horizontally in a staggered pattern. Elsewhere, the new wall construction comprising of an outer leaf of stone and a 140mm leaf blockwork (strength to be determined), will have traditional wall ties to suit the cavity width as dictated by BS5268.
6. The new inner walls will be constructed in lifts, no more than 2m with the inner leaf never exceeding 1m above the height of the outer leaf.
7. The wall will be taken up to first floor chamber level, where a pre-cast concrete floor of a beam and pot nature will be introduced. This will be tied to the walls as appropriate using robust details.
8. Once these details are complete to the satisfaction of all parties, the construction of the wall will continue to second floor. Here, a timber floor will be ties in to the walls.
9. The roof will be of traditional construction using loose timber, including rafters and purlins. Install to the roof structure a plywood/OSB lining to ensure this acts as a diaphragm to provide stability to the leaf of each wall. Tying details will be employed.

Lintels and Steelwork.
All lintels to be fully insulated IG proprietary galvanised mild steel with cavity trays above same all to be given half hour fire resistance. All steel lintels to have a minimum end bearing of 150mm with cavity trays over. All steelwork to structural engineers details and recommendations. Provide concrete/IG internal Box lintels with a minimum end bearing of 150mm to both sides to all internal door openings, where required.

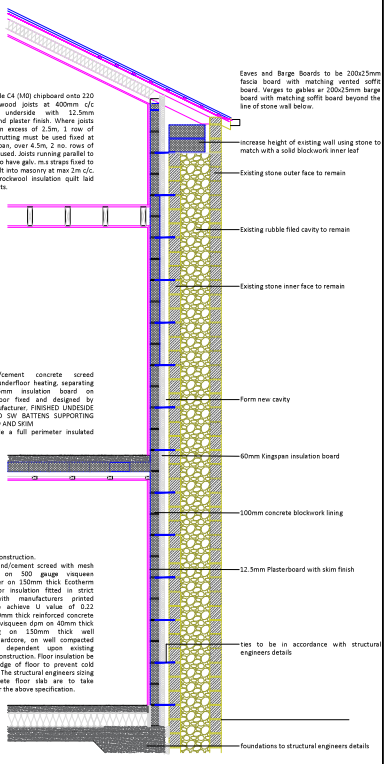

VERTICAL SECTION 1:20

Pickles Architecture
31 Church Lane, Brighouse, West Yorkshire, HD6 1AT
Tel: 01484 712266
Email:mail@picklesarchitecture.co.uk

PROPOSED EXTENSION AND INTERNAL ALTERATION AT BRANCH ROAD FARM, BRANCH ROAD. LITTLEBOUROUGH. WEST YORKSHIRE. FOR MR AND MRS WILDMAN.

Drawing Title	Job No.	Sheet No.	Revisions
BUILDING REGULATION EXISTING WALL DETAIL	W1050	10	B
This drawing is copyright	Scale 1:50@A1	Date 31/03/22	Drawn NSH