



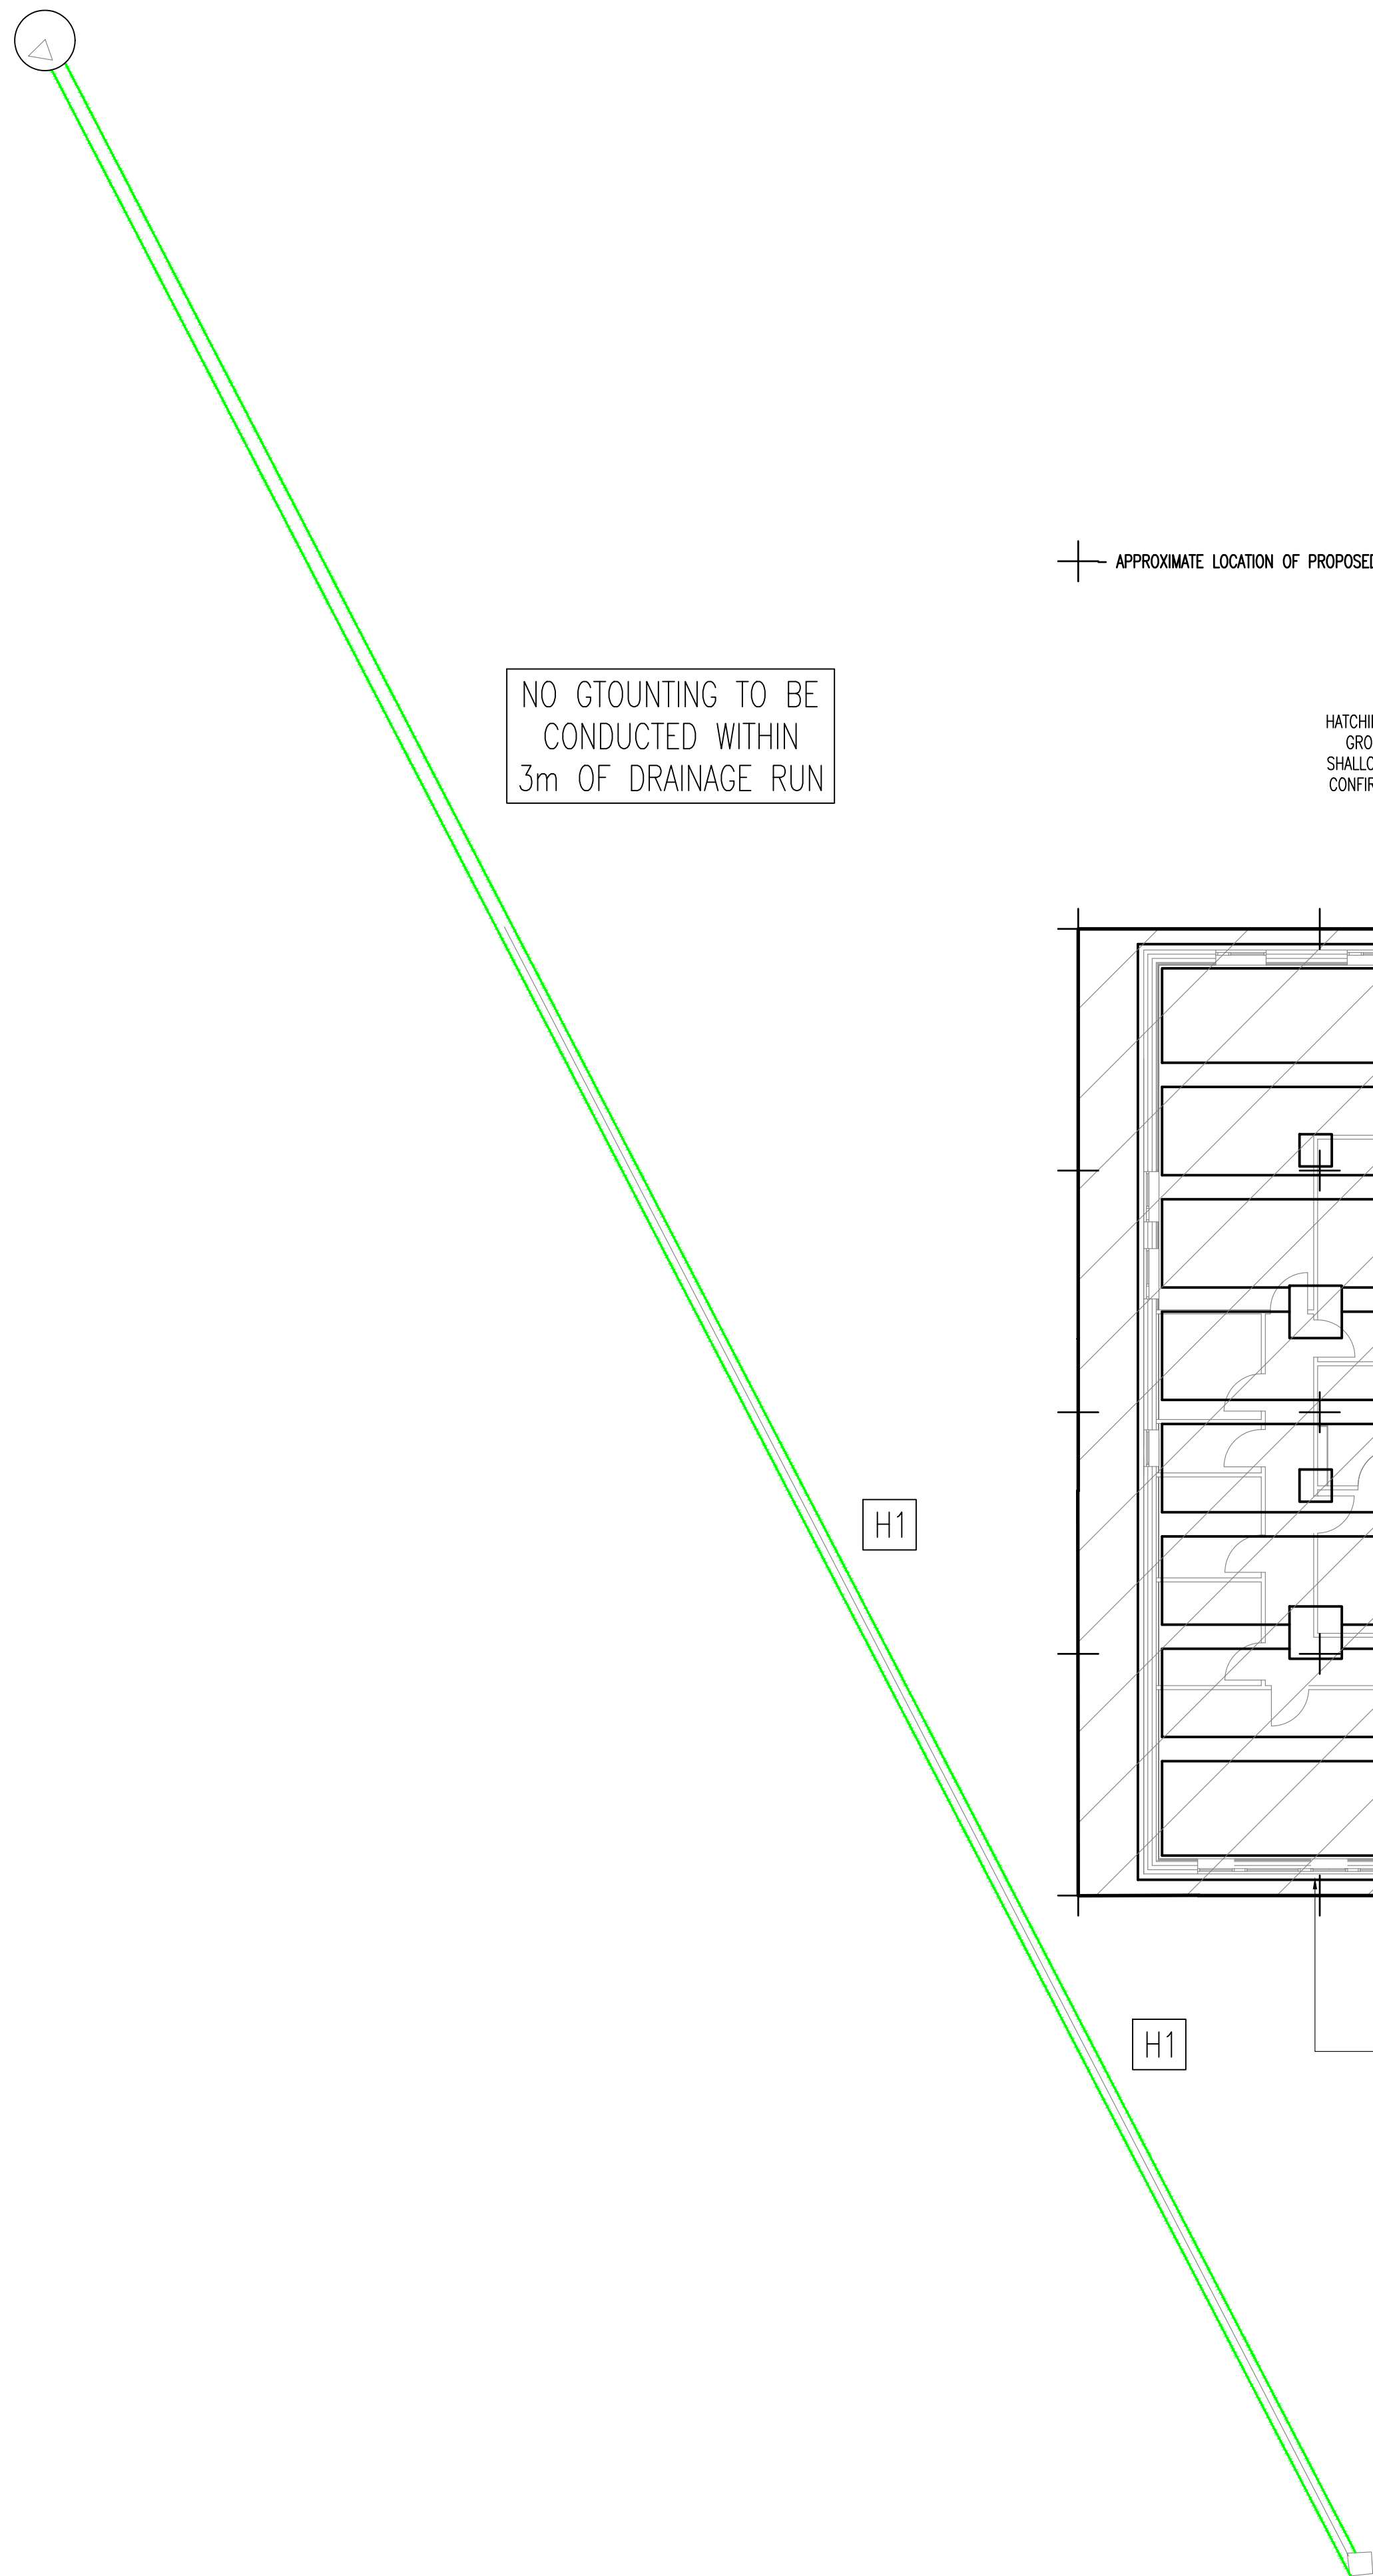

NO GROUTING TO BE
CONDUCTED WITHIN
3m OF DRAINAGE RUN

HATCHING IS APPROXIMATE AREA TO BE
GROUTED TO STABILIZE POTENTIAL
SHALLOW MINE WORKINGS. AREA TO BE
CONFIRMED BY GROUTING CONTRACTOR


CANOPY AREA STABILISATION
TO BE CONFIRMED

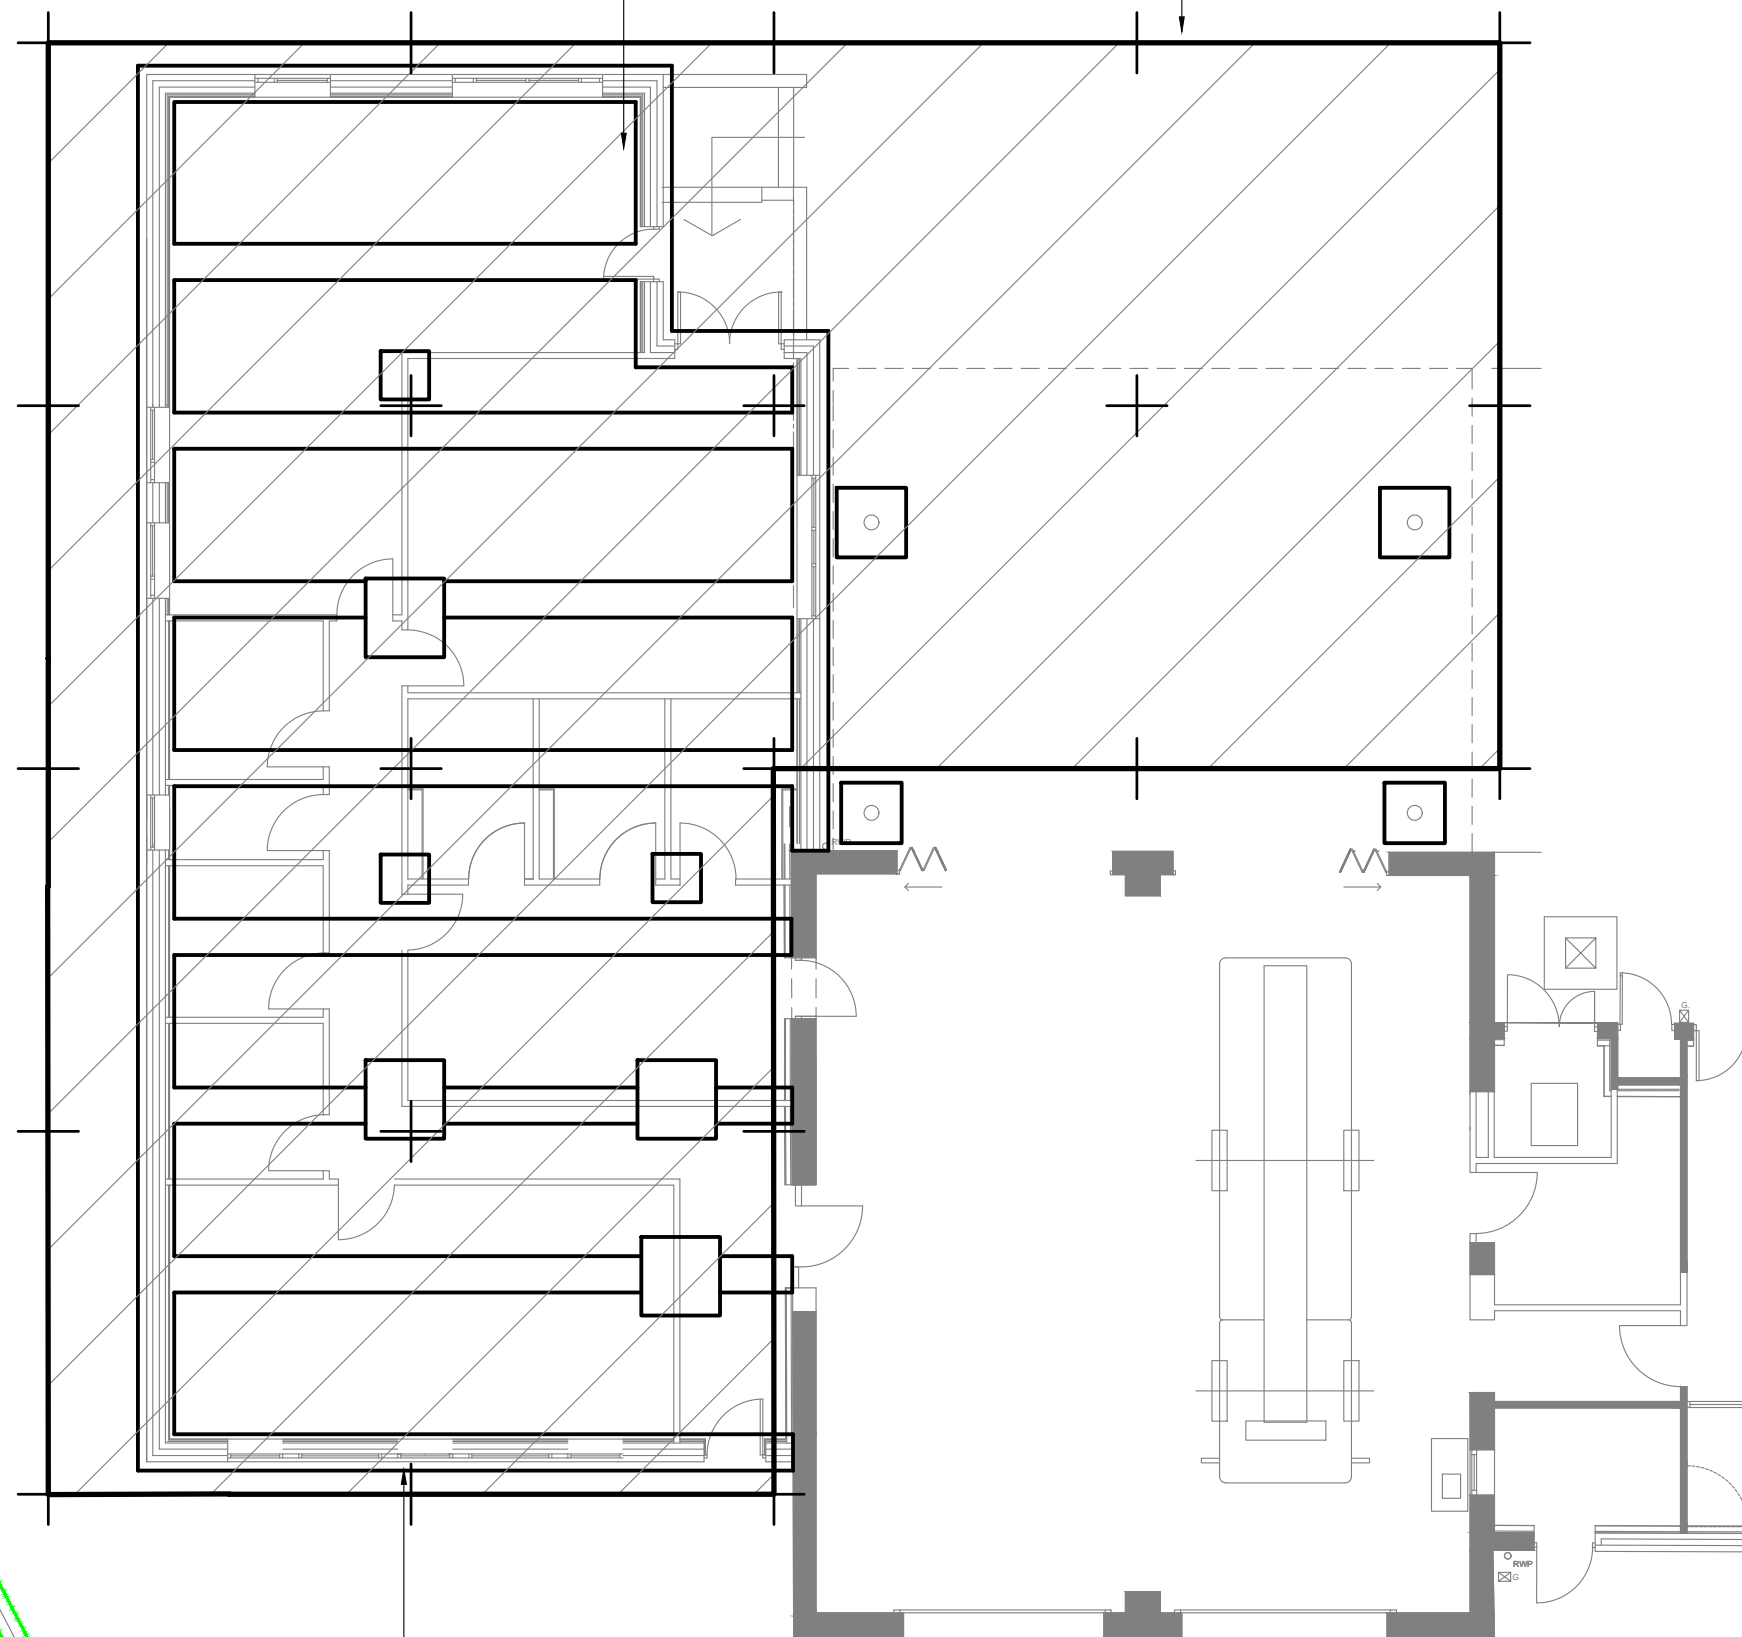

H1

H1

FOOTINGS INCLUDED FOR CLARITY.
DISTANCE FROM FOOTINGS TO SEWER
APPROXIMATE AND TO BE CONFIRMED
UPON RECEIPT OF CCTV SURVEY

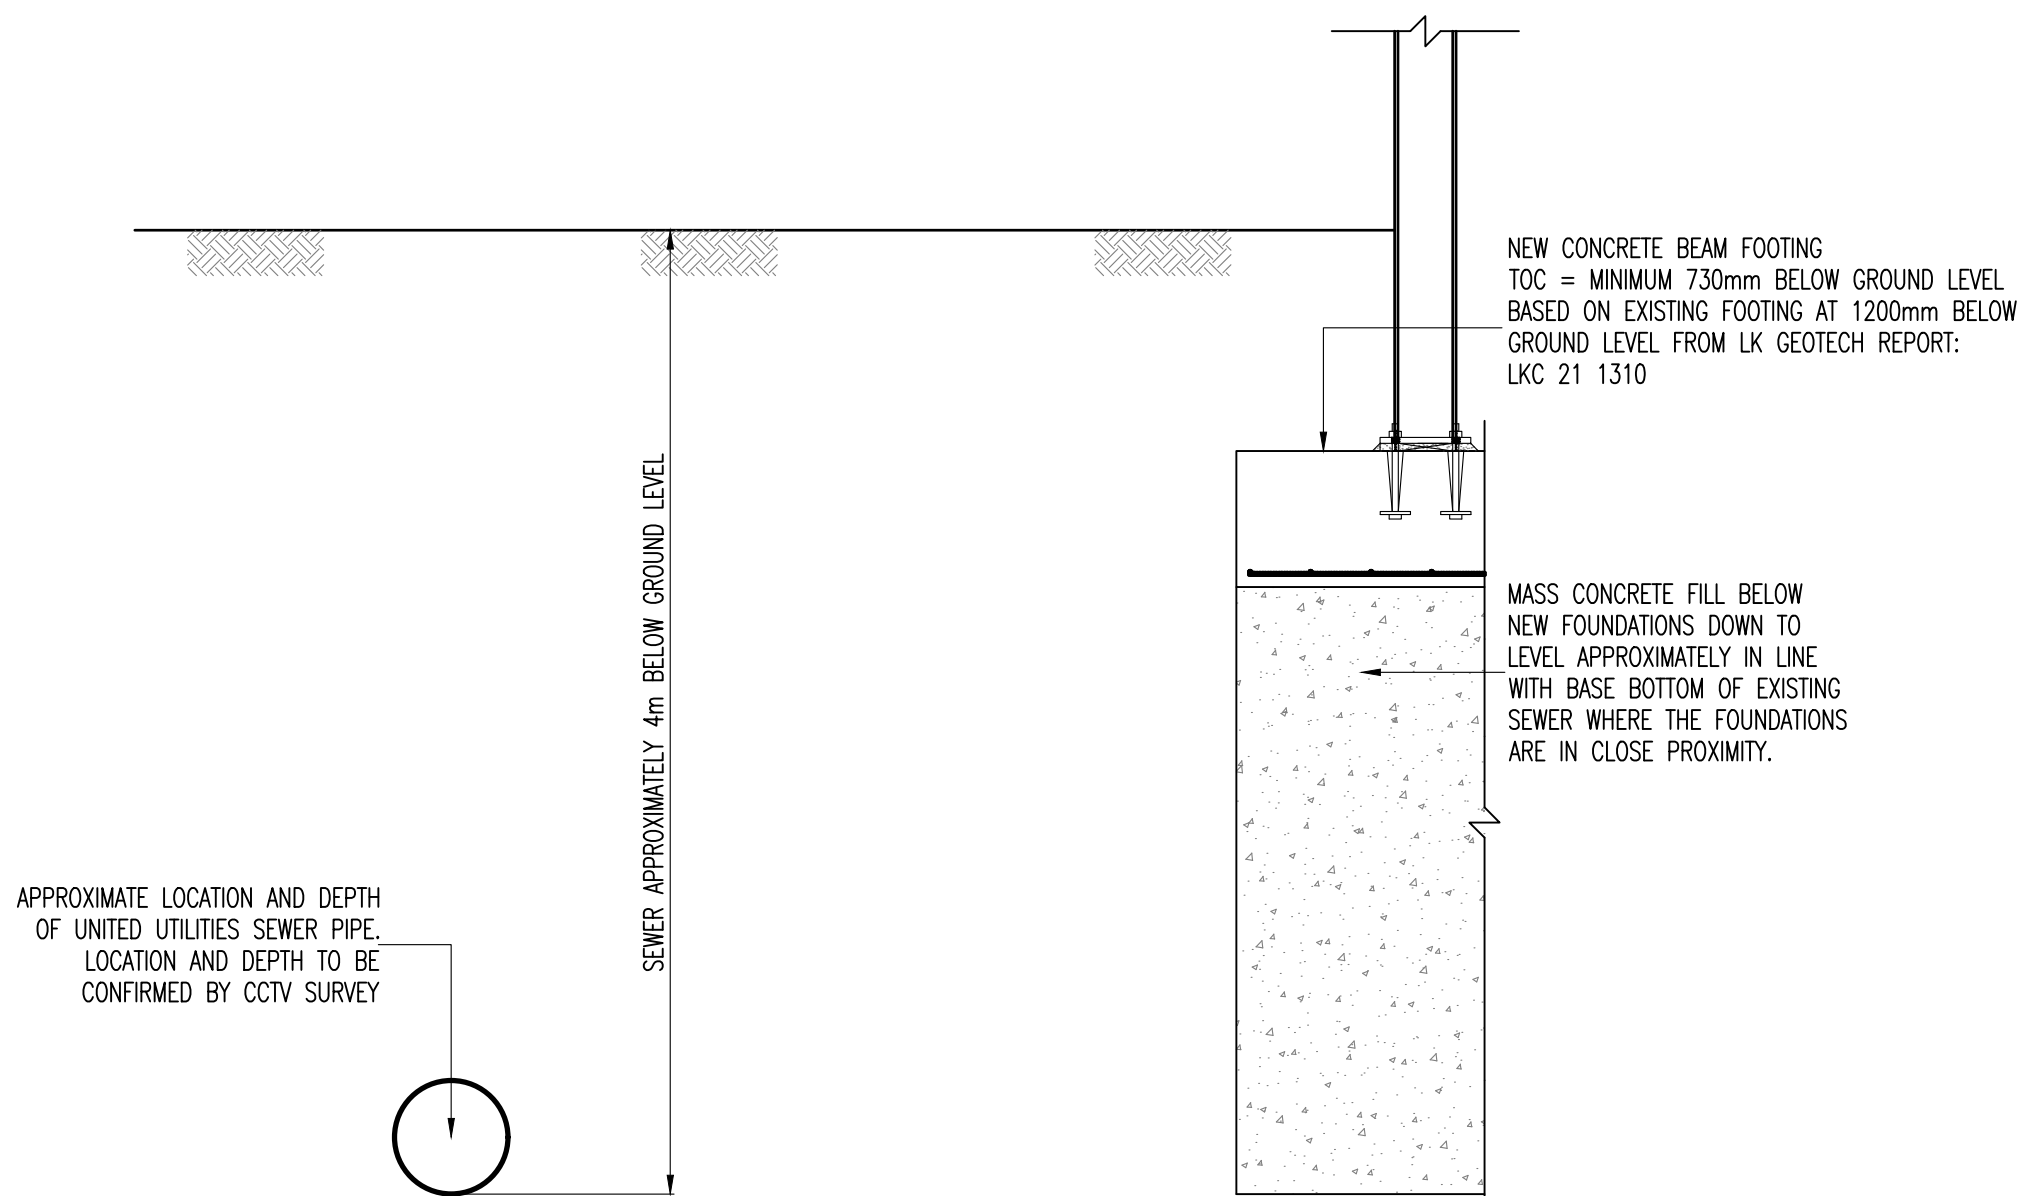

SECTION A-A



status	
TENDER	
This drawing is ©FraserHarris Gass & Hope LLP and is not to be copied, reproduced or re-distributed either in whole or in part without the prior written permission of the originator. The originator shall have no responsibility for any liability, loss, cost, damage or expense arising from or relating to any use of this document other than for its intended purpose on this project. This drawing shall be read in conjunction with all other relevant drawings, specifications and associated documentation. Any discrepancies, errors or omissions are to be reported to the originator before proceeding with work. All dimensions are to be checked on site by the contractor prior to proceeding with any work.	
Hazard Identification	
	
ref	date
h1	hazard
CARE TO BE TAKEN WHEN GROUTING IN CLOSE PROXIMITY TO UNITED UTILITIES SEWER. GROUTING IS NOT TO PLACE ADDITIONAL LOAD ON SEWER.	

NOTES – GROUTING

DO NOT SCALE FROM THIS DRAWING

ANY DIMENSIONAL DISCREPANCIES TO BE REPORTED
TO THE ENGINEERS

THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL
RELEVANT ARCHITECTS DRAWINGS AND SPECIFICATIONS

ALL MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE RELEVANT SPECIFICATIONS AND BRITISH STANDARDS

THE CONTRACTOR SHALL ENSURE THE STABILITY OF THE STRUCTURE & ANY ADJOINING STRUCTURES IS MAINTAINED AT ALL STAGES DURING CONSTRUCTION. THE CONTRACTOR SHALL DESIGN, INSTALL & MAINTAIN ANY NECESSARY TEMPORARY WORKS

DRAWING TO BE READ IN CONJUNCTION WITH:

LK CONSULTING REPORT NO. LKC 21 1310

25

THE LAND CONSULTANCY MINING REPORT NO. TLC1169

DEPTHS OF GROUTING REQUIRED TO BE CONFIRMED
BY GROUTING SUB-CONTRACTOR

6m x 6m MAY REQUIRED TIGHTENING IF BELOW
GROUND UPTAKE IS DEEMED EXCESSIVE


 — APPROXIMATE AREA OF
FOOTING TO EXTEND DOWN IN
LINE WITH BOTTOM OF SEWER.

T1	ISSUED FOR TENDER	PC	22.08.22
ref	revision	by	date



Architects
Consulting Engineers
Quantity Surveyors

21 Silverwell Street
Bolton
BL1 1PR
t: 01204 525321
email@bghbolton.co.uk
www.bghbolton.co.uk

Bradshaw Gass & Hope LLP

client
GREATER MANCHESTER FIRE AND
RESCUE SERVICE

project

LITTLEBOROUGH FIRE STATION
EXTENSION AND REFURBISHMENT

drawing

PROPOSED GROUTING GRID

drawn by	PC	date	JULY 2022
checked by		date	
scale	1:50		A1
dwg no	1978.37.104	rev	T1