



127.1m

The Point
Retail Park

EVCP Feeder Pillar

Total Import Load - 153kVA

185(3)WF supply to terminate in 400A three
phase cut-out, fused at 315A.

150mm service entry duct for unit.

185(3) WF

132.3m

El Sub Sta

HILL STREET


March
Street
Garage

Works

Garage



STANDARD NJUG ARRANGEMENT

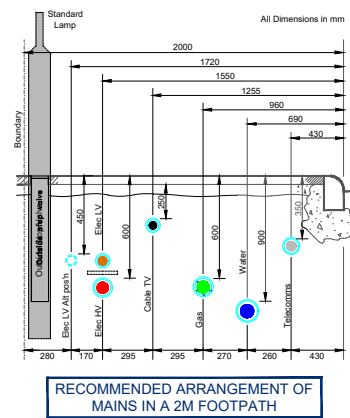

DISCLAIMER
For details of all existing apparatus, please consult the Records Department
of the local utility. Any existing apparatus shown on this drawing is for
planning purposes only, the positions of which are to be taken as
approximate only.

Notes:

- THIS DRAWING IS CONFIDENTIAL AND MUST NOT BE DISCLOSED TO
THIRD PARTIES, REPRODUCED OR USED, OR THE CONTENT THEREOF
COPIED OR REPRODUCED WITHOUT THE WRITTEN CONSENT OF
THE IQA GROUP.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT
EXISTING UTILITY ARCHITECTS, SERVICE ENGINEERS' AND IQA DRAWINGS
AND SPECIFICATION.

All cables to be installed as per NJUG minimum guidelines:

Footpath = HV - 450mm - 1200mm
LV - 450mm
Roadway = HV - 750mm - 1200mm
LV - 600mm

- NOTES**
- All service cables up to 25m in length to be type 25mm Hybrid
single-core (25mm Aluminium Core - ALPE insulated -
Concrete Neutral Earth).
 - All service cables between 25m - 40m in length to be type 35mm
Hybrid single-core (35mm Aluminium Core - ALPE insulated -
Concrete Neutral Earth).
 - All service cables to be laid in 15mm flexible service ducting.
 - Evangelization of the connections could be delayed if the service
ducts are not laid as per the design.

ELECTRIC LEGEND

LAID ELECTRIC HV MAIN	—
LAID ELECTRIC LV MAIN	—
PROPOSED 2X(1) ELEC SERVICE UNLESS STATED OTHERWISE + 32mm PROPERTY ENTRY DUCT	—
EXISTING APPARATUS	—
PROPOSED ELECTRIC HV MAIN	—
PROPOSED ELECTRIC LV MAIN	—
EXISTING HV OVERHEAD	—
EXISTING LV OVERHEAD	—
SERVICE BREECH JOINT	—
POT END	—
STRAIGHT JOINT	—
BREECH JOINT	—
LINK BOX	—
ELEC CABLE IN SERVICE RISER	—
DISTRIBUTION BOARD	—
EARTH SPIKE	—
25(1)LSH WITHIN 32mm SERVICE DUCT	—
RIGIDUCT	—
INTERNAL METER (FLATS)	—
INDICATIVE METER POSITION	—
STREET LIGHTING CONTROL PILLAR	—

2	Feeder Pillar amendment	RF	30/04/22
1	Initial firm proposal	RF	28/04/22

REV. DESCRIPTION: BY: DATE:

STATUS:

iqagroup
IQA Operations Group Ltd
2 Centura Court
Hillingdon, Glasgow,
G52 4PR
Tel: 0141 840 5256
www.IQAGroup.co.uk

CLIENT: **Swarco UK Ltd**
Unit 1, Maxted Corner
Maxted Corner
Hemel Hempstead, HP2 7RA

PROJECT: **The Point Retail Park**
Molesworth Street
Rochdale
OL16 1TS

TITLE: **Land Registry**

SCALE AT A1 1:250	DATE: 30/05/22	DRAWN: RF	CHECKED: MK
PROJECT NO: PS147	DRAWING REF: LR	REVISION: 2	