


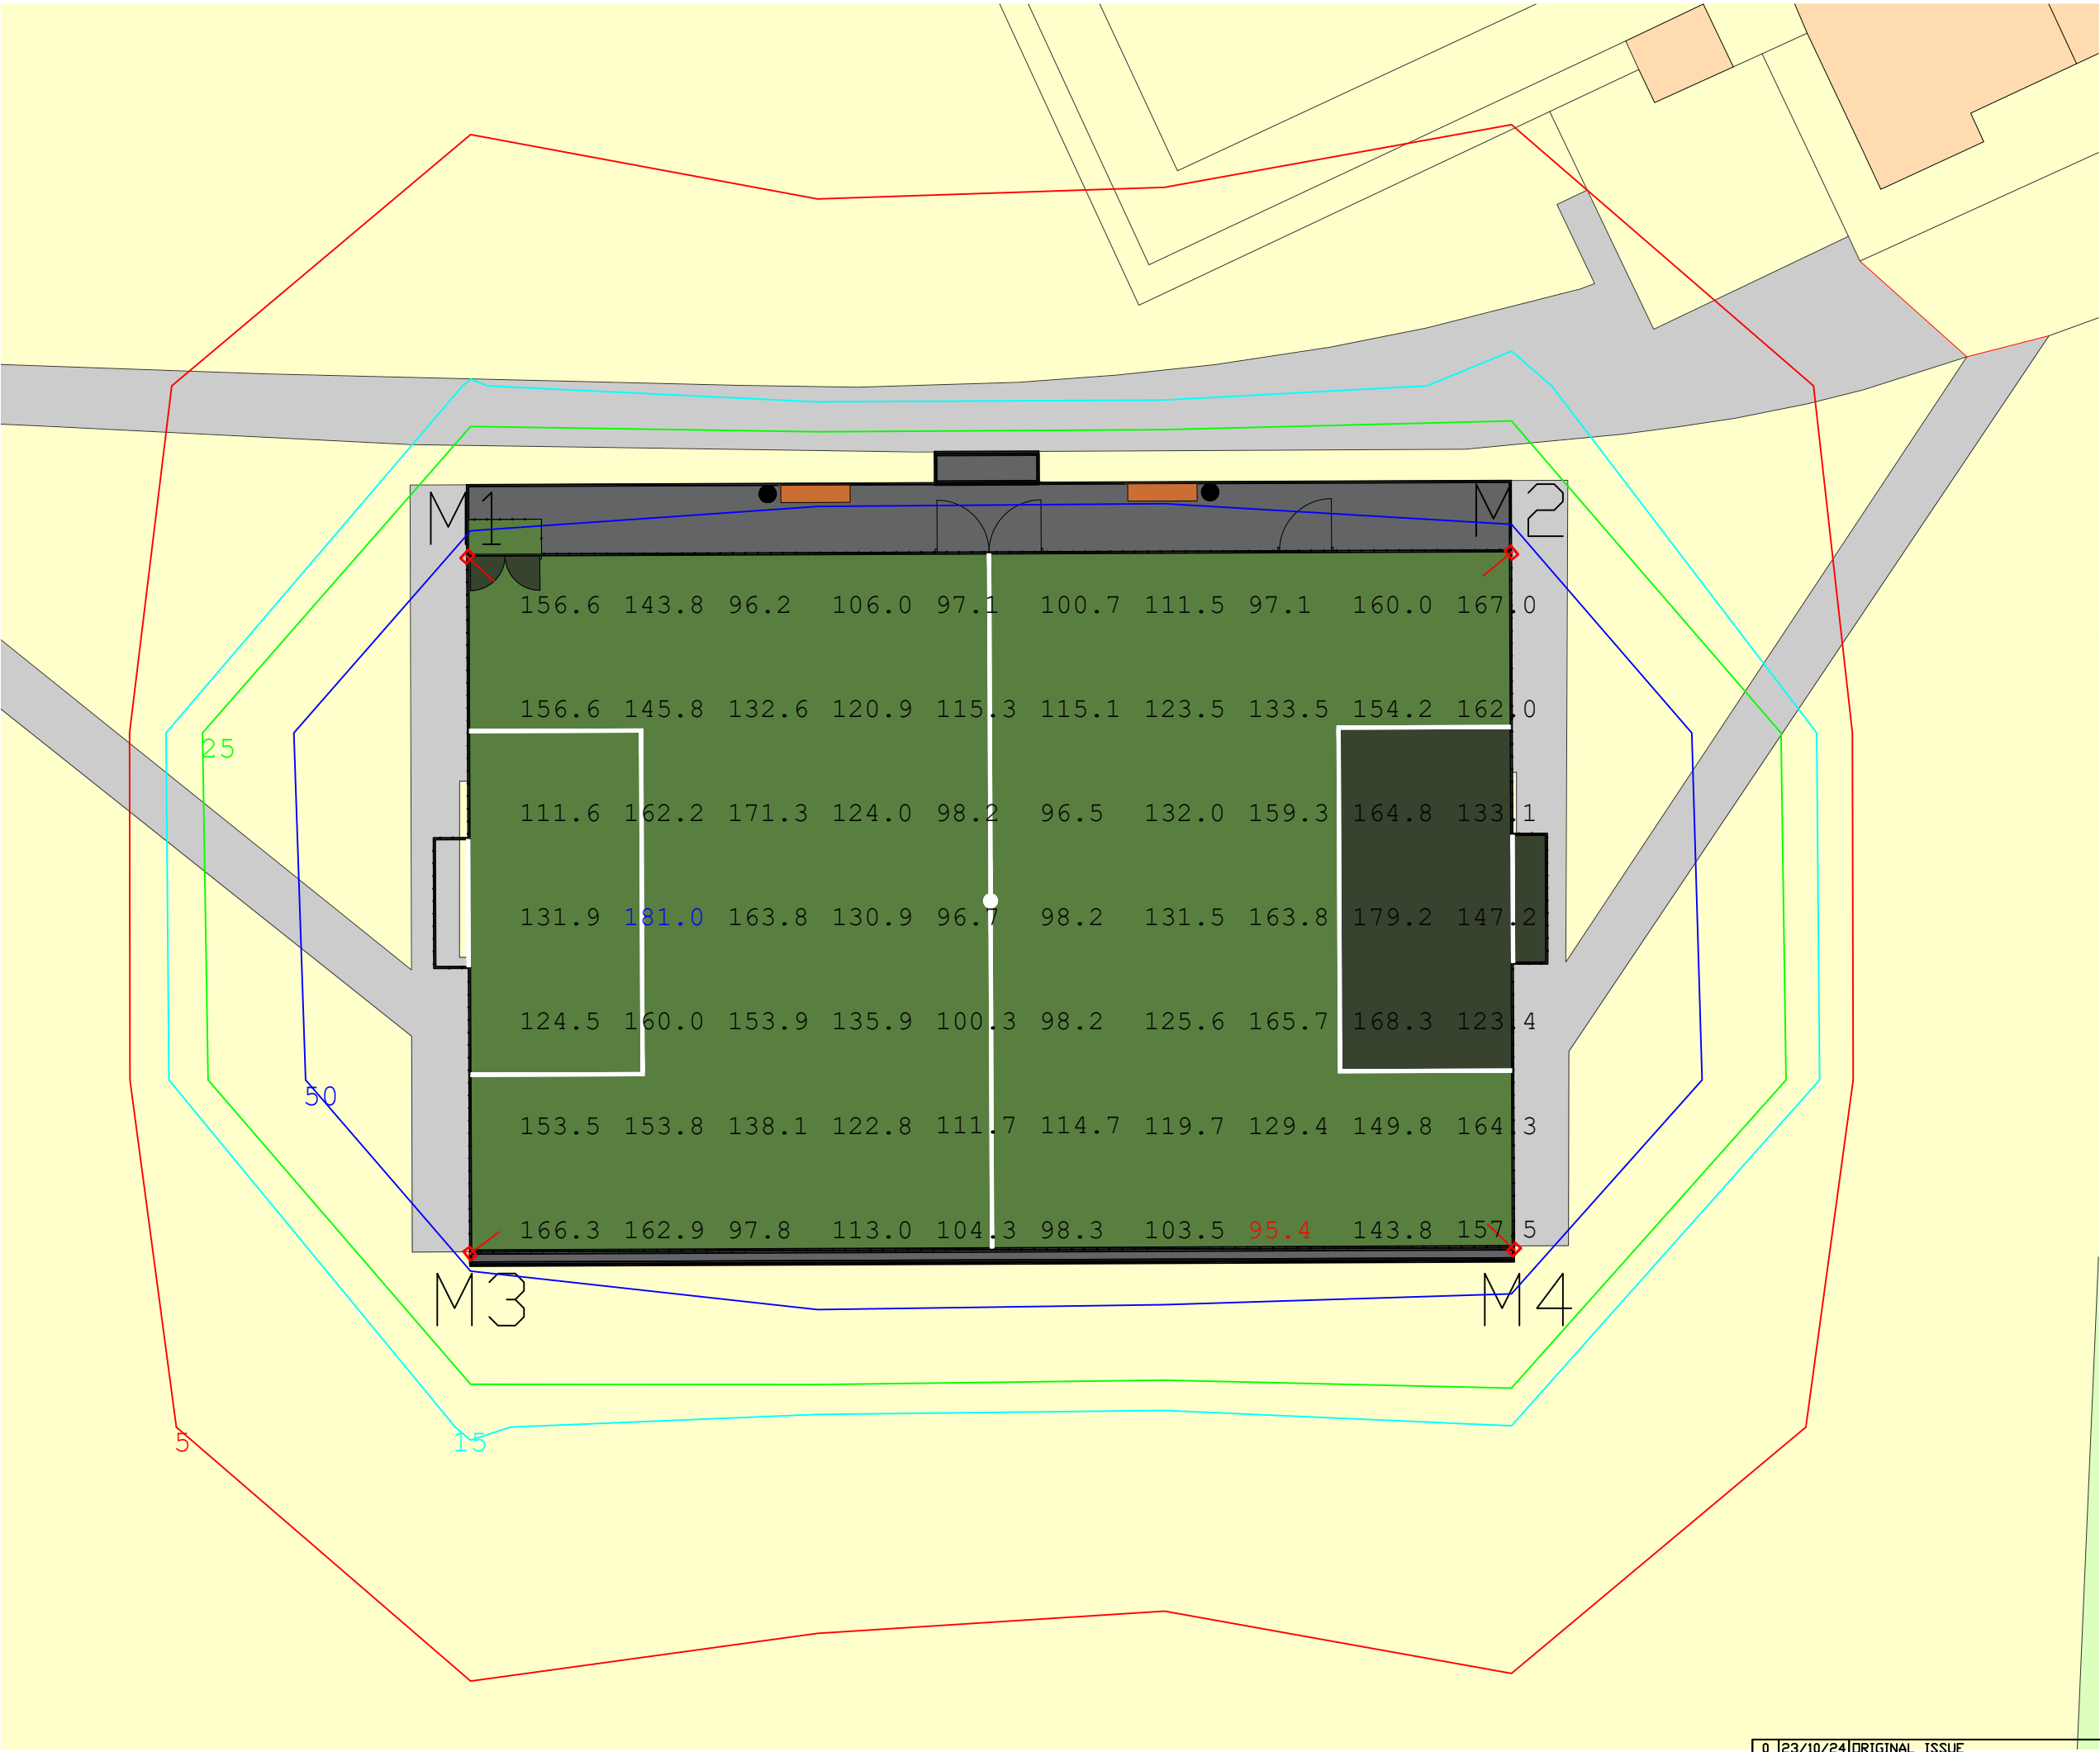

NOTES:
Floodlighting Equipment
4 x 6m Masts (M1-M4)
Each carrying the following Floodlights :-
M1-M4
...1 x Siteco FL21 Midi

Lamps = Siteco LED - 4,000K CRI 70

Illuminance Levels
Initial -
(100hrs) E.i.ave = 133Lux
Maintained -
(4000hrs) E.i.ave = 120Lux
Uniformity
Emin/Eave = 0.72
Emin/Emax = 0.53

Grid values in Lux(initial).
Grid interval = 3m.
Contour values in Lux (initial).
Contours: 5, 15, 25, 50 Lux.

Maintenance Factor = 0.90
(Based on a cleaning interval of 2 years)



www.halliday-lighting.co.uk
THIS DRAWING & THE INFORMATION CONTAINED THEREIN IS THE PROPERTY OF
HALLIDAY LIGHTING LTD AND SHOULD NOT BE COPIED IN WHOLE OR IN PART,
DISCLOSED TO ANY THIRD PARTY OR USED FOR ANY OTHER PURPOSE WITHOUT
THE PRIOR WRITTEN CONSENT OF HALLIDAY LIGHTING
email - info@halliday-lighting.co.uk

PROJECT NAME:
King George V

DRAWING TITLE:
Proposed Floodlighting
Page 1: Pitch levels

DRAWN BY: JDW	DATE: 13/01/2025
CHECKED BY: JDW	SCALE: NTS

DRAWING No: HLS9401	REVISION: REV 2
------------------------	--------------------

0	23/10/24	ORIGINAL ISSUE	JDW	JM
1	06/01/25	Changed to 120 lux	JDW	JM
2	13/01/25	Updated background	JDW	JDW

DBTRUSIVE LIGHT 1



Obtrusive Light - Compliance Report

CIE 150:2003, E2-Rural, Pre-Curfew
Filename: HLS9401 rev 1
06/01/2025 10:58:50

Illuminance

Maximum Allowable Value: 5 Lux

Calculations Tested (3):

Calculation Label	Test Results	Max. Illum.
ObtrusiveLight_1_Ill_Seg1	PASS	0.0
ObtrusiveLight_2_Ill_Seg1	PASS	0.1
ObtrusiveLight_3_Ill_Seg1	PASS	0.0

Luminous Intensity (Cd) At Vertical Planes

Maximum Allowable Value: 7500 Cd

Calculations Tested (3):

Calculation Label	Test Results
ObtrusiveLight_1_Cd_Seg1	PASS
ObtrusiveLight_2_Cd_Seg1	PASS
ObtrusiveLight_3_Cd_Seg1	PASS

NOTES:

Floodlighting Equipment

4 x 6m Masts (M1-M4)

Each carrying the following Floodlights :-
M1-M4

...1 x Siteco FL21 Midi

Lamps = Siteco LED - 4,000K CRI 70

Illuminance Levels

Initial -

(100hrs) E.i.ave = 133Lux

Maintained -

(4000hrs) E.i.ave = 120Lux

Uniformity

Emin/Eave = 0.72

Emin/Emax = 0.53

Grid values in Lux(initial).

Grid interval = 3m.

Contour values in Lux (initial).

Contours: 5, 15, 25, 50 Lux.

Maintenance Factor = 0.90

(Based on a cleaning interval of 2 years)

DBTRUSIVE LIGHT 2

DBTRUSIVE LIGHT 3



www.halliday-lighting.co.uk

THIS DRAWING & THE INFORMATION CONTAINED THEREIN IS THE PROPERTY OF
HALLIDAY LIGHTING LTD AND SHOULD NOT BE COPIED IN WHOLE OR IN PART,
DISCLOSED TO ANY THIRD PARTY OR USED FOR ANY OTHER PURPOSE WITHOUT
THE PRIOR WRITTEN CONSENT OF HALLIDAY LIGHTING
email - info@halliday-lighting.co.uk

PROJECT NAME:

King George V

DRAWING TITLE:

Proposed Floodlighting
Page 2: Obtrusive Light

DRAWN BY:

JDW

DATE:

13/01/2025

CHECKED BY:

JDW

SCALE:

NTS

DRAWING No:

HLS9401

REVISION:

REV 2

0	23/10/24	ORIGINAL ISSUE	JDW	JM
1	06/01/25	Changed to 120 lux	JDW	JM
2	13/01/25	Updated background	JDW	JDW