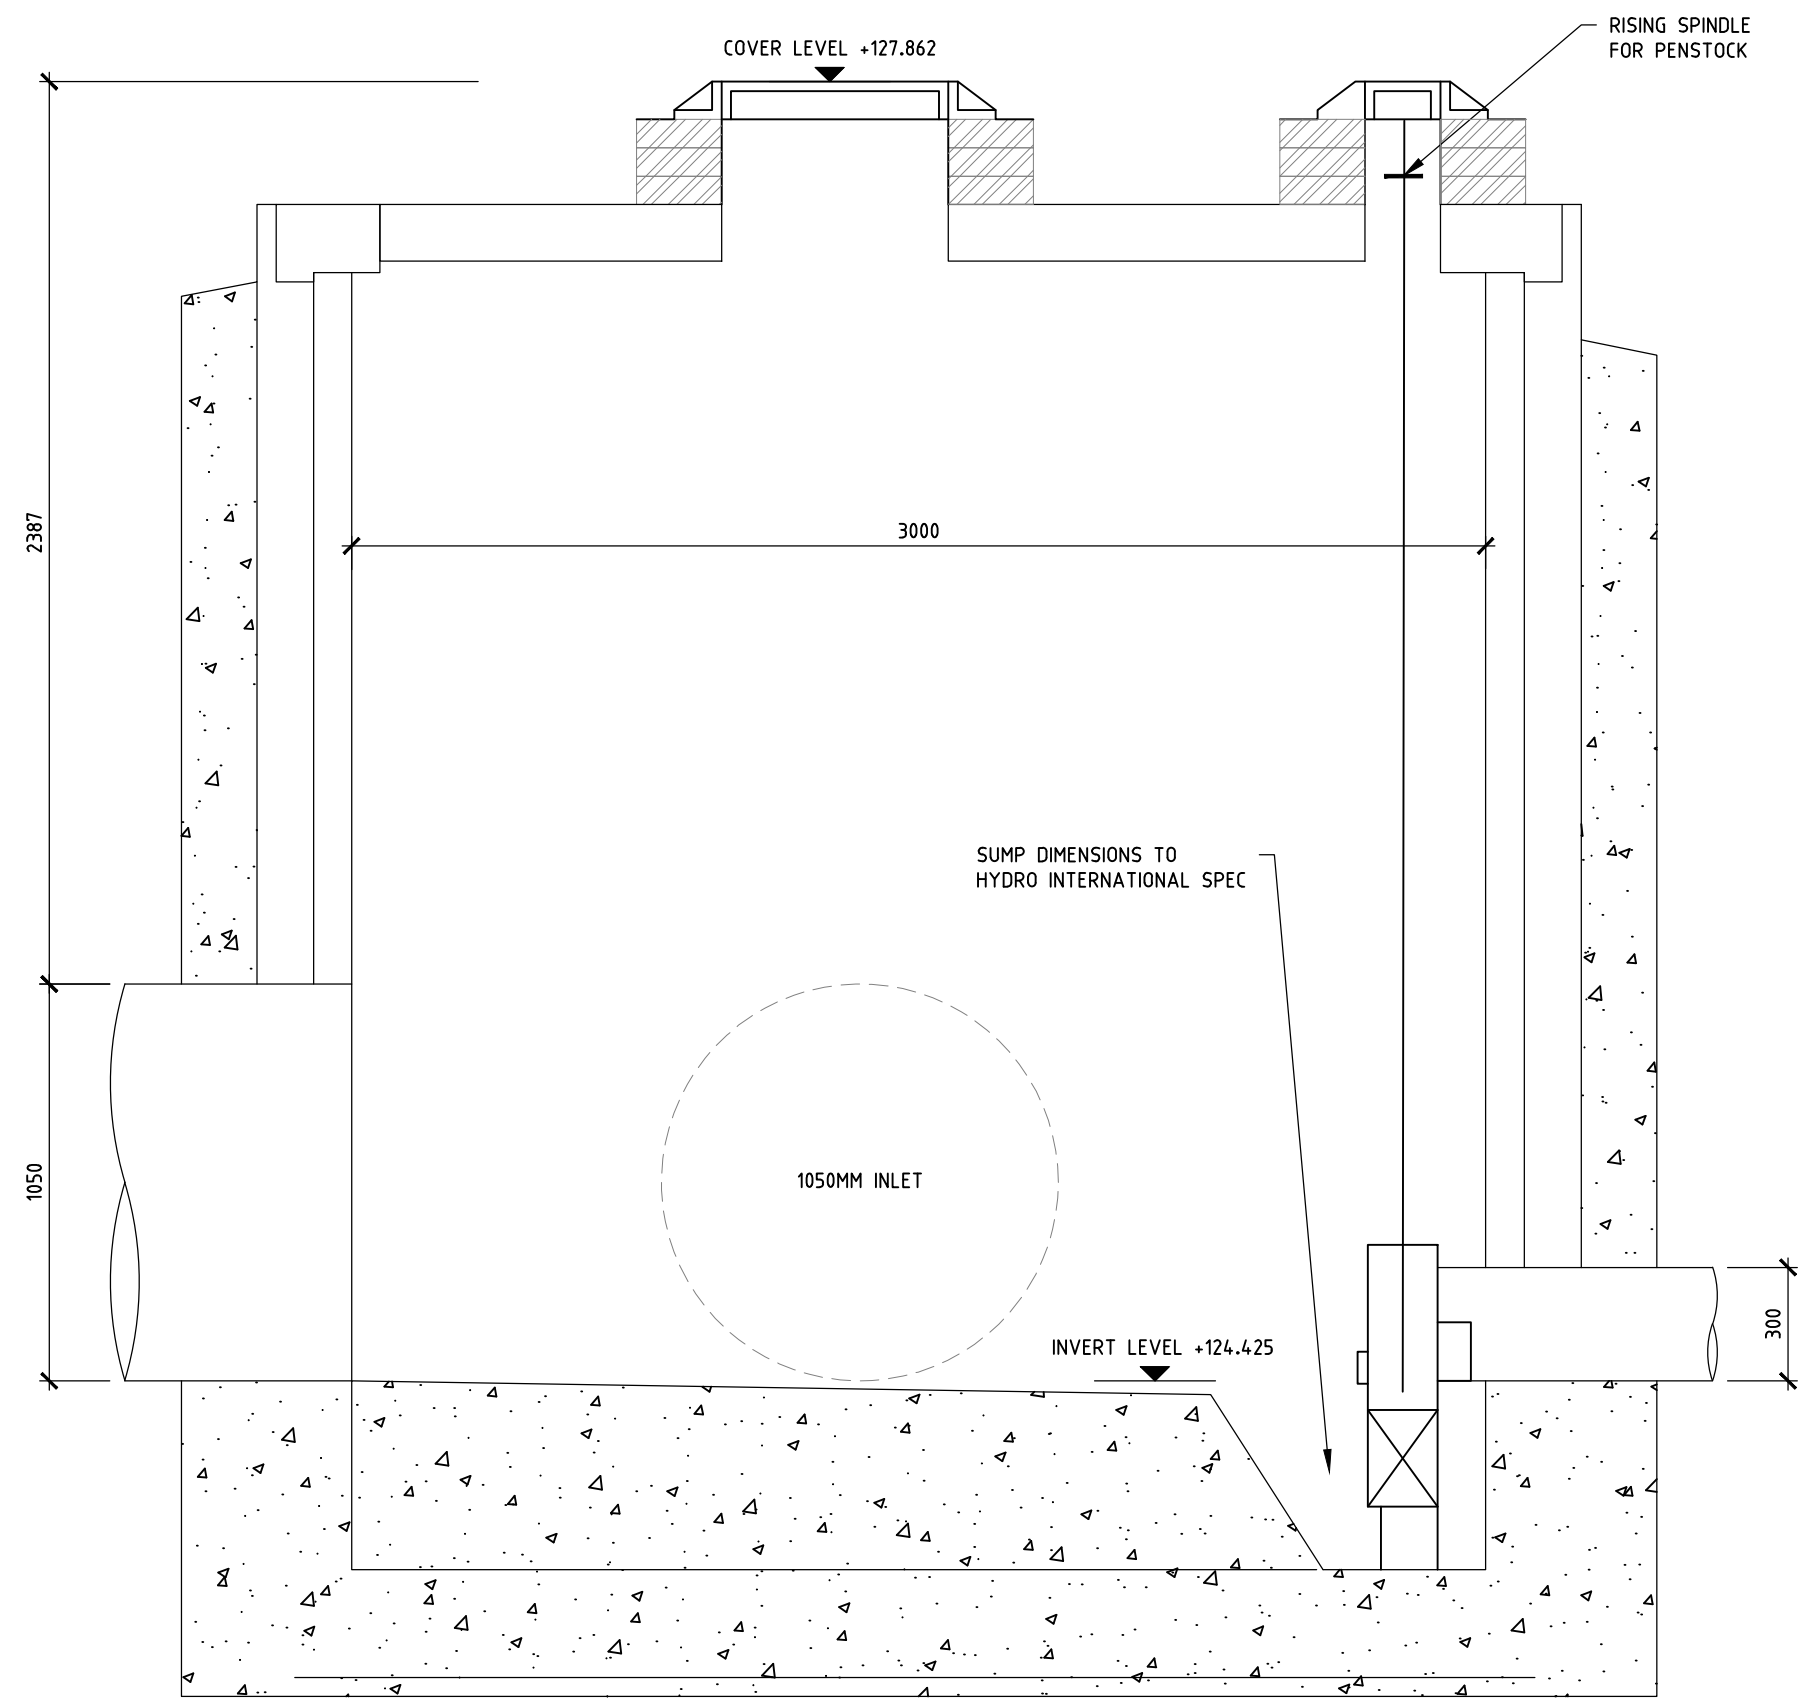
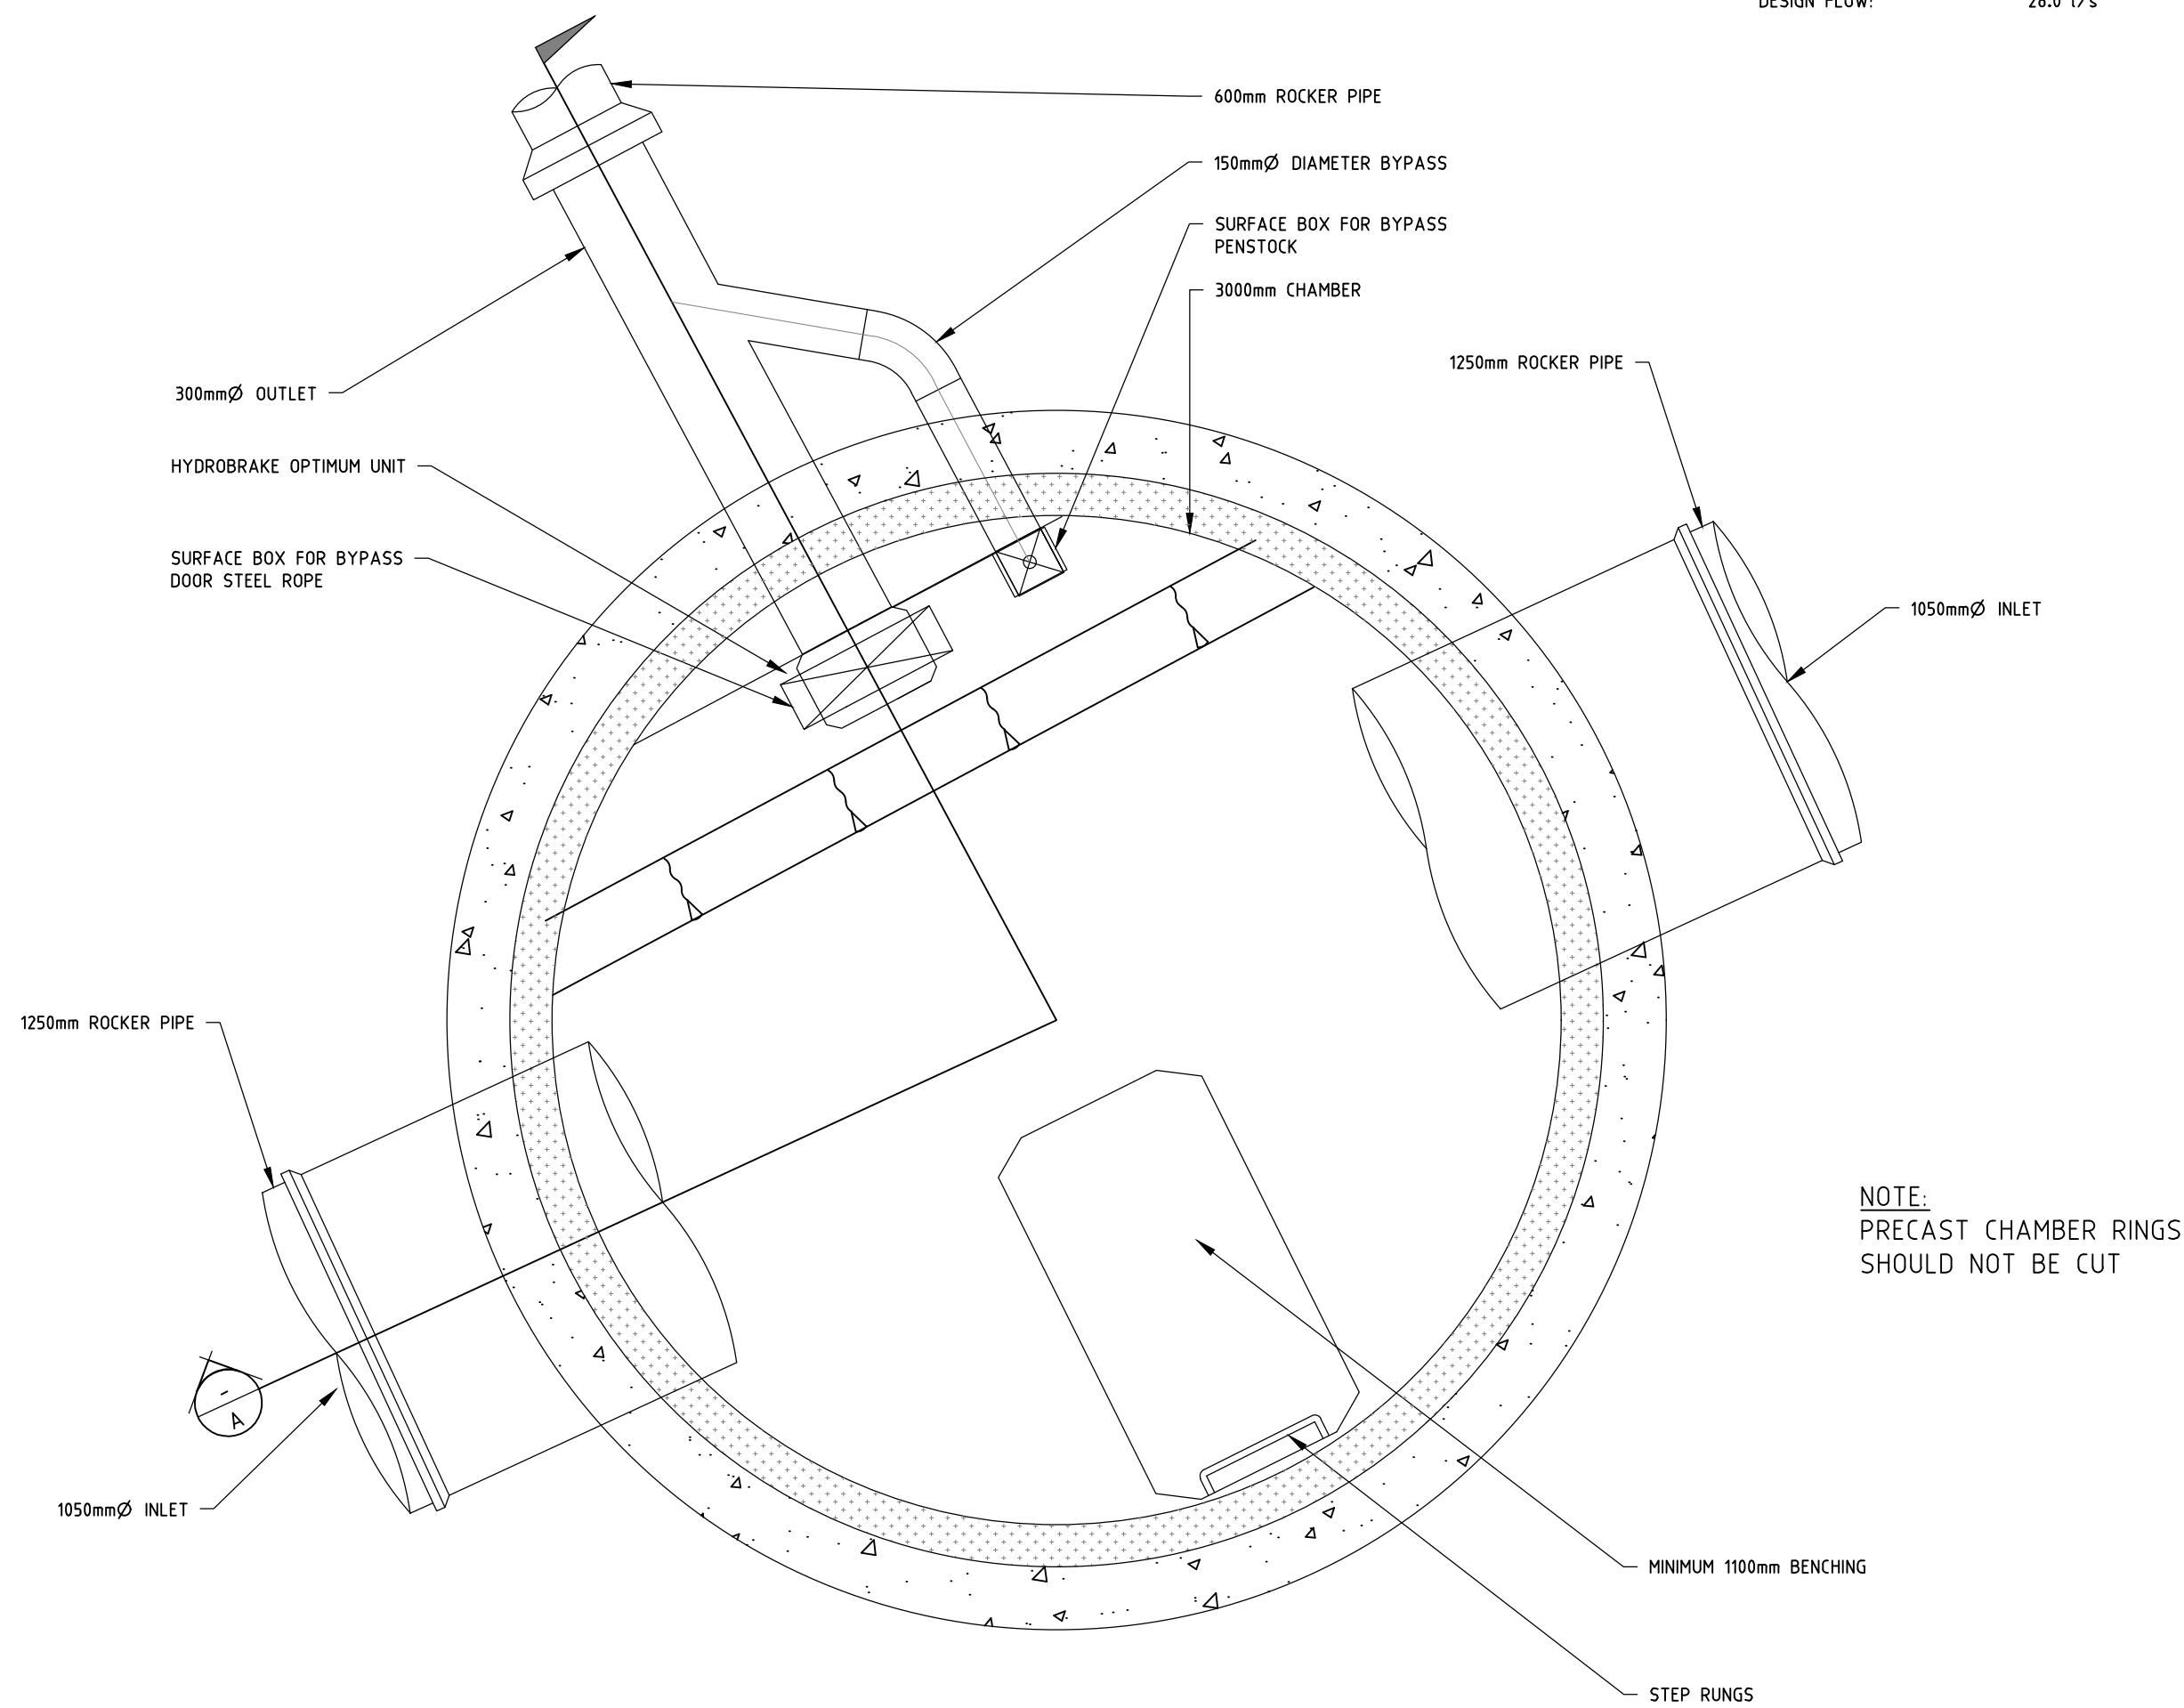


MANHOLE S5 HYDROBRAKE

COVER LEVEL: 127.862
INVERT LEVEL: 1050mm 124.425
DEPTH TO SOFFIT: 2.387
MAHOLE TYPE: UU TYPE 5
COVER TYPE: DOUBLE 1200 X 675 CLEAR OPENING
HYDROBRAKE SPECIFICATION: MD-SHE-0215-2800-0250-2800
ORIFICE SIZE: 215mm
DESIGN HEAD: 2.05m
DESIGN FLOW: 28.0 l/s

MANHOLE S5 HYDROBRAKE
SECTION A

NOTES:

- ALL SEWERS ARE DESIGNED IN ACCORDANCE WITH SEWERS FOR ADOPTION 6TH EDITION AND UNITED UTILITIES GUIDELINES AND STANDARD DETAILS.
- ALL CO-ORDINATES AND LEVELS SHOWN ARE RELATIVE TO THE TOPOGRAPHIC SURVEY.
- IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE ANY EXISTING SEWERS ARE IN THE LOCATION INDICATED AND ANY EXISTING GROUND AND INVERT LEVELS SHOWN ON THE DRAWING ARE CORRECT PRIOR TO THE COMMENCEMENT OF ANY WORKS. ANY DISCREPANCIES MUST BE MUST BE REPORTED IMMEDIATELY.
- PRIOR TO THE COMMENCEMENT OF ANY ON SITE WORKS THE CONTRACTOR MUST CONTACT THE STATUTORY UNDERTAKER AND BE IN POSSESSION OF THE LATEST DRAWINGS SHOWING THEIR APPARATUS.
- IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ALLOW FOR THE SUPERVISION OF THE CONSTRUCTION WORKS BY UNITED UTILITIES AND/ OR ROCHDALE BOROUGH COUNCIL. THE CONTRACTOR WILL NOTIFY THE SUPERVISING OFFICER GIVING NOTICE WHICH WILL BE IN ACCORDANCE WITH THE AUTHORITIES REQUIREMENTS.
- THE PROPOSED SEWERS WILL BE CLAY PIPE WORK AND SHALL BE EXTRA STRENGTH TO BS EN 295:1991 PART 1.
- ANY PCC PIPE WORK WILL BE IN ACCORDANCE WITH BS EN 1916:2002.
- ALL MANHOLES AND CHAMBERS SHALL BE IN ACCORDANCE WITH BS EN 1917:2002
- SEWERS WITH COVER TO SOFFIT GREATER THAN 1.2m IN ROADS AND 0.9m IN FIELDS SHALL HAVE CLASS 5 BED AND SURROUND ALL IN ACCORDANCE WITH UNITED UTILITIES STANDARD DETAIL STDN/05/001.
- PRIVATE DRAINAGE CONNECTIONS TO THE SEWER WILL BE 150MM DIAMETER AND LAID TO THE SPECIFIED INVERT.
- THE INVERT LEVELS SPECIFIED AT THE DRAGOUT CHAMBER ARE INCOMING LEVELS.
- WHEREVER POSSIBLE PRIVATE DRAINAGE RUNS WILL REMAIN WITHIN THE CURTILAGE OF THE DWELLING FOR WHICH THEY SERVE.
- THE CONNECTION TO THE ADOPTABLE SEWER SHALL BE MANUFACTURED JUNCTION PIPES A SADDLE CONNECTION IS NOT PERMITTED UNLESS IT IS CLEARLY SPECIFIED.
- ANY SEWER FOR ADOPTION WITH A COVER OF LESS THAN 1.2M TO PIPE SOFFIT IN ROADS OR 0.9m TO PIPE SOFFIT IN FIELDS WILL HAVE A MINIMUM 150mm GEN 3 CONCRETE BED AND SURROUND WITH FLEXIBILITY MAINTAINED WITH FLEXCELL EXPANSION JOINT FILLER OR SIMILAR APPROVED AT EACH PIPE JOINT.
- CONCRETE MXX FOR MANHOLE SURROUNDS TO BE GEN3.
- INSTALL GULLIES, MANHOLES, GRATES, COVERS AND ALL ANCILLARY ITEMS TO MANUFACTURERS SPECIFICATION.
- ALL MANHOLES INCLUDING 1950MM DIAMETER TO BE KITEMARKED AND COMPLY TO BS EN 1917:2002.
- ALL MANHOLES TO BE INSTALLED IN ACCORDANCE WITH UNITED UTILITIES DETAILS AND HYDRO INTERNATIONAL SPECIFICATION.
- CONNECTIONS TO THE EXISTING SEWER WILL BE IN ACCORDANCE WITH SECTION 10. APPROVAL GRANTED BY UNITED UTILITIES.
- SEWERS/MANHOLES TO BE ABANDONED TO BE EITHER GROUTED UP OR GRUBBED OUT. UU INSPECTOR TO SIGN OFF WORKS ON COMPLETION.
- TOTAL SURFACE WATER DISCHARGE RATE QUOTED IS 30 LITRES PER SECOND. UNITED UTILITIES PRE DEVELOPMENT ENQUIRY RESPONSE TO CONFIRM ALLOWABLE DISCHARGE RATE.

C01	10.08.22	ISSUED FOR CONSTRUCTION		H.S	R.A
P01	20.07.22	PRELIMINARY - Issued for Information		J.C	R.A
Rev	Date	Description		By	CHK

EDGE
CONSULTING
ENGINEERS
www.edgece.com

Manchester . UK
3rd Floor, Canonon Court,
12 Blackfriars Street,
Manchester, M3 9BQ,
United Kingdom

T: +44 (0) 161 834 1938
E: manchester@edgece.com

The concepts + information contained in this document are the copyright of EDGE Consulting Engineers.
Use or copying of this document in whole or in part without the written permission of EDGE Consulting Engineers
constitutes an infringement of copyright.
DO NOT SCALE DRAWINGS. IF IN DOUBT, ASK!

Project Name NIXON STREET ROCHDALE			
Client HIVE HOMES			
Designed R.A	Drawn J.C	Checked R.A	Scale @ A1 1:20
Drawing Title HYDROBRAKE MANHOLE DETAILS			
Project No. 20066		ISSUED FOR CONSTRUCTION	
Drawing No. C2104		Revision C01	