



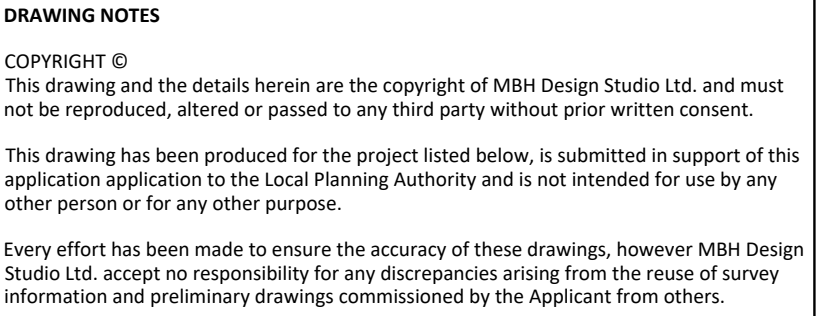


The diagram shows a substation enclosure with a door that is open, revealing internal components. A warning label is affixed to the inside of the door, reading: "SUBSTATION ENCLOSURE", "EN/ICO", and "ENG TR7".

DENOTES DNO HV/LV SUBSTATION
Typical GRP Enclosure 2.8m x 2.8m
All to service provider standard details

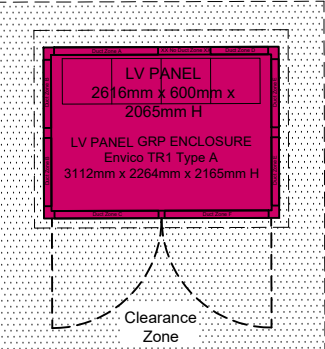


4 or more chargers
DENOTES LV PANEL GRP ENCLOSURE
Envico Engineering Ltd
 TR14
 Unit Size 3112mm x 2800mm x 2264mm H
 MAKE OF GRP ENCLOSURE TBC



RAPTION 150 SERIES
POWER PACK
1000 W x 800 D x 2100mm
H



RAPTION 150 SERIES
CHARGER
470 W x 380 D x 1867mm H

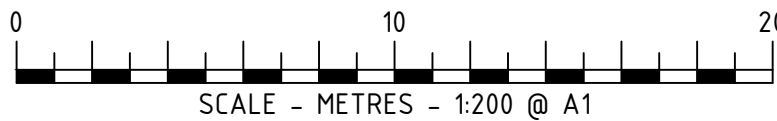

REV	DATE	DESCRIPTION	DRAWN/CHECKED
REVISION NOTES			
PLANNING  MBH Design Studio Ltd. Rosemount House, Rosemount Avenue, West Byfleet, Surrey, KT14 6LB www.mbh ltd.com t: 01932 352 727 f: 01932 351 545			
CLIENT 			
PROJECT FS352 GREENGATE SERVICE STATION GREENGATE, MIDDLETON, MANCHESTER, M24 1RD			
DRAWING TITLE PROPOSED SITE LAYOUT			
DRAWN BY	DATE	SCALE	PAPER SIZE
JP	01.09.2020	1:200	A1
CHECKED BY	DRAWING NUMBER	REV.	
JN	13664-P02-352		