


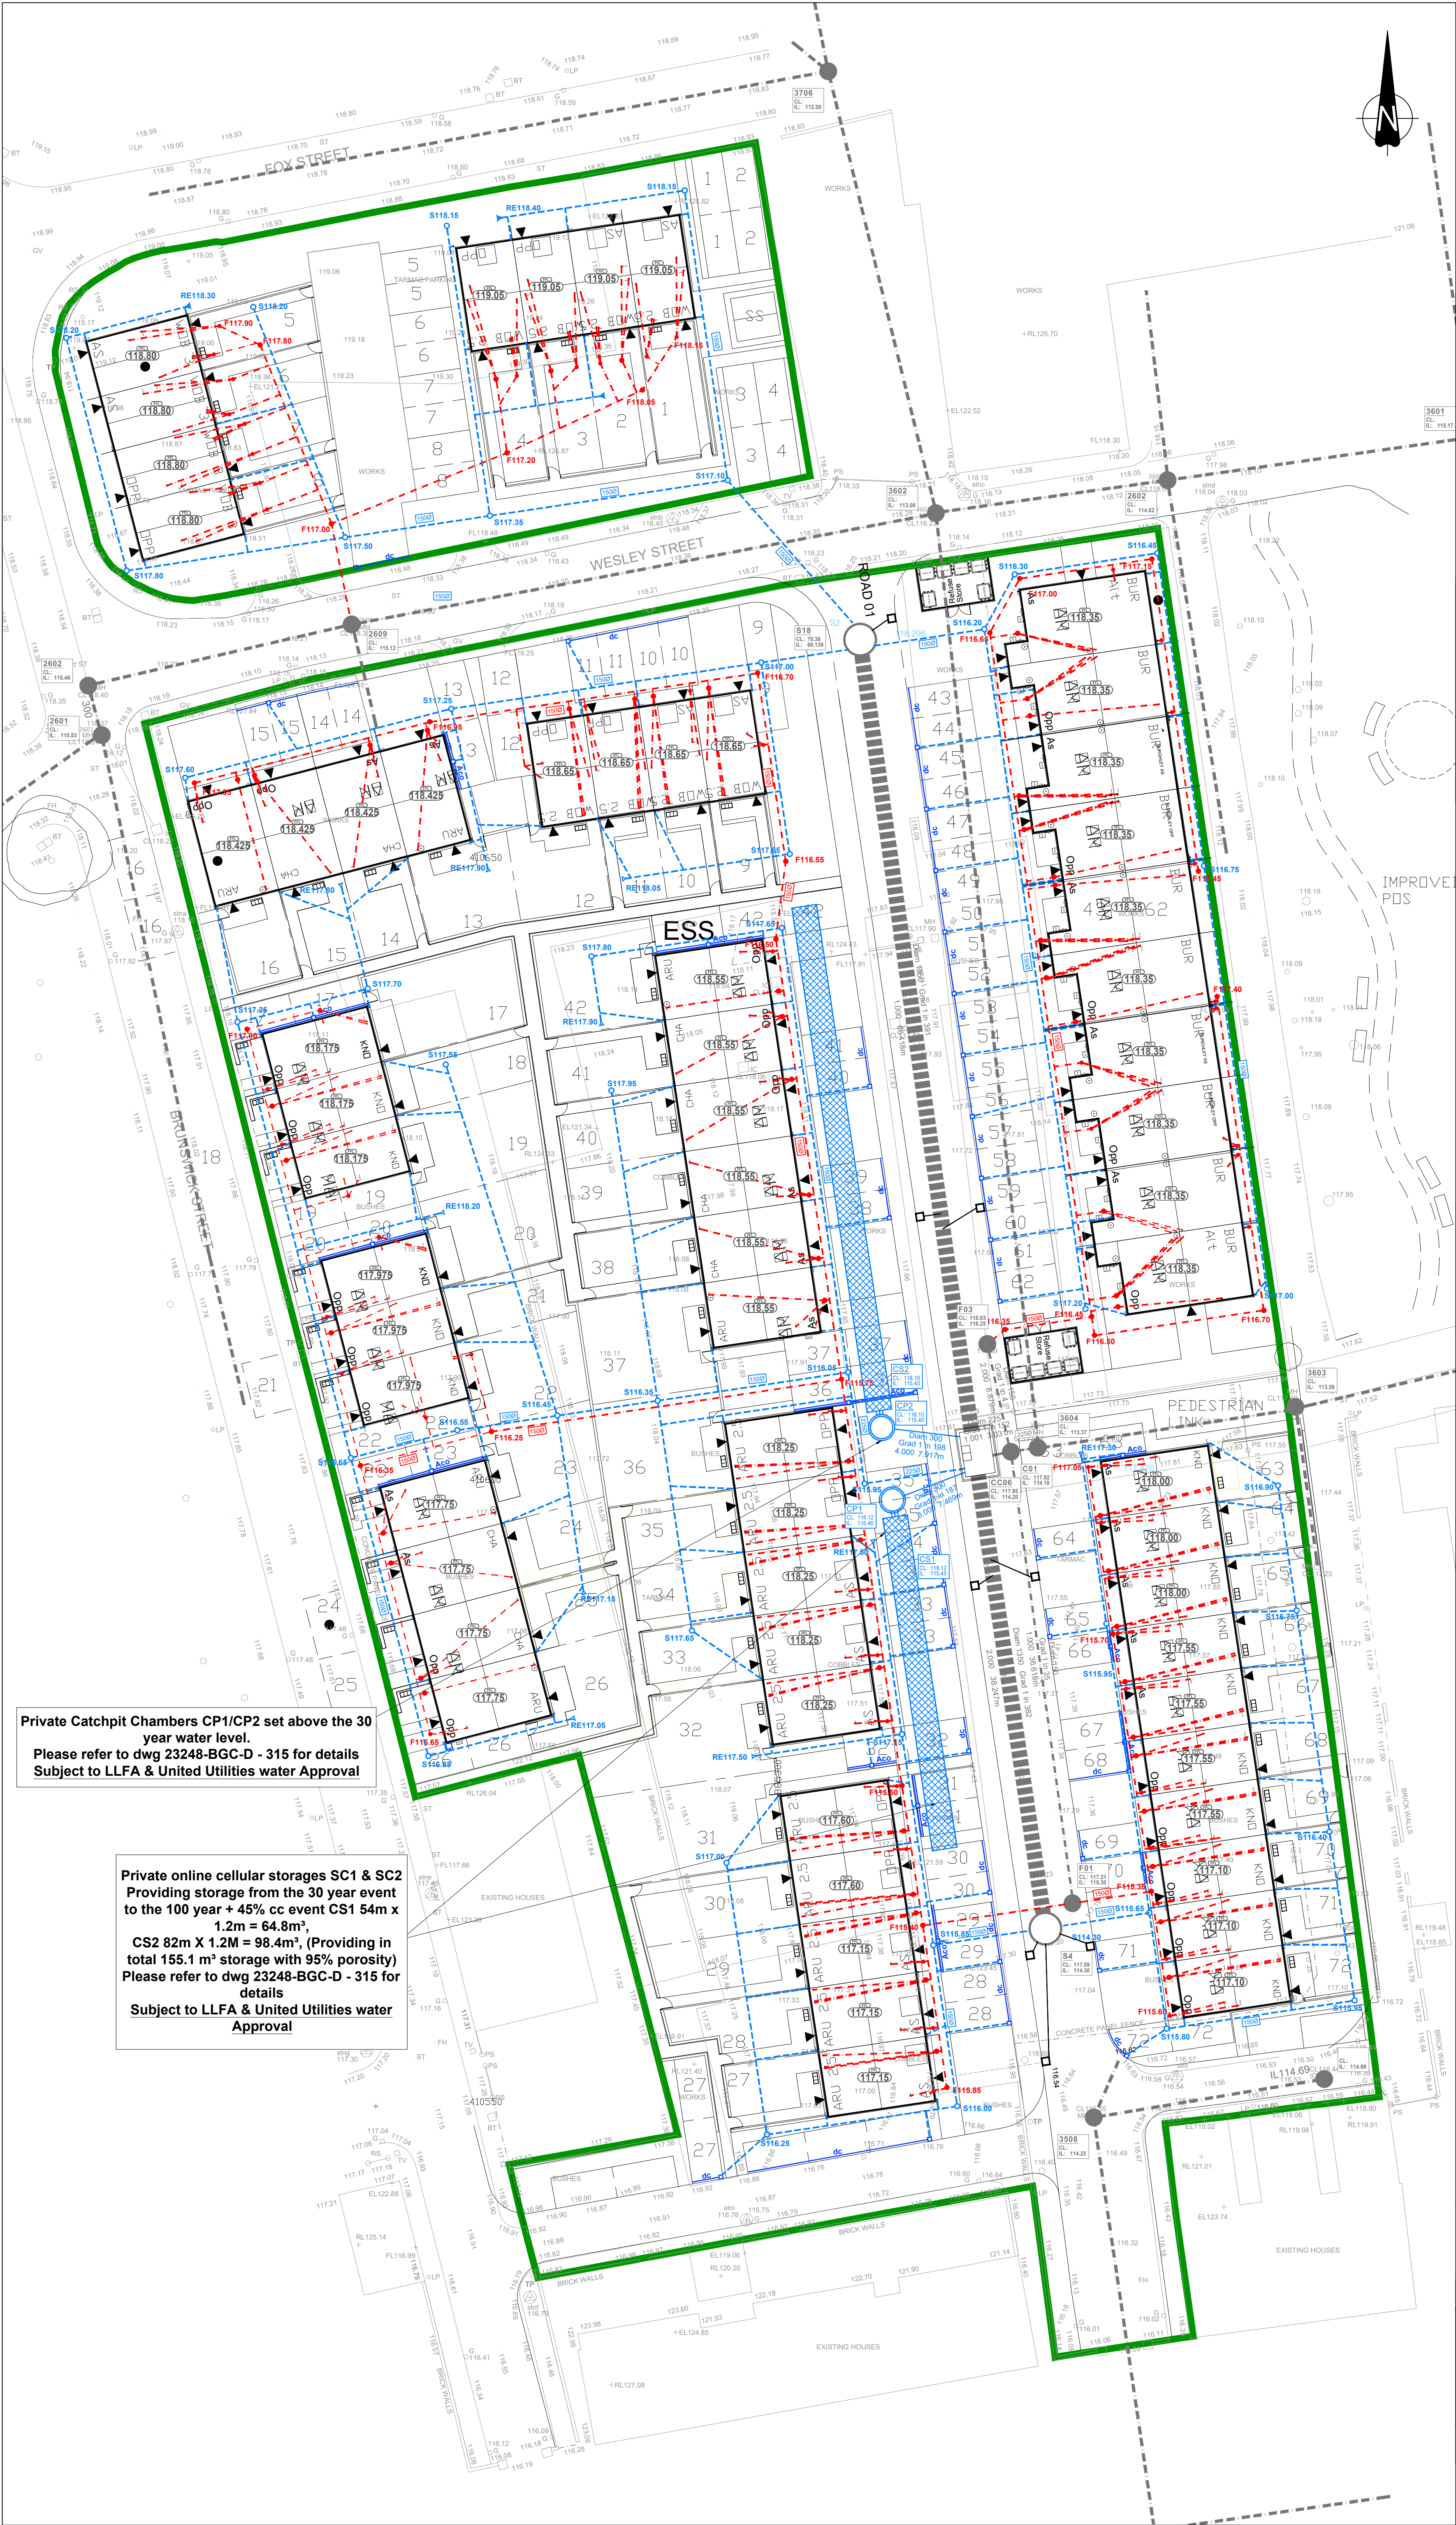

This drawing and the building works depicted are the copyright of Banners Gate Ltd and may not be reproduced or amended except by written permission. No liability will be accepted for amendments made by other persons.

The Contractor is to check and verify in conjunction with the Architects details all setting out points, building and site dimensions, levels and sewer invert levels at connection points and ensure that they are fully compliant with the contents and requirements of the site investigation report before work starts. The Contractor is to comply in all respects with current building legislation, British Standard Specifications, Building Regulations etc, and/or in the specific details of the drawing.

This drawing is not intended to show details of ground conditions or ground constraints. Each area of ground relied upon to support any structure, building, excavation etc, and/or in the specific details of the drawing, shall be investigated by a suitable expert. Any earthworks shown indicate typical aspects for guidance only and should be investigated further by a suitable geotechnical expert. Where existing trees are shown to be retained they should be subject to a full Arborescence report for safety. All trees are to be planted so as to ensure they are a minimum of 3 metres from buildings and 2 metres from drainage and services, where applicable. A foundation is to be provided to accommodate the proposed tree planting, where applicable.

GENERAL NOTES

- This drawing is to be read in conjunction with relevant architectural and engineering drawings.
- Levels indicated in blocks are Finished floor levels and are 150mm above adjacent finished ground levels
- Levels of the existing road at the point of tie-in with proposed site road must be checked prior to commencement of works.
- Any discrepancies between the details shown and actual on site conditions to be reported immediately to the engineer prior to commencement of works.

BUILDING DRAINAGE NOTES

- Building drainage shall comply with BS EN 752 2008 and the Building Regulations 2002 part H (updated 2015).
- All SVP, RWP and BIG are indicative and must be confirmed on site using latest architectural plans. Any discrepancies must be reported to Engineer prior to commencement on site.
- All building drainage shall be 100mm diameter unless shown otherwise.
- All building drainage shall be clayware to BS EN 295 or uPVC to BS 4660 and BS EN 1401-1 with Class B or Class S bedding unless shown otherwise.
- All pipes under buildings without suspended floors shall have Class S bedding.
- Concrete protection shall be provided to all pipes with less than 600mm cover in pedestrian areas, to all pipes with less than 600mm cover in private driveways not used by commercial vehicles, and to all pipes with less than 1200mm cover to roads or private driveways used by commercial vehicles. Where concrete surround is specified flexibility of joints is to be maintained by using compressible bitumen impregnated fibreglass at each joint.
- Where a pipe passes through a wall an opening is to be formed to give at least 50mm clearance around the pipe. Blockwork over shall be supported by a lintel. The opening is to be finished each side with rigid sheet material. Pipes embedded in walls shall have a joint formed within 150mm of each wall face. A rubber pipe of maximum 500mm length shall be used to continue the pipework.
- Where a pipe trench is within 1m of a building, the pipe is to be provided with concrete protection and the trench filled with concrete up to a level below the building equal to the distance from the building less 150mm.
- Where the formation of a pipe trench is above original ground level levels are to be made up with well compacted DTP Type 2 material or better.
- Inspection chambers located within garages are to have double seal bolt down covers.
- All private drives which fall towards a public highway and exceed two parking bays in area are to be provided with a suitable gully or drainage channel to prevent water discharging onto the highway.
- Where a driveway falls towards a dwelling it shall be provided with a suitable gully or drainage channel to prevent water discharging the building.
- The invert level of a rodding eye at the head of a surface water drain is to be set 450mm below finished ground level unless shown otherwise.
- The maximum depth of both foul and storm access chambers is 600mm below finished ground level.
- The invert level of an inspection chamber on a foul drain from a building is to be set in accordance with the following table unless otherwise shown. Inspection chambers should be used for connections longer than 12m as stated in Part H. This is assuming a 450mm floor construction thickness and 1:40 fall to inspection chamber which must be confirmed prior to construction.

Maximum Length of Connection	8m	11m	14m	17m	20m
Minimum Invert Depth below FFL	750mm	825mm	900mm	975mm	1050mm

*Inspection Chamber to be used for connections longer than 12m as stated in Part H.

PLOT DRAINAGE LEGEND:

FOUL WATER

- FOUL WATER SEWER (100mm UNLESS OTHERWISE STATED)
- DEEP INSPECTION CHAMBER (600mm MAXIMUM DEPTH)
- SHALLOW INSPECTION CHAMBER (100mm MAXIMUM DEPTH)
- FOUL WATER PIPE DIAMETER
- ACO CHANNEL DRAIN & GULLY
- DESHED CHANNEL & GULLY
- YARD GULLY & COVER LEVEL
- S38 HIGHWAY GULLY

STORM WATER

- STORM WATER SEWER (100mm UNLESS OTHERWISE STATED)
- DEEP INSPECTION CHAMBER (600mm MAXIMUM DEPTH)
- SHALLOW INSPECTION CHAMBER (100mm MAXIMUM DEPTH)
- STORM WATER PIPE DIAMETER
- ACO CHANNEL DRAIN & GULLY
- DESHED CHANNEL & GULLY
- YARD GULLY & COVER LEVEL
- S38 HIGHWAY GULLY

SURFACE WATER CATCHMENT

- ACO CHANNEL DRAIN & GULLY
- DESHED CHANNEL & GULLY
- YARD GULLY & COVER LEVEL
- S38 HIGHWAY GULLY

GENERAL

- DEVELOPMENT BOUNDARY

Rev.	First Issue	Description	23.01.2024	MA
Drawing Status	PRELIMINARY			
Client	Subject to Client approval as part of ongoing consultations and design check, amendments may therefore be requested.			
Project	Brunswick Street, Heywood Greater Manchester			
Title	Plot Drainage Plan			

BANNERS GATE

CIVIL, STRUCTURAL & ARCHITECTURAL DESIGN SERVICES

10-11 Birmingham Street, Halesowen, West Midlands B63 3JN

Tel: 0121 687 1500 Fax: 0121 687 1501

E-mail: mail@bannersgate.com

Scale	A1 @ 1:250	Drawn	MA
Date	January 2024	Checked	RA
File	23248/dwg/civils/current	Drawing	23248-BGC-D- 111