
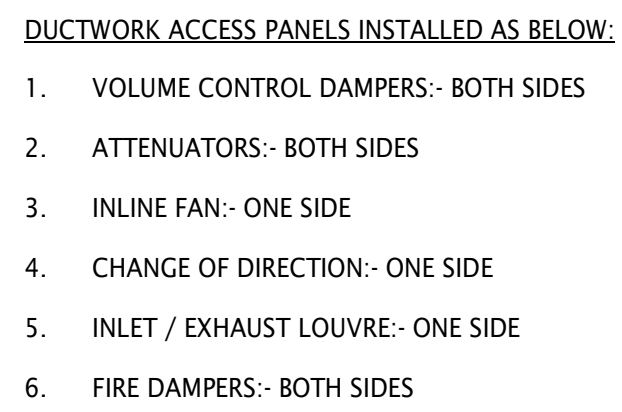


REV	DESCRIPTION	DATE	BY
AF	AS FITTED	12.05.23	MC

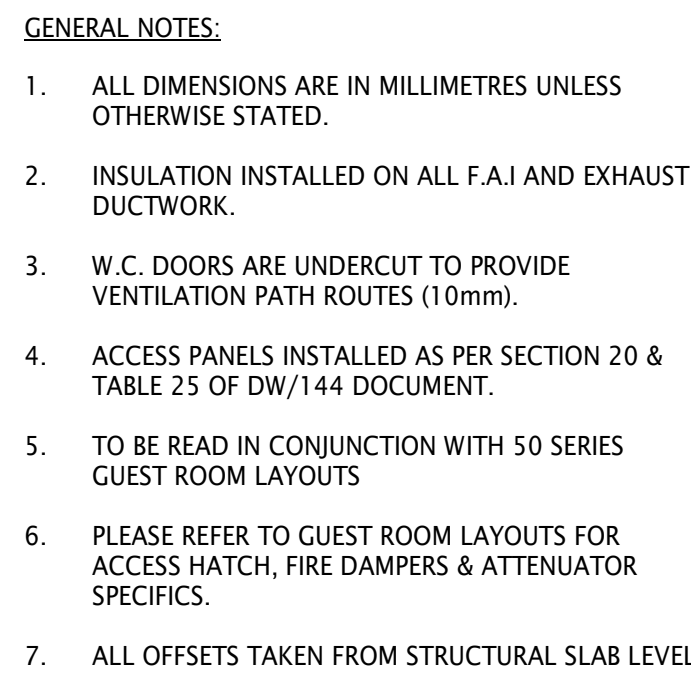

- - SUPPLY DUCT
-  - EXTRACT DUCT
-  - FRESH AIR INTAKE DUCT
- - EXHAUST DUCT

1 : 50

S7 - Level 01 HRU Schedule					
Ref	Location	Manufacturer	Model	Flowrate (m3/s)	Max SFP (W/l/s)
HRU-01-01	Fitness Suite	Nuair	UNI-X220	0.05	1.6
HRU-01-02	Fitness Suite	Nuair	UNI-X220	0.05	1.6

