



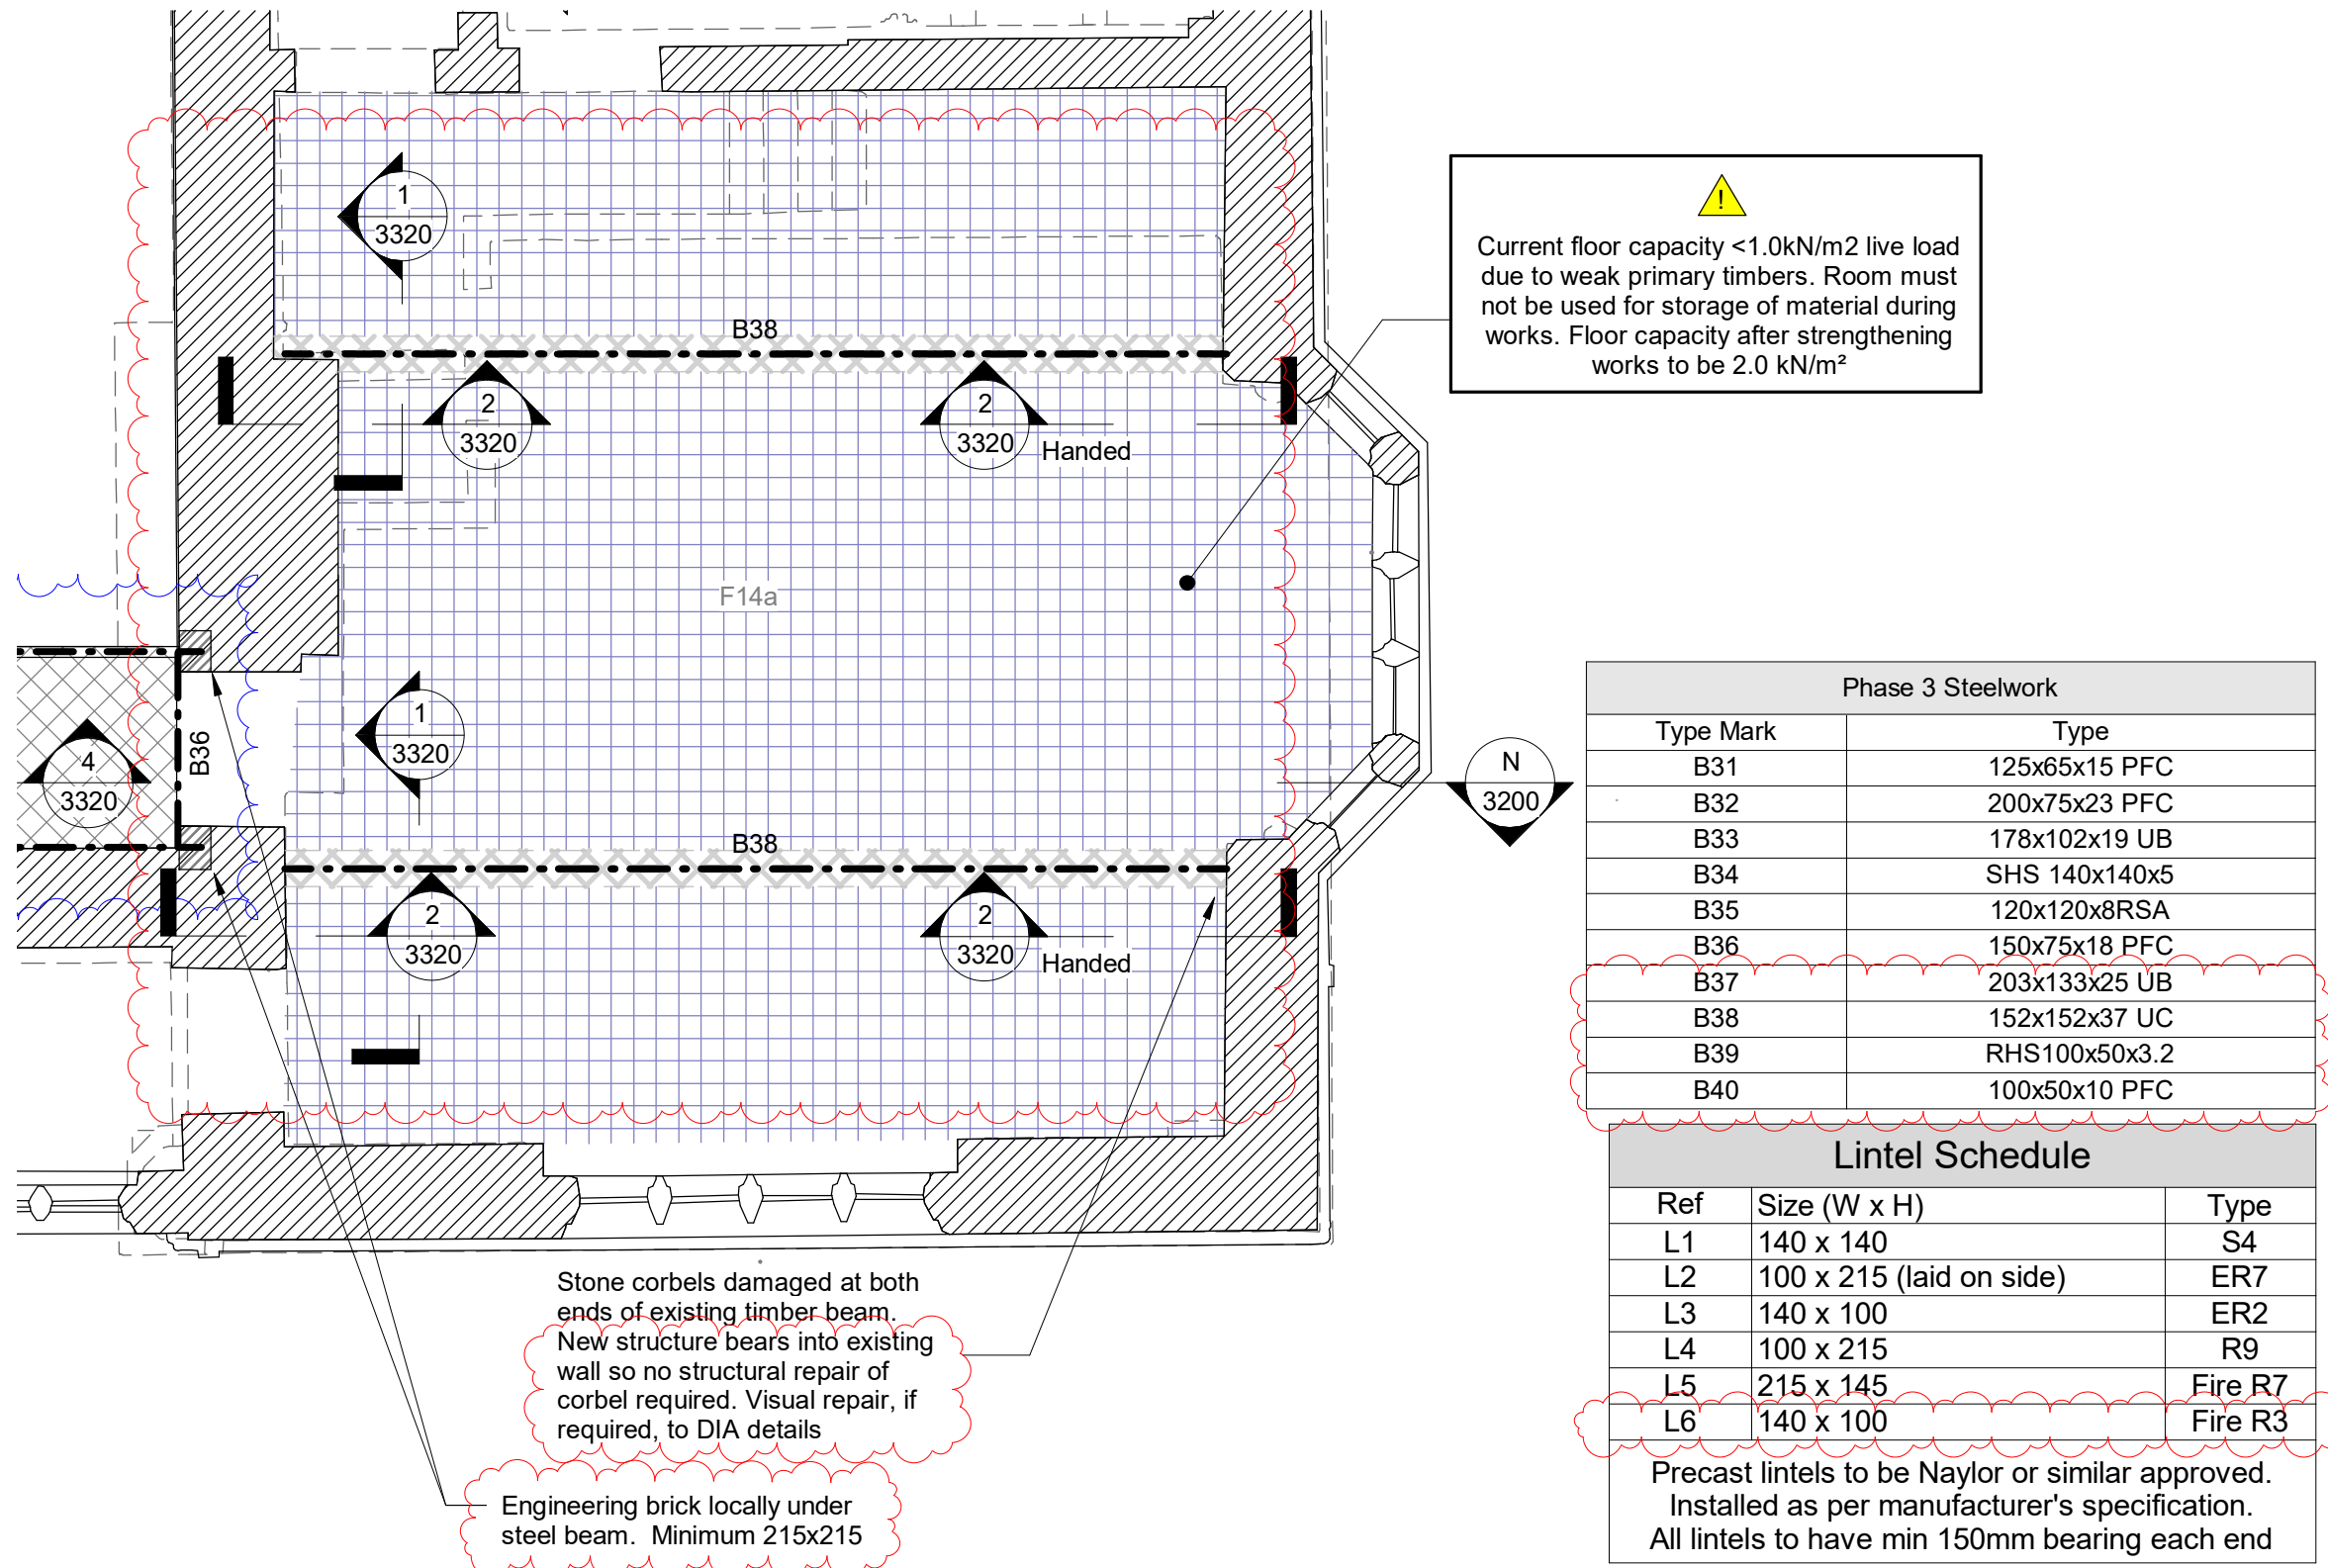

Mayors Parlour - Plan View
Scale ~1:100 on A1

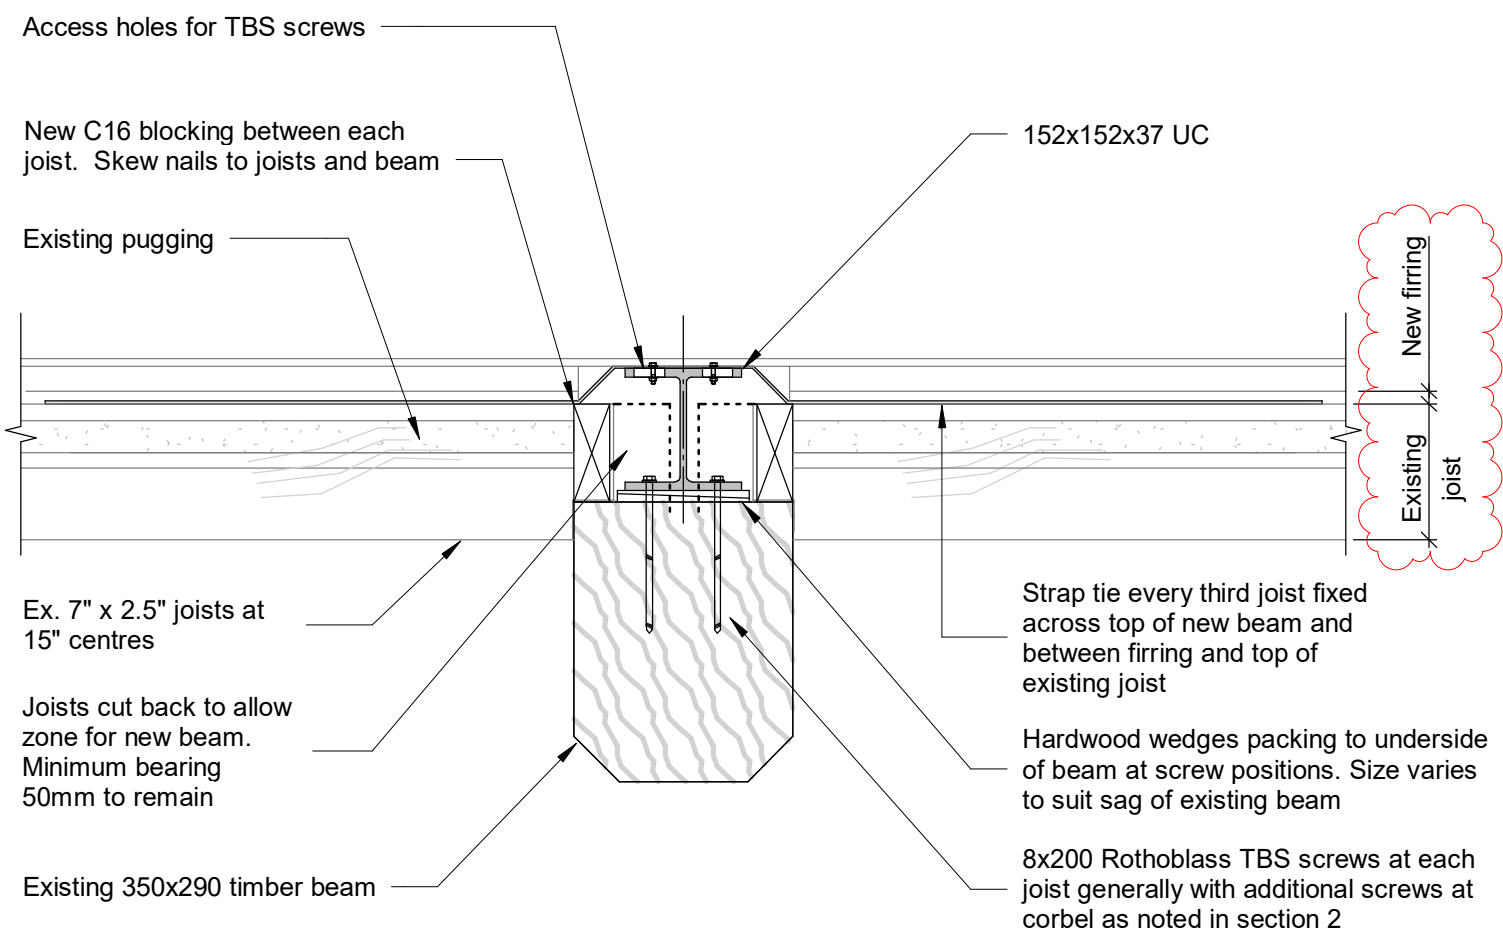


SECTION 1-1
(DRG. REF.: 3121)
SCALE: 1 : 10

NOTE SECTION 1 & 2:

(1) From measured survey the floor sags 80-100mm at mid span. Beam strengthening design assumes that firrings will be required to the existing joists to level the existing floor. Refer to DIA drawings for details of new floor leveling.

(2) Contractor to confirm seating of existing 350x290 beam within wall prior to fabrication of new steel beams

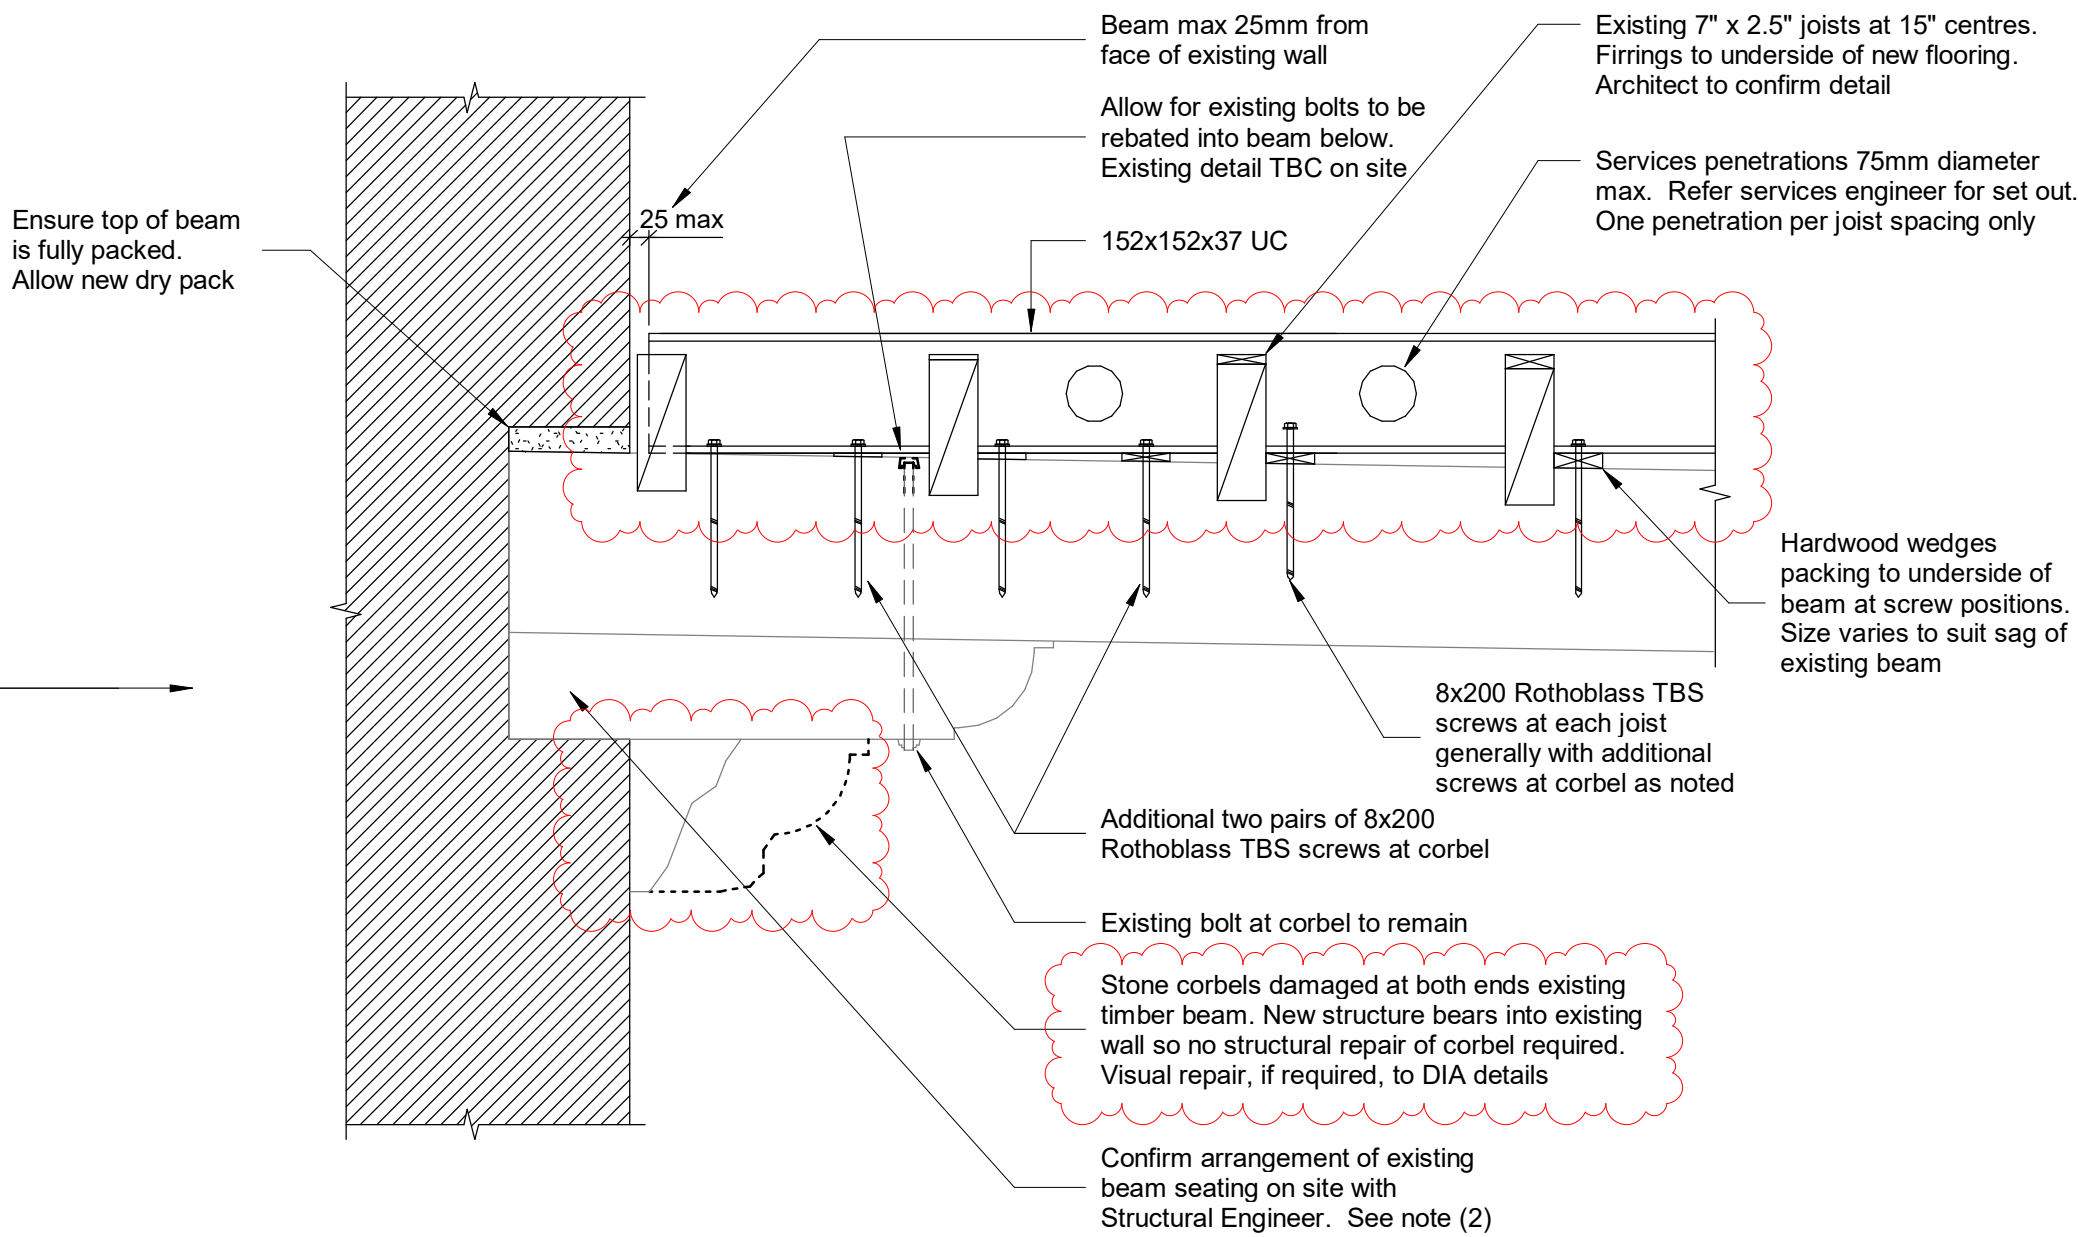

SECTION 2-2
(DRG. REF.: 3121)
SCALE: 1 : 10