
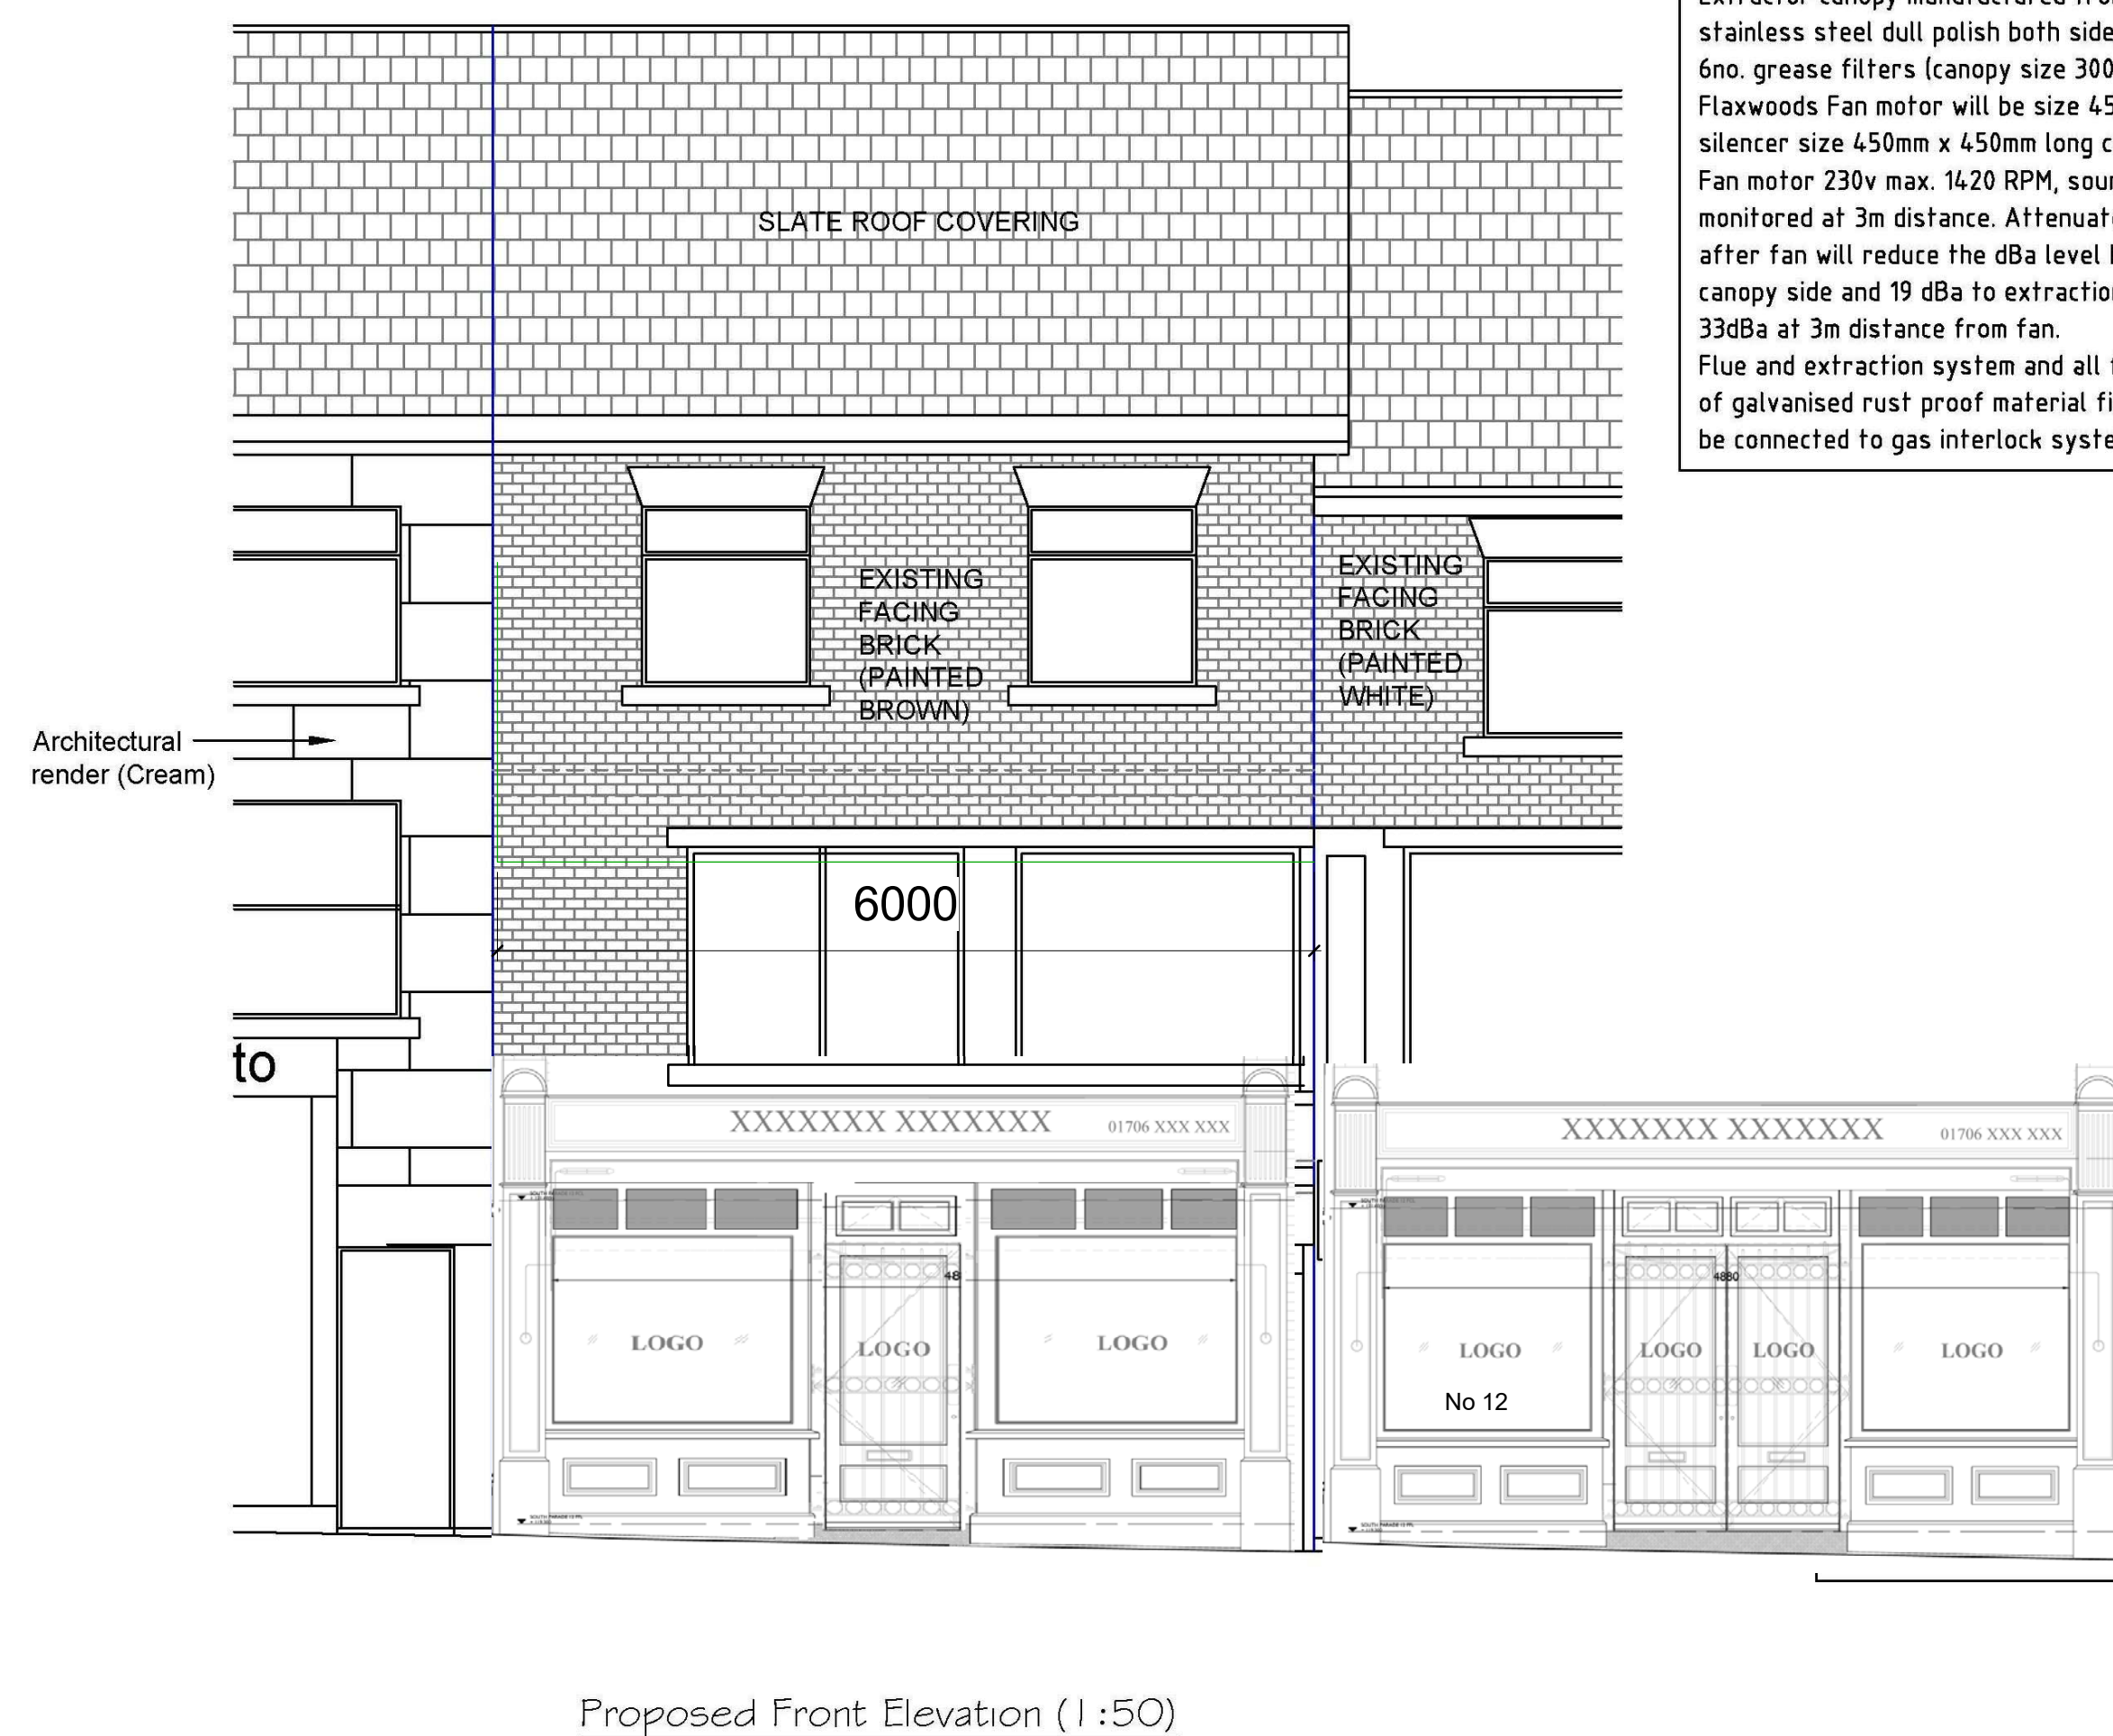



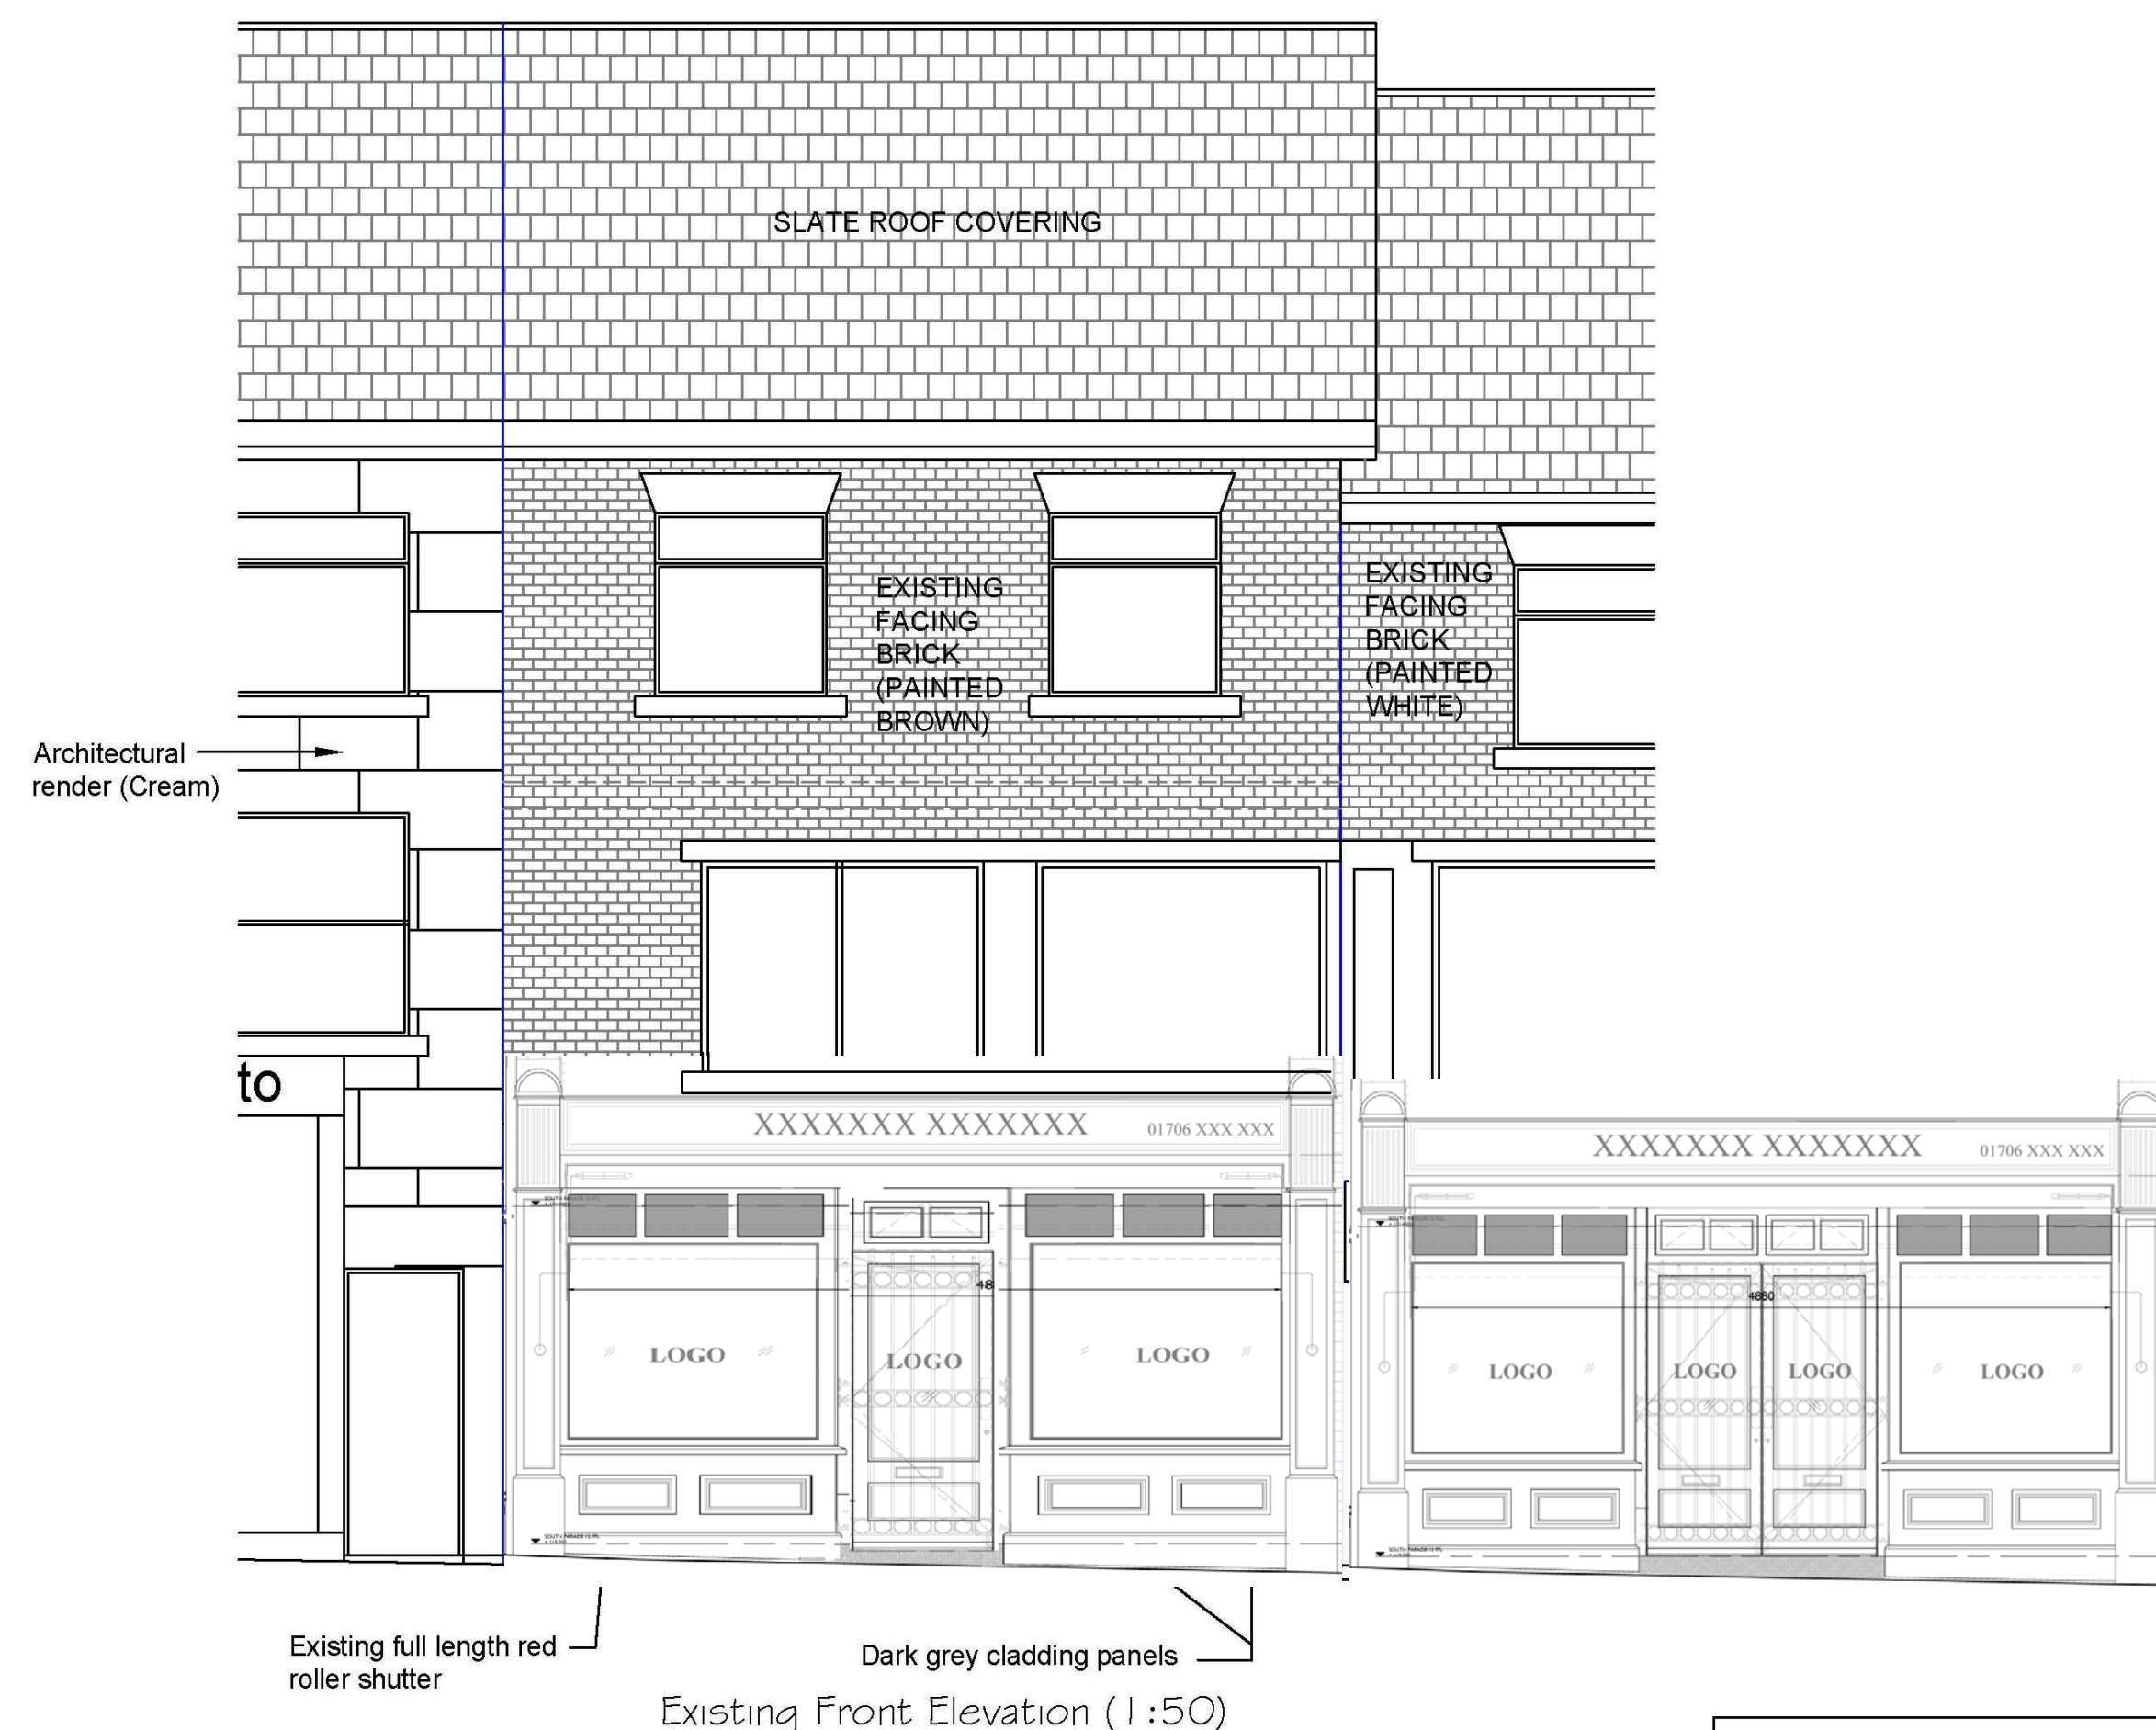


EXTRACTION SPECIFICATION

Extractor canopy manufactured from grade 430 grade stainless steel dull polish both sides compatible with 6no. grease filters (canopy size 3000x1200x600) Flaxwoods Fan motor will be size 450mm long case , silencer size 450mm x 450mm long case. Fan motor 230v max. 1420 RPM, sound level 56dbA when monitored at 3m distance. Attenuator use before and after fan will reduce the dbA level by 10 dbA to the canopy side and 19 dbA to extraction side thus producing 33dbA at 3m distance from fan. Flue and extraction system and all fastenings constructed of galvanised rust proof material fixed to the wall. Fan to be connected to gas interlock system.

Dilution Flue largely
concealed behind
mansard parapet flue
head painted slate grey

Staff 2nd floor overnight
shift accomodation
entrance

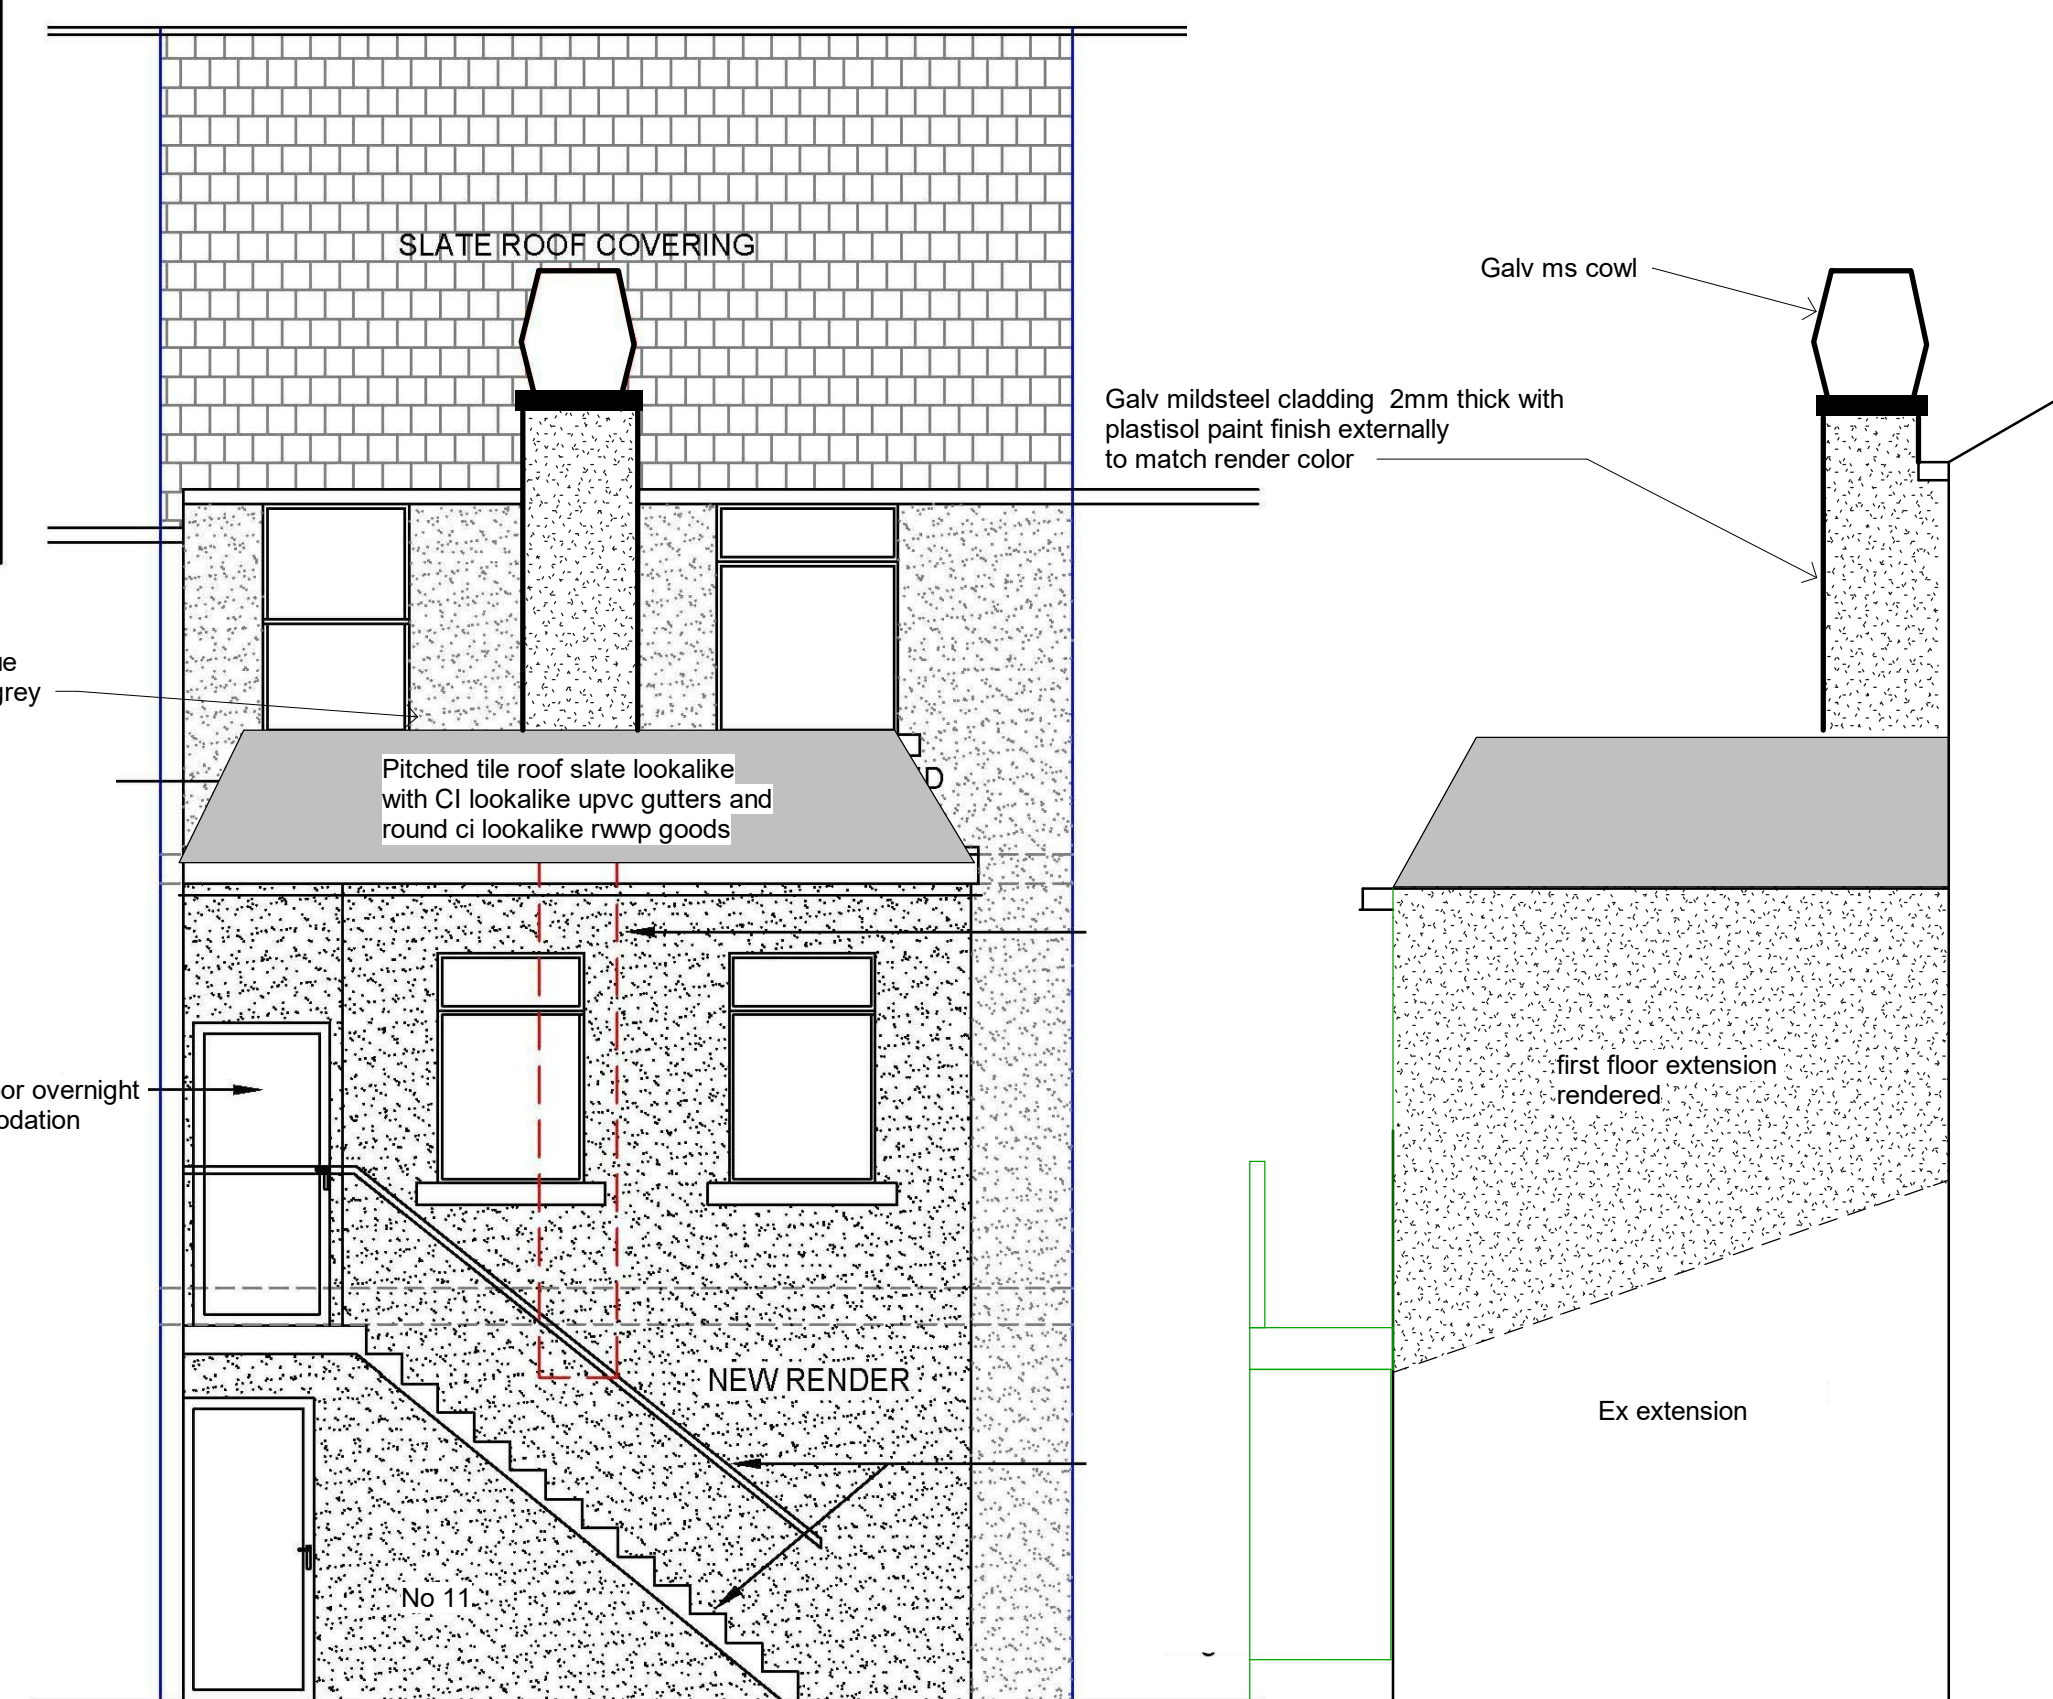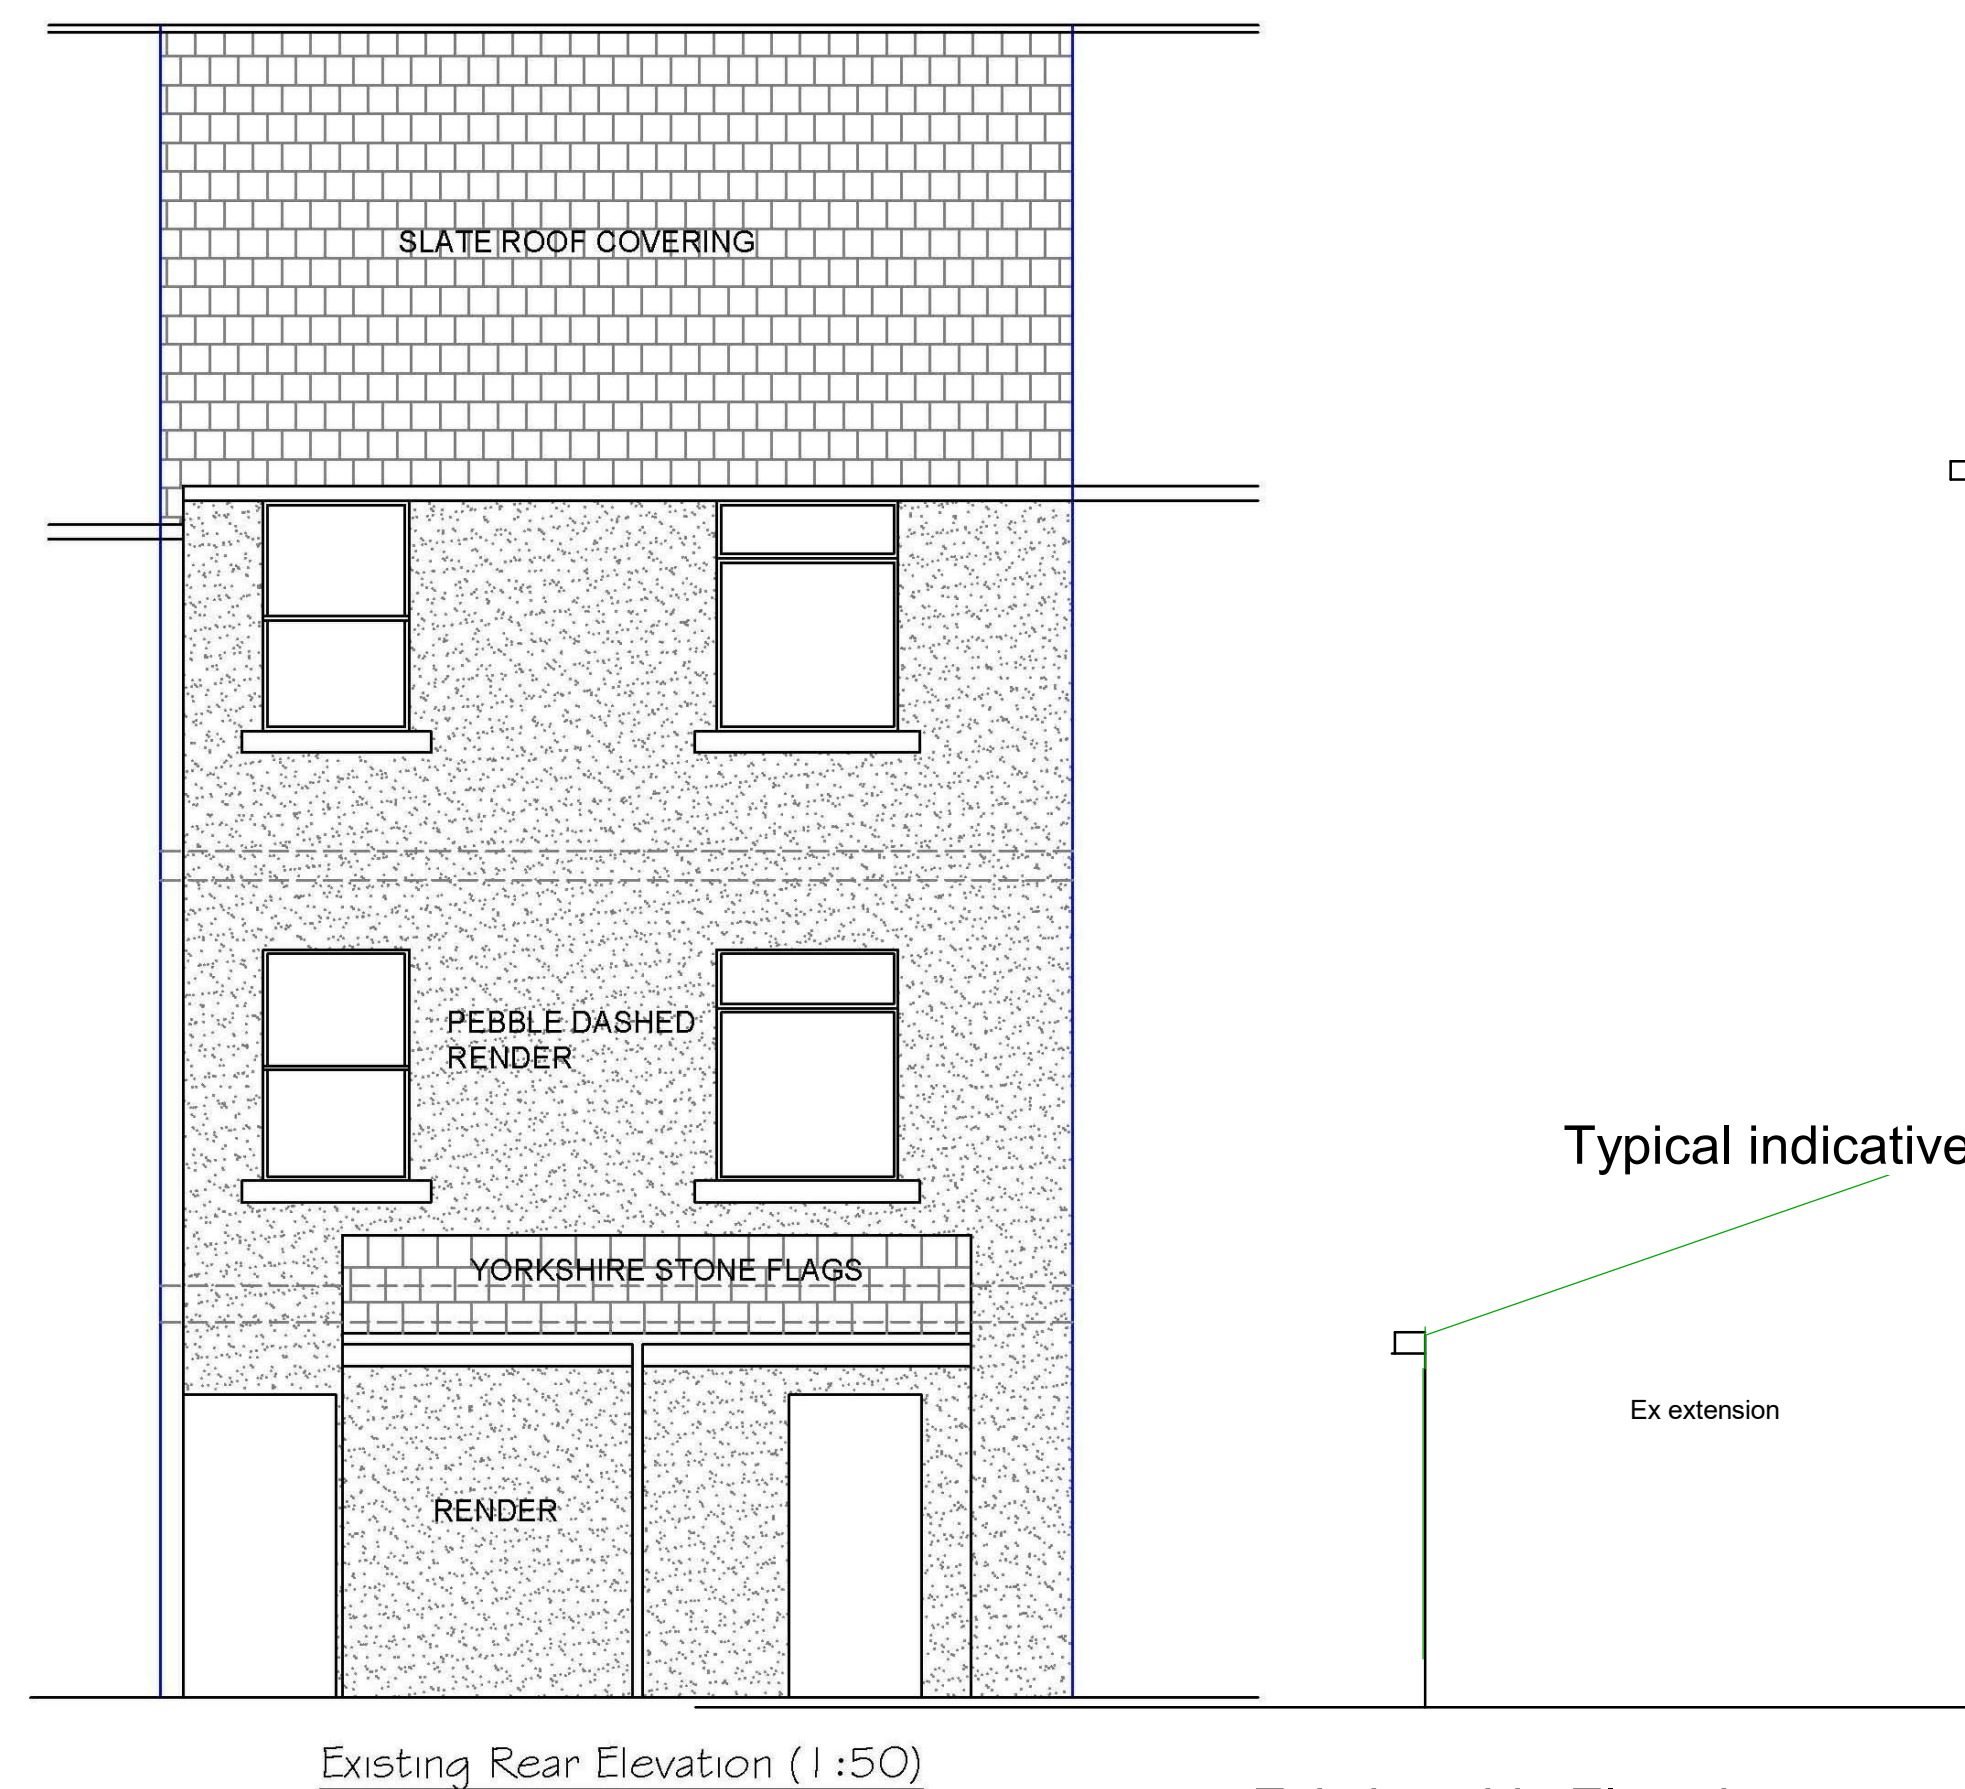

Typical indicative horizontal flue arrangement

Ex extension

Galv ms cowl

Galv mildsteel cladding 2mm thick with
plastisol paint finish externally
to match render color _____

first floor extension

Ex extension

THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION PURPOSES UNTIL WRITTEN APPROVAL IS OBTAINED FROM THE LOCAL AUTHORITY.

SCALE AS SHOWN AT A1

GENERAL NOTES

1. All dimensions are in millimetres unless otherwise noted.
2. This drawing is not to be copied or disclosed by or forwarded on to any unauthorised persons without prior written consent of Gamble King and Noone Limited.
3. Do not scale from this drawing and is only to be used for Local Authority Approval purposes only.

[illegible]

CODE	SUITABILITY DESCRIPTION	
STATUS	PURPOSE OF ISSUE	



PROJECT

12 South Parade Rochdale

TITLE	Existing And Proposed Elevations
-------	----------------------------------

CLIENT

Havana Burgers and Shakes

DRAWN BY

Author

CHECKED BY

Checker

ORIGIN DATE	

01/30/23

SCALE (@ A1)

1:50

PROJECT NUMBER	
----------------	--

215

DRAWING NUMBER

P03- G

REV