
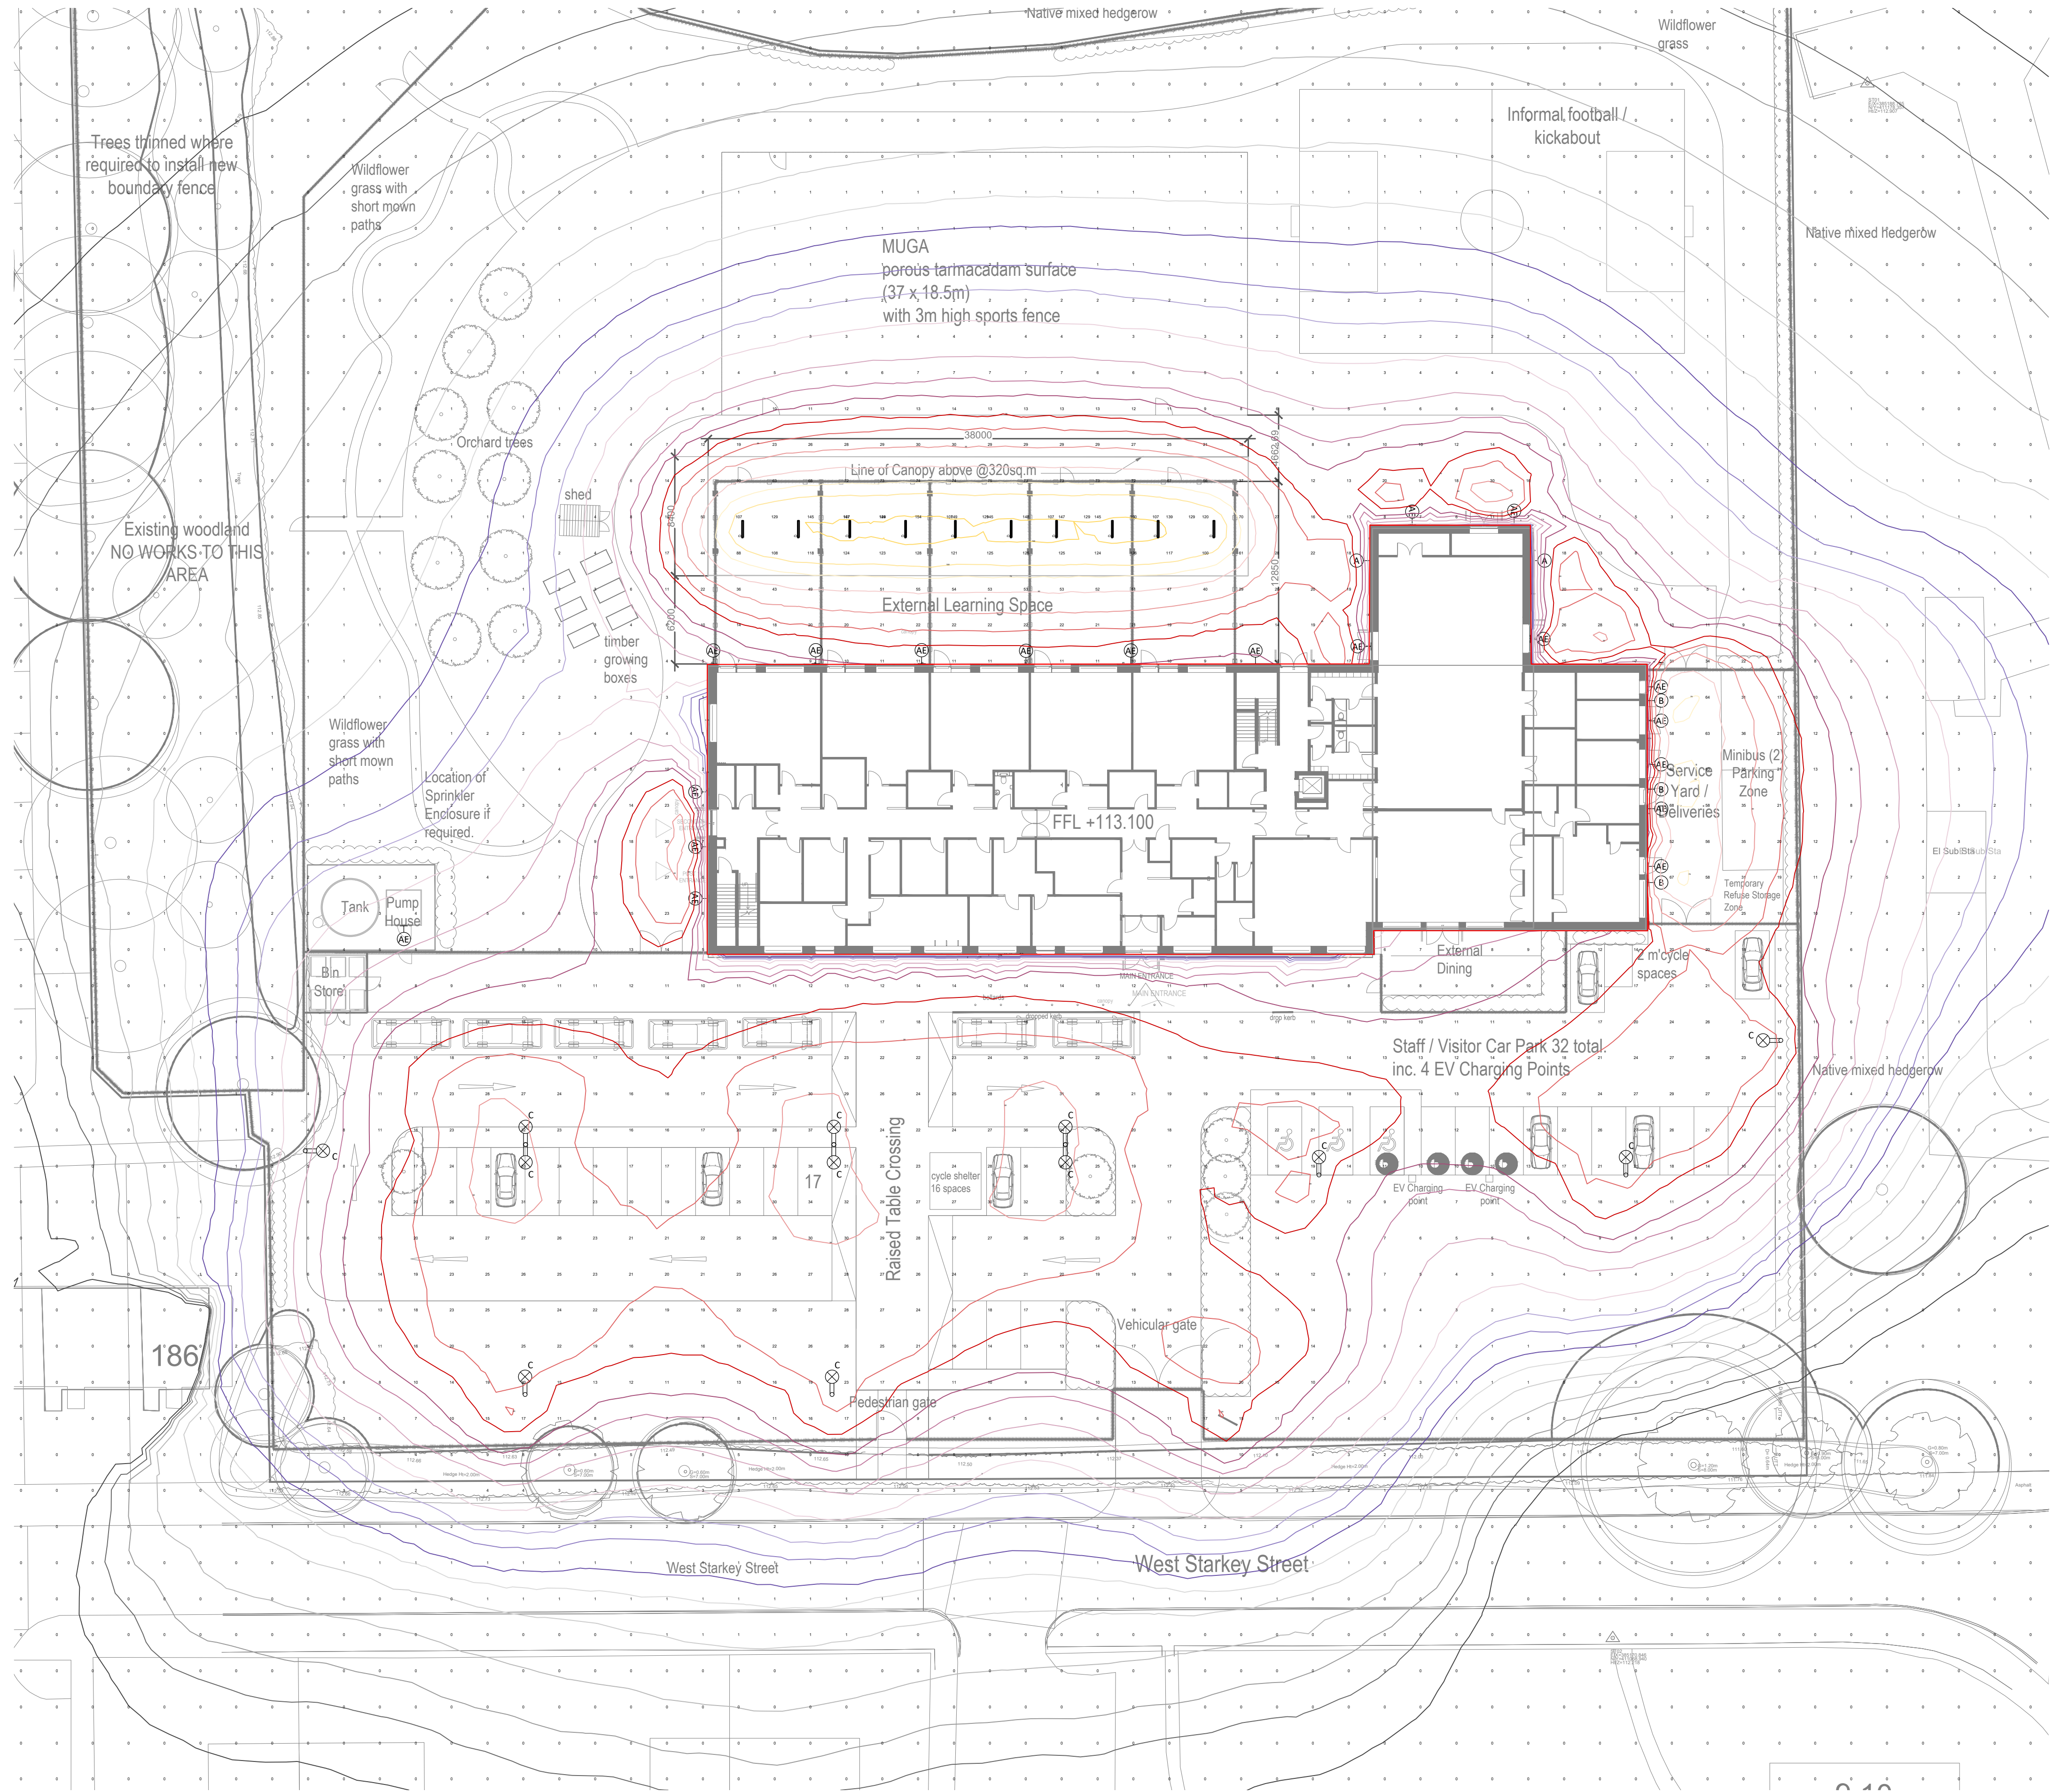


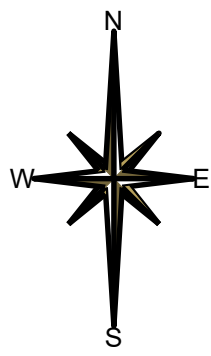

NOTES:

1. ALL DIMENSIONS ARE IN mm.
2. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS AND SERVICES ENGINEERS DRAWINGS AND SPECIFICATIONS.
3. ALL PERIMETER COLUMN LIGHTING TO BE PROVIDED WITH HOODS TO PREVENT OBTRUSIVE LIGHT BEYOND THE BOUNDARY

HOURS OF OPERATION

THE INTENDED HOURS OF OPERATION FOR THE SITE ARE AS FOLLOWS:

MONDAY TO FRIDAY - 6:30am TO 10:00pm
SATURDAY AND SUNDAY - 8:00am TO 8:00pm

EXTERNAL LIGHTING CONTROL

THE EXTERNAL LIGHTING WHICH COVERS MAIN ACCESS, ROADS, CAR PARK AREAS AND THE BUILDING PERIMETERS SHALL BE CONTROLLED VIA PHOTOCELL / TIMECLOCK ARRANGEMENT WITH MANUAL OVERRIDE.

LEGEND

- WALL MOUNTED LED LUMINAIRE MOUNTED @ 3m 23W
- WALL MOUNTED LED FLOOD LUMINAIRE MOUNTED @ 5m 26W
- SINGULAR COLUMN MOUNTED LED LUMINAIRE COLUMN HEIGHT - 6m 59W
- TWIN COLUMN MOUNTED LED LUMINAIRE COLUMN HEIGHT - 6m 2XNO. 59W
- LINEAR IP65 SURFACE MOUNTED LUMINAIRE MOUNTED @ 4.2m 47W

P03	27.07.23	ISSUED FOR INFORMATION	DF/CL	DH
P02	14.06.23	UPDATED TO SUIT EXTERNAL CANOPY LIGHTING	DF/CL	DH
P01	12.06.23	STAGE 3 ISSUE	DF/CL	DH
REV	DATE	DESCRIPTION	CHK	APR

© This drawing is the property of Kennedy Redford Limited and the information can only be reproduced with their prior permission.



CLIENT



PROJECT NAME

ROCHDALE SEND SCHOOL

DRAWING TITLE

PROPOSED EXTERNAL LIGHTING STRATEGY

DATE	SCALE	SHEET SIZE	REV
04.05.23	1:250	A1	P03

DRAWING STATUS

S2 - ISSUED FOR INFORMATION

DRAWING NUMBER

FS0911 - KR - XX - XX - D - E - 9000