
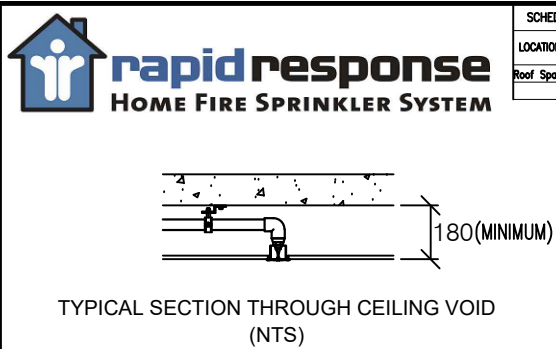
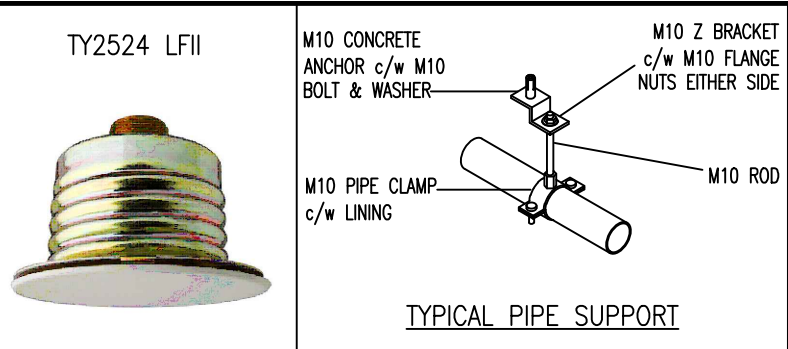


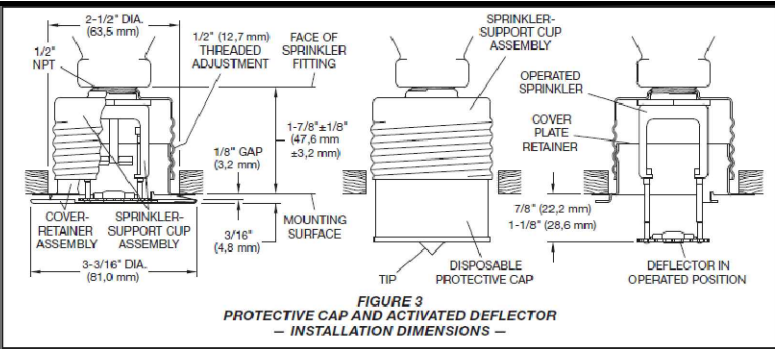

SCHEDULE OF SPRINKLERS									
LOCATION	HEAD TYPE							MAX. SPK.	QTY.
	MANUF.	MODEL No.	PATTERN	K.	°C.	RESPONSE	FINISH	SPACING	
Roof Space	TYCO	TY2524 LFII	CONC/PEND.	70.6	71	QUICK	WHITE	5.5M	09

NOTES TO CLIENT
DO NOT SCALE OFF THIS DRAWING
ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
ALL DIMENSIONS SHOULD BE READ IN THE HORIZONTAL PLANE UNLESS ALIGNED DIM'S ARE PROVIDED.
UK Sprinklers Ltd DO NOT ACCEPT RESPONSIBILITY FOR DAMAGE CAUSED BY FROST CLIENTS SHOULD TAKE PRECAUTIONS AGAINST THE WATER IN VALVES AND PIPES FREEZING DURING SEVERE WEATHER.
HOLES THROUGH WALLS, FLOORS, CEILINGS, SLABS OR PARTITIONS ARE THE RESPONSIBILITY OF THE CLIENT.
PIPEWORK TO BE EARTHED AND BONDED BY CLIENT IN ACCORDANCE WITH APPROPRIATE REGULATIONS.
WATER AND ELECTRICAL SUPPLY SERVICES TO BE PROVIDED BY CLIENT UNLESS OTHERWISE STATED
ALL TRENCHING AND CIVIL WORKS TO BE PROVIDED BY CLIENT
WARNING: SPRINKLERS, CONTROLS ETC MUST NOT BE PAINTED

© UK Sprinklers Ltd
THE COPYRIGHT OF THIS DRAWING IS OWNED BY UK Sprinklers Ltd AND CANNOT BE USED FOR ANY OTHER PURPOSE THAN THE NEGOTIATION OF THE SUBCONTRACT AND SUBSEQUENT CONSTRUCTION OF THE SUBJECT WORK BY UK Sprinklers Ltd AND THE PASSING OF ANY OF THE INFORMATION ON THIS DRAWING TO A COMPETITOR OF UK Sprinklers Ltd IS A BREACH OF THE PROVISIONS OF THE COMPETITION ACT 2002 NO PART OF THIS DRAWING MAY BE PHOTOCOPIED OR OTHERWISE REPRODUCED WITHOUT THE WRITTEN PERMISSION OF UK Sprinklers Ltd

STANDARD TUBE SPECIFICATION	
PIPEWORK ABOVE GROUND	CPVC (BLAZEMASTER)
FITTINGS ABOVE GROUND	CPVC (BLAZEMASTER)
PIPEWORK BELOW GROUND	N/A
FITTINGS BELOW GROUND	N/A
PIPE JOINTS #50 OR LESS	SOLVENT WELDED
PIPE JOINTS OVER #50	N/A

PIPEWORK BRACKET SPACING							
CPVC (BLAZEMASTER)							
SPEC. & DIA.(mm)	20	25	32	40	50	65	
INSIDE DIA. (mm)	22.0	28.2	35.6	40.7	50.9	61.5	
OUTSIDE DIA. (mm)	26.7	33.4	42.2	48.3	60.3	73.0	
MAX. HORIZONTAL DIST. APART (<6.96)	1.22	1.52	1.83	2.13	2.13	2.13	
MAX. HORIZONTAL DIST. APART (>6.96)	0.91	1.22	1.52	2.13	2.13	2.13	
MAX. VERTICAL DISTANCE APART	1.7	1.8	2.0	2.1	2.4	2.7	

PAINTED - RED OXIDE	☐	GALVANISED	☒
PAINTED - WHITE GLOSS	☐	POWDER COAT - WHITE	☐
PAINTED - RED GLOSS	☐	POWDER COAT - RED	☐
CPVC (BLAZEMASTER)	☒	OTHER - SEE DRG.	☐

DESIGN DATA	
TOWN MAIN / PUMP TANK	BOWS
TANK SIZE / CAPACITY	N/A
PUMP No / TYPE	N/A
SUPPLY DUTY ltr/min at bar	
BUILDING CONSTRUCTION	NON-FIRE PROOF

THIS SYSTEM IS DESIGNED AND WILL BE INSTALLED TO COMPLY WITH:
BS 9251:2021 & BAFA TECHNICAL GUIDANCE NOTE No.1:JUN 2008
SYSTEM IS TO BE A RESIDENTIAL CATEGORY 1 INSTALLATION.

FULL HYDRAULIC CALCULATIONS.		
FLOOR	FLOW L/min	BAR
.	.	.
.	.	.
.	.	.
.	.	.
.	.	.
.	.	.

DRAWINGS REFERENCES.	
.	
.	
.	
.	

A01 09/04/2022 ISSUED FOR COMMENT			LH	DG
REV	DATE	DESCRIPTION	DRN	APP



Alma House
Grimsbow Lane
Middleton
Greater Manchester M24 1GQ.

TEL:0161 762 0225
FAX:0161 763 7419
sales@uksprinklersltd.co.uk
www.uksprinklersltd.co.uk


SITE ADDRESS
KINGS ROAD
ROCHDALE
.

CLIENT
A J COCKER ASSOCIATES
.
.
.
.

TITLE
SPRINKLER PROTECTION LAYOUT
ROOF SPACE
.

DRAWING No. C1345-02-01			REV A01
----------------------------	--	--	------------

DRAWN LH	CHECKED DG	DATE 09/04/24	SCALE 1:100	DRG SIZE A3
-------------	---------------	------------------	----------------	----------------

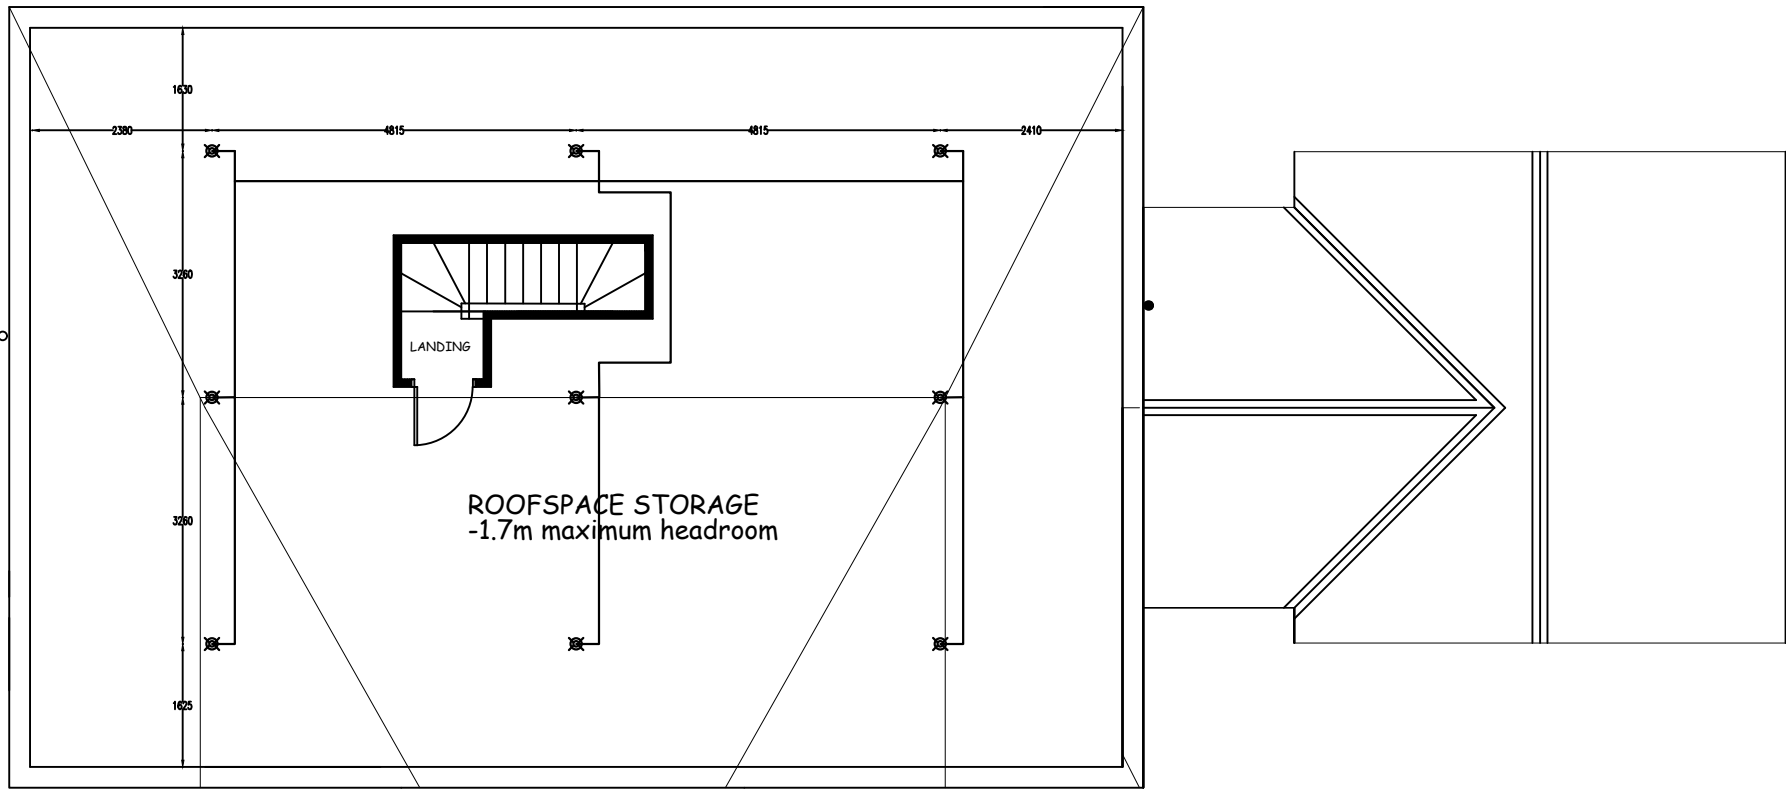

ROOFSpace

