


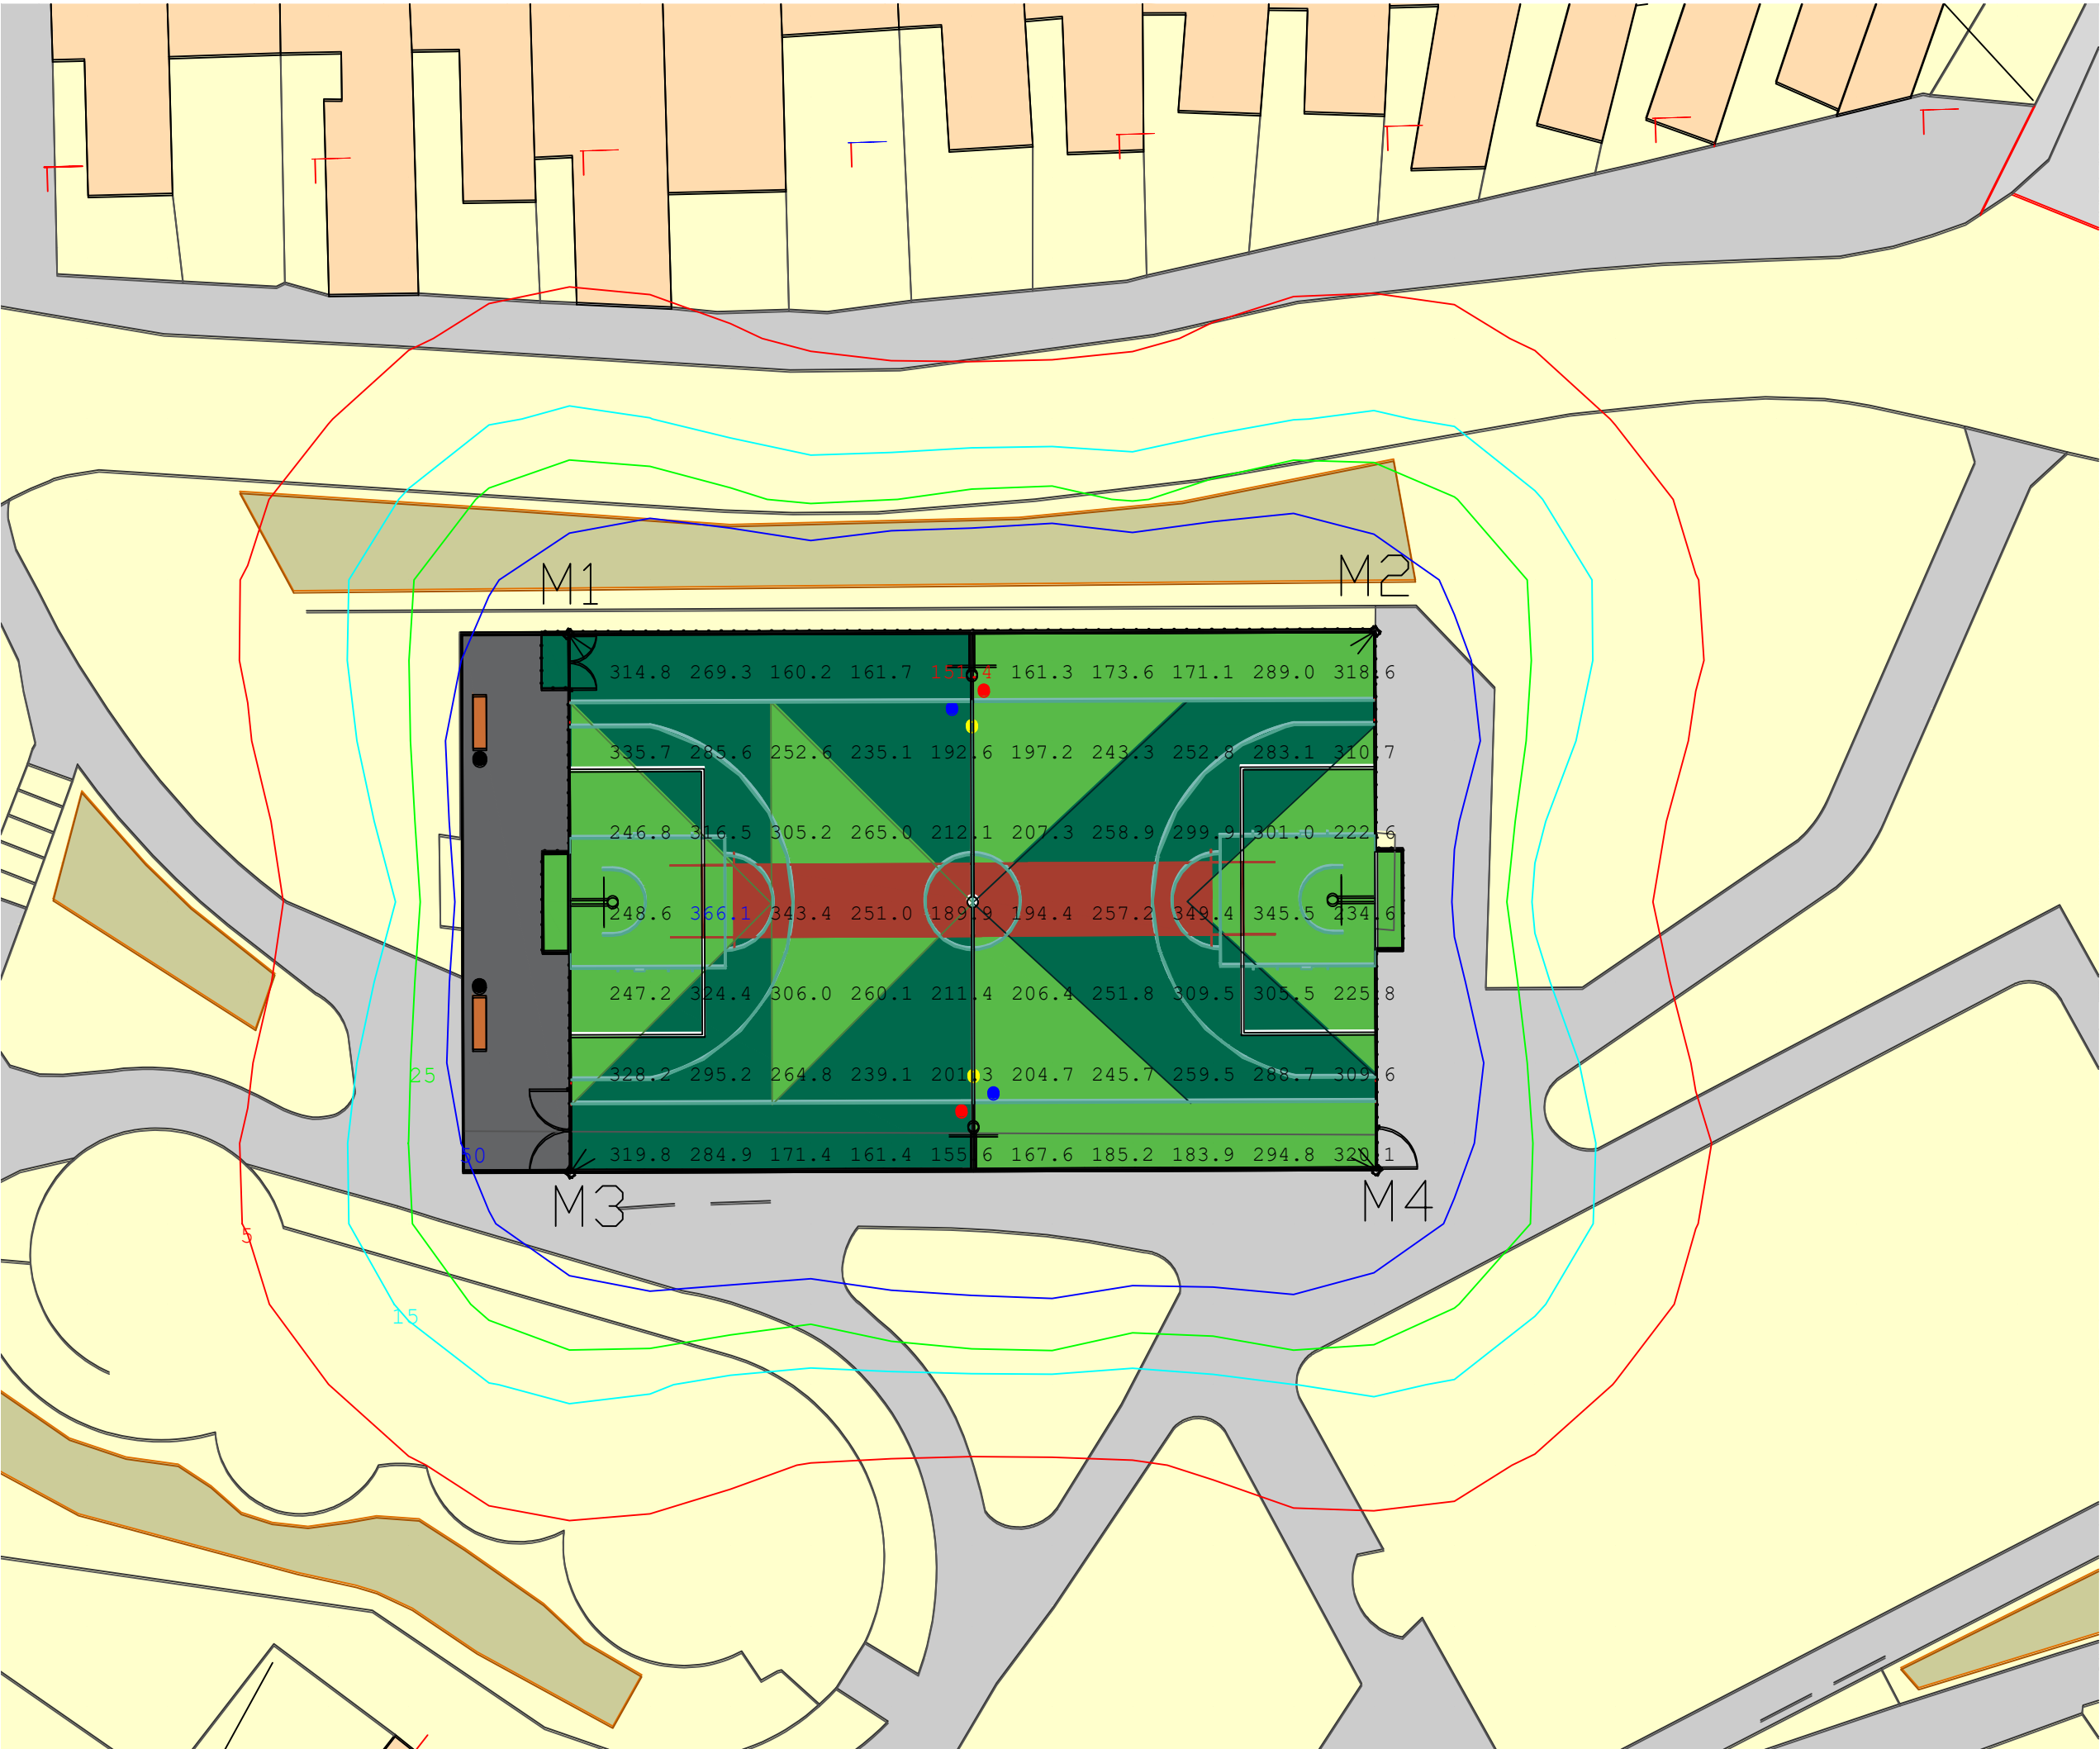

NOTES:

Floodlighting Equipment
4 x 6m Masts (M1-M4)
Each carrying the following Floodlights :-
M1-M4
...2 x Siteco FL21 Midi

Lamps = Siteco LED - 4,000K CRI 70

Illuminance Levels
Initial -
(100hrs) E.i.ave = 252Lux
Maintained -
(4000hrs) E.i.ave = 226Lux
Uniformity
Emin/Eave = 0.60
Emin/Emax = 0.41

Grid values in Lux(initial).
Grid interval = 3m.
Contour values in Lux (initial).
Contours: 5, 15, 25, 50 Lux.

Maintenance Factor = 0.90
(Based on a cleaning interval of 2 years)



www.halliday-lighting.co.uk

THIS DRAWING & THE INFORMATION CONTAINED THEREIN IS THE PROPERTY OF HALLIDAY LIGHTING LTD AND SHOULD NOT BE COPIED IN WHOLE OR IN PART, DISCLOSED TO ANY THIRD PARTY OR USED FOR ANY OTHER PURPOSE WITHOUT THE PRIOR WRITTEN CONSENT OF HALLIDAY LIGHTING


email - info@halliday-lighting.co.uk

PROJECT NAME:
South Street

DRAWING TITLE:
Proposed Floodlighting
Page 1: Pitch Levels

DRAWN BY: JDW	DATE: 23/10/2024
CHECKED BY: JM	SCALE: NTS
DRAWING No: HLS9403	REVISION: REV

0	23/10/24	ORIGINAL ISSUE	JDW	JM
REV	DATE	DESCRIPTION	BY	CHKD

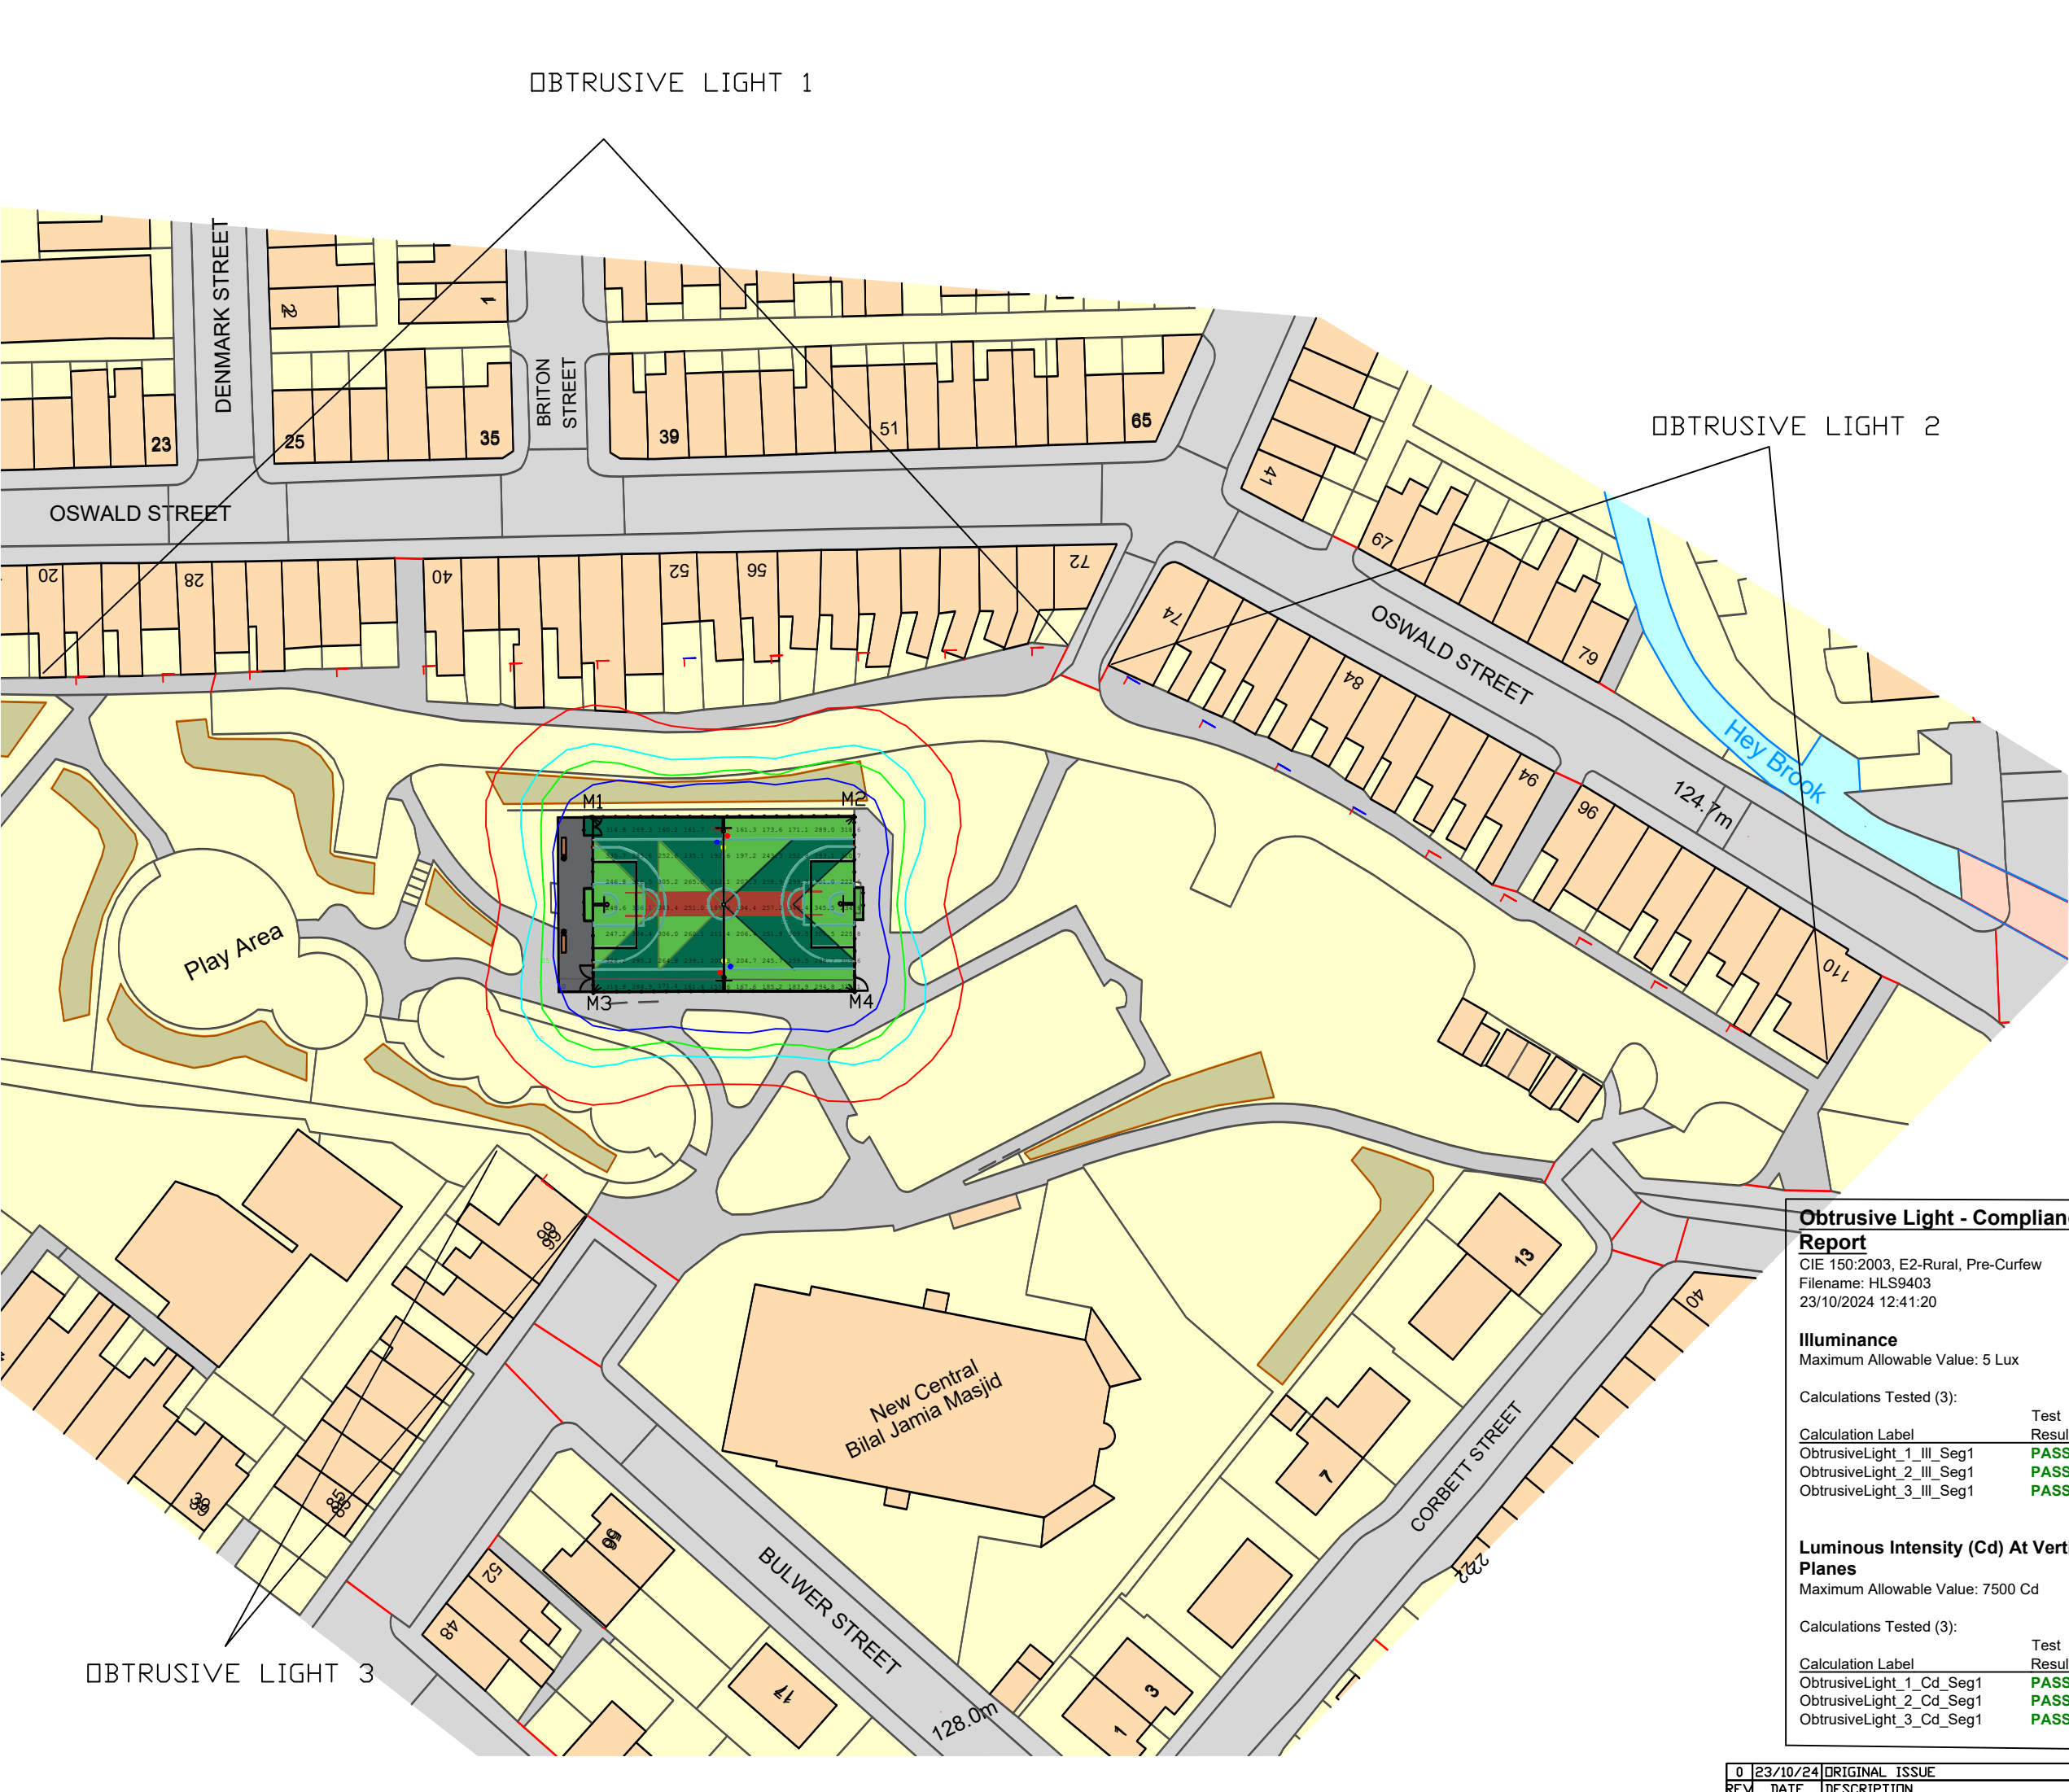

NOTES:

Floodlighting Equipment
4 x 6m Masts (M1-M4)
Each carrying the following Floodlights :-
M1-M4
...2 x Siteco FL21 Midi

Lamps = Siteco LED - 4,000K CRI 70

Illuminance Levels
Initial -
(100hrs) E.i.ave = 252Lux
Maintained -
(4000hrs) E.i.ave = 226Lux
Uniformity
Emin/Eave = 0.60
Emin/Emax = 0.41

Grid values in Lux(initial).
Grid interval = 3m.
Contour values in Lux (initial).
Contours: 5, 15, 25, 50 Lux.

Maintenance Factor = 0.90
(Based on a cleaning interval of 2 years)

Obtrusive Light - Compliance Report

CIE 150:2003, E2-Rural, Pre-Curfew
Filename: HLS9403
23/10/2024 12:41:20

Illuminance
Maximum Allowable Value: 5 Lux

Calculations Tested (3):

Calculation Label	Test Results	Max. Illum.
ObtrusiveLight_1_III_Seg1	PASS	0.7
ObtrusiveLight_2_III_Seg1	PASS	0.1
ObtrusiveLight_3_III_Seg1	PASS	0.4

Luminous Intensity (Cd) At Vertical Planes

Maximum Allowable Value: 7500 Cd

Calculations Tested (3):

Calculation Label	Test Results
ObtrusiveLight_1_Cd_Seg1	PASS
ObtrusiveLight_2_Cd_Seg1	PASS
ObtrusiveLight_3_Cd_Seg1	PASS

EST. 1962

HALLIDAY LIGHTING

www.halliday-lighting.co.uk

THIS DRAWING & THE INFORMATION CONTAINED THEREIN IS THE PROPERTY OF HALLIDAY LIGHTING LTD AND SHOULD NOT BE COPIED IN WHOLE OR IN PART, DISCLOSED TO ANY THIRD PARTY OR USED FOR ANY OTHER PURPOSE WITHOUT THE PRIOR WRITTEN CONSENT OF HALLIDAY LIGHTING
email - info@halliday-lighting.co.uk

PROJECT NAME: South Street	
DRAWING TITLE: Proposed Floodlighting Page 2: Obtrusive Light	
DRAWN BY: JDW	DATE: 23/10/2024
CHECKED BY: JM	SCALE: NTS
DRAWING No: HLS9403	REVISION: REV

0	23/10/24	ORIGINAL ISSUE	JDW	JM
REV	DATE	DESCRIPTION	BY	CHKD