

Jonathan Gilbertson
Gilby Homes

Email: gilbyhomes@outlook.com

Date: 16th December 2022
LKC Reference: LKC 20 1546

Dear Jonathan,

RE: CARRICK, ROCHDALE ROAD, MILNROW – SINGLE DETACHED HOUSE – SITE INVESTIGATION REPORT

1.0 Introduction

A site investigation has previously been undertaken by LKC on the original Carrick, Rochdale Road site where 3no. detached houses were proposed.

The following reports were produced by LKC on the original site:

- Phase 1 Preliminary Risk Assessment, CL-602-LKC 20 1546-01, June 2020.
- Phase 2 Geo-Environmental Investigation, Risk Assessment and Remediation Strategy, CL-602-LKC 20 1546-02, April 2021.

Subsequently, a further parcel of land has been proposed to be developed for a single detached house. The site location is shown on Figure 1. Both parcels of land are shown on Figure 2.

The PRA was updated and revised in October 2022 (ref. CL-602 LKC 20 1546-01-R1) to incorporate the new parcel of land for the single detached house.

LKC undertook further site investigation on the new parcel of land for the single detached house and that is reported here.

2.0 Site Investigation

2.1 Site Investigation Design and Methodology

An intrusive investigation was undertaken on 29th September 2022. This comprised 2no. hand dug pits excavated to 0.35-0.60mbgl (HD106-HD107) in the existing garden area. The location of the hand dug pits is shown on Fig 3A.

All profile logs are provided in Appendix A and are in line with BS14688-1¹ and BS5930².

¹ British Standards (2002) Geotechnical investigation and testing – Identification and Classification of Soil. Part 1: Identification and description. BS EN ISO 14688-1:2002.

² British Standard (2015). "Code of Practice for Ground Investigations". BS5930:2015.

2.2 Sampling

Standard sampling protocol and preservation of samples was undertaken as described in the EA guidance on site investigation³.

Soil was collected for onsite testing. A plastic zip bag was half filled with soil allowing a suitably sized headspace. The bag was sealed and stored for at least 20 minutes before being tested for total volatile organic compounds (TVOCs) using a PhoCheck Tiger photoionisation detector (PID). Results of the PID readings are presented on the profile logs (Appendix B). The on-site monitoring was carried out in line CIRIA C665⁴ to aid in screening samples for volatile analysis.

Soil samples of approximately 500g were recovered in amber jars, amber vials for volatile analysis and plastic tubs. All the samples were labelled and stored in cool boxes prior to being collected by courier at the end of the day for delivery to the Chemtest laboratory in Newmarket for chemical testing. If collection was not possible the same day then samples were stored in the sample storage fridge at the LK Group offices below 4°C. Samples were tracked using appropriate Chain of Custody forms provided by Chemtest.

Many of the contamination tests are UKAS or MCERTS accredited and further details are given in the Certificate of Analysis presented in Appendix B. Table 2-1 shows the soil testing undertaken.

Suites and Contaminants	No. Samples	Location & Depth	Justification
Metals / metalloids, pH, water soluble sulphate, cyanide suite, phenol, TPHCWG, BTEX, MTBE, speciated PAHs, SOM and asbestos screen.	5	TS1 0.0-0.15m TS2 0.0-0.15m TS3 0.0-0.15m SS1 0.15-0.35m SS2 0.15-0.35m SS3 0.15-0.35m	Detailed suite to enable characterisation of material which may need to be disposed of offsite.

Table 2-1. Summary of soil sample testing undertaken.

Notes:

If asbestos present during screen identification and quantification will be undertaken.

Metal/metalloids=arsenic, cadmium, chromium, (total and hexavalent), copper, lead, mercury, nickel, selenium, vanadium, zinc and boron; TPHCWG=carbon banded and aromatic/aliphatic split petroleum hydrocarbons; PAH=polycyclic aromatic hydrocarbons, BTEX=benzene, toluene, ethylbenzene and xylenes; MTBE=Methyl tert-butyl ether, SOM=Soil Organic Matter.

Table 2-2 shows the locations where the samples were obtained.

Trial Pit Location	Corresponding Samples
HD106	SS1, SS2 and SS3
HD107	TS1, TS2 and TS3

Table 2-2. Sample Locations.

³ EA (2000). "Technical Aspects of Site Investigation. Volumes 1 & 2 Text Supplements Research and Development Technical Report." P5-065/Tr.

⁴ CIRIA (2007). "Assessing Risks Posed by Hazardous Ground Gases to Buildings." CIRIA C665.

3.0 Ground Conditions

Topsoil was recorded to between 0.15-0.40mbgl and comprised dark brown gravelly sandy SILT with frequent rootlets and rare coal fragments.

Superficial deposits of firm to stiff very gravelly silty CLAY with rare coal fragments was recorded beneath the topsoil.

No groundwater was encountered.

4.0 Soil Risk Assessment


With regards to the soil risk assessment LKC will use the following hierarchy:

- Category 4 Screening Levels (C4SLs).
- LQM Suitable 4 Use Levels (S4ULs).
- ATRISK Soil Screening Values (SSVs) and CL:AIRE Generic Assessment Criteria (GACs).

The proposed development is for residential house with garden, therefore the assessment criteria for residential with plant uptake has been used. Results will be compared to the nearest appropriate soil organic matter (SOM). A summary of the generic assessment criteria is provided in Appendix C.

4.1 B(a)P as a Surrogate Marker

Based on the above assumption for PAHs, LKC undertook an assessment of the data for the site with regards to using B(a)P as a surrogate marker for carcinogenic PAHs as per HPA and CL:AIRE guidelines. Graph 4-1 summarises the study site data with respect to how the ratios of carcinogenic PAHs relate to B(a)P, within the confidence limits provided in the HPA document.

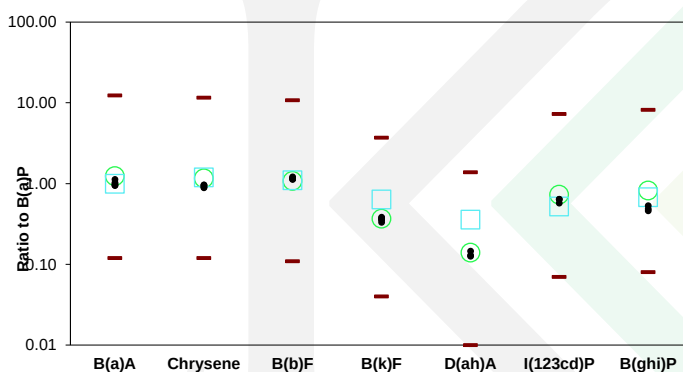

Graph 4-1: The ratio of PAH to B(a)P in soil for all available data at the site based on 5 samples (where values were >LOD to allow the calculation of a ratio).

Notes:

B(a)P=Benzo(a)pyrene; D(ah)A=Dibenzo(ah)anthracene; B(a)A=Benzo(a)anthracene; B(b)F=Benzo(b)fluoranthene; B(k)F=Benzo(k)fluoranthene; I(123cd)P=Indeno(123cd)pyrene; B(ghi)P=Benzo(ghi)perylene
● =Ratio to B(a)P for all data; ○ =Mean ratio to B(a)P for Culp data; △ =Mean ratio to B(a)P from all data at the site
□ =Mean ratio to B(a)P for UK data presented by HPA; — =Upper and Lower limits (order of magnitude from Culp data)

All the data points that could be used to calculate ratios fall inside the upper or lower limits.

Based on this distribution of data LKC considers B(a)P can be used as a surrogate marker for carcinogenic PAHs and the C4SL criteria is suitable for this dataset.

4.2 Soil Results Comparison against Assessment Criteria

Results have been compared to the relevant assessment criteria (Appendix C) and no elevated contaminants were identified. No asbestos was recorded in any samples. All analysis sheets are presented in Appendix B.

4.3 Contamination Risk Assessment – Direct Contact Risk

No hydrocarbons, metals, PAHs or asbestos were identified at concentrations exceeding screening criteria, therefore the probability of these contaminants posing a risk to future residents via direct contact (ingestion, dermal contact) is considered unlikely. With a medium consequence, the risk is low, and no remediation is recommended.

5.0 Conclusions

2no. hand dug pts were excavated in the new site where the single detached house was proposed. Topsoil was encountered overlying gravelly silty clay. 6no. samples were obtained from the topsoil and clay, and no contaminants of concern were recorded above residential with garden GACs. Therefore, no remediation was recommended in this area.

Yours Sincerely,

ROSIE CUMMINGS
PRINCIPAL GEO-ENVIRONMENTAL CONSULTANT

Enclosed:

Fig 1 – Site Location and Boundary Plan
Fig 2A – Proposed Development Plan
Fig 3A – Site Investigation Location Plan

Appendix A – Profile Logs
Appendix B – Certificate of Analysis – Soil
Appendix C – Generic Assessment Criteria Values

Figures


LINK

CONSULT

» Eton Business Park, Eton Hill Rd, Radcliffe, Greater Manchester M26 2ZS
» 0161 763 7200 » info@thelkgroup.com » www.thelkgroup.com



Client: Gilby Homes Ltd				Title: Site Location & Boundary Plan			
Site: Carrick, Rochdale Road, Milnrow				Scale (see scale bar): 1:10,000 & 1:1,000 @ A4			
Job No.: LKC 20 1546	Drawn By: FP	Checked By: EK	Drawn: Sept 2022	Figure: 1	Revision:		



El Sub Stas

6

113

Willows Lane

Rochdale Road

Carrick

Refuse bay for 3 No. houses approved with Planning Application Reference: 20/01038/FUL, to be enlarged to allow for two recycling bins for each house. Construction details to match existing

FFL 10.78

23

Dashed indicating site with Planning Approved 3 No. houses (Application Reference: 20/01038/FUL)

111

109


Willows Cottages

3

4

2

1



KEY



Site Boundary

Sampling Locations and features annotated by LK Consult Ltd are approximate and are based upon observed measurements unless otherwise stated. Do not scale from this drawing and work from marked dimensions only. All dimensions and features should be confirmed on site by the Contractor. Where this drawing includes information provided to LK Consult Ltd by others, LK Consult Ltd gives no warranty, representation or assurance as to the accuracy of such information.



Client:

Gilby Homes Ltd

Site:

Carrick, Rochdale Road, Milnrow

Title:

Proposed Development Plan

Job No.:

LKC 20 1546

Scale (See Scale Bar):

1:500 @ A3

Figure:

2

Revision:

A

Drawn By:

AC


Checked By:

FP

Drawn:

Sep 2022

Extract from: Equilibrium Architects
Drawing Ref: Proposed Site Plan, No.R-0733-10, Rev:A (18/05/2022)

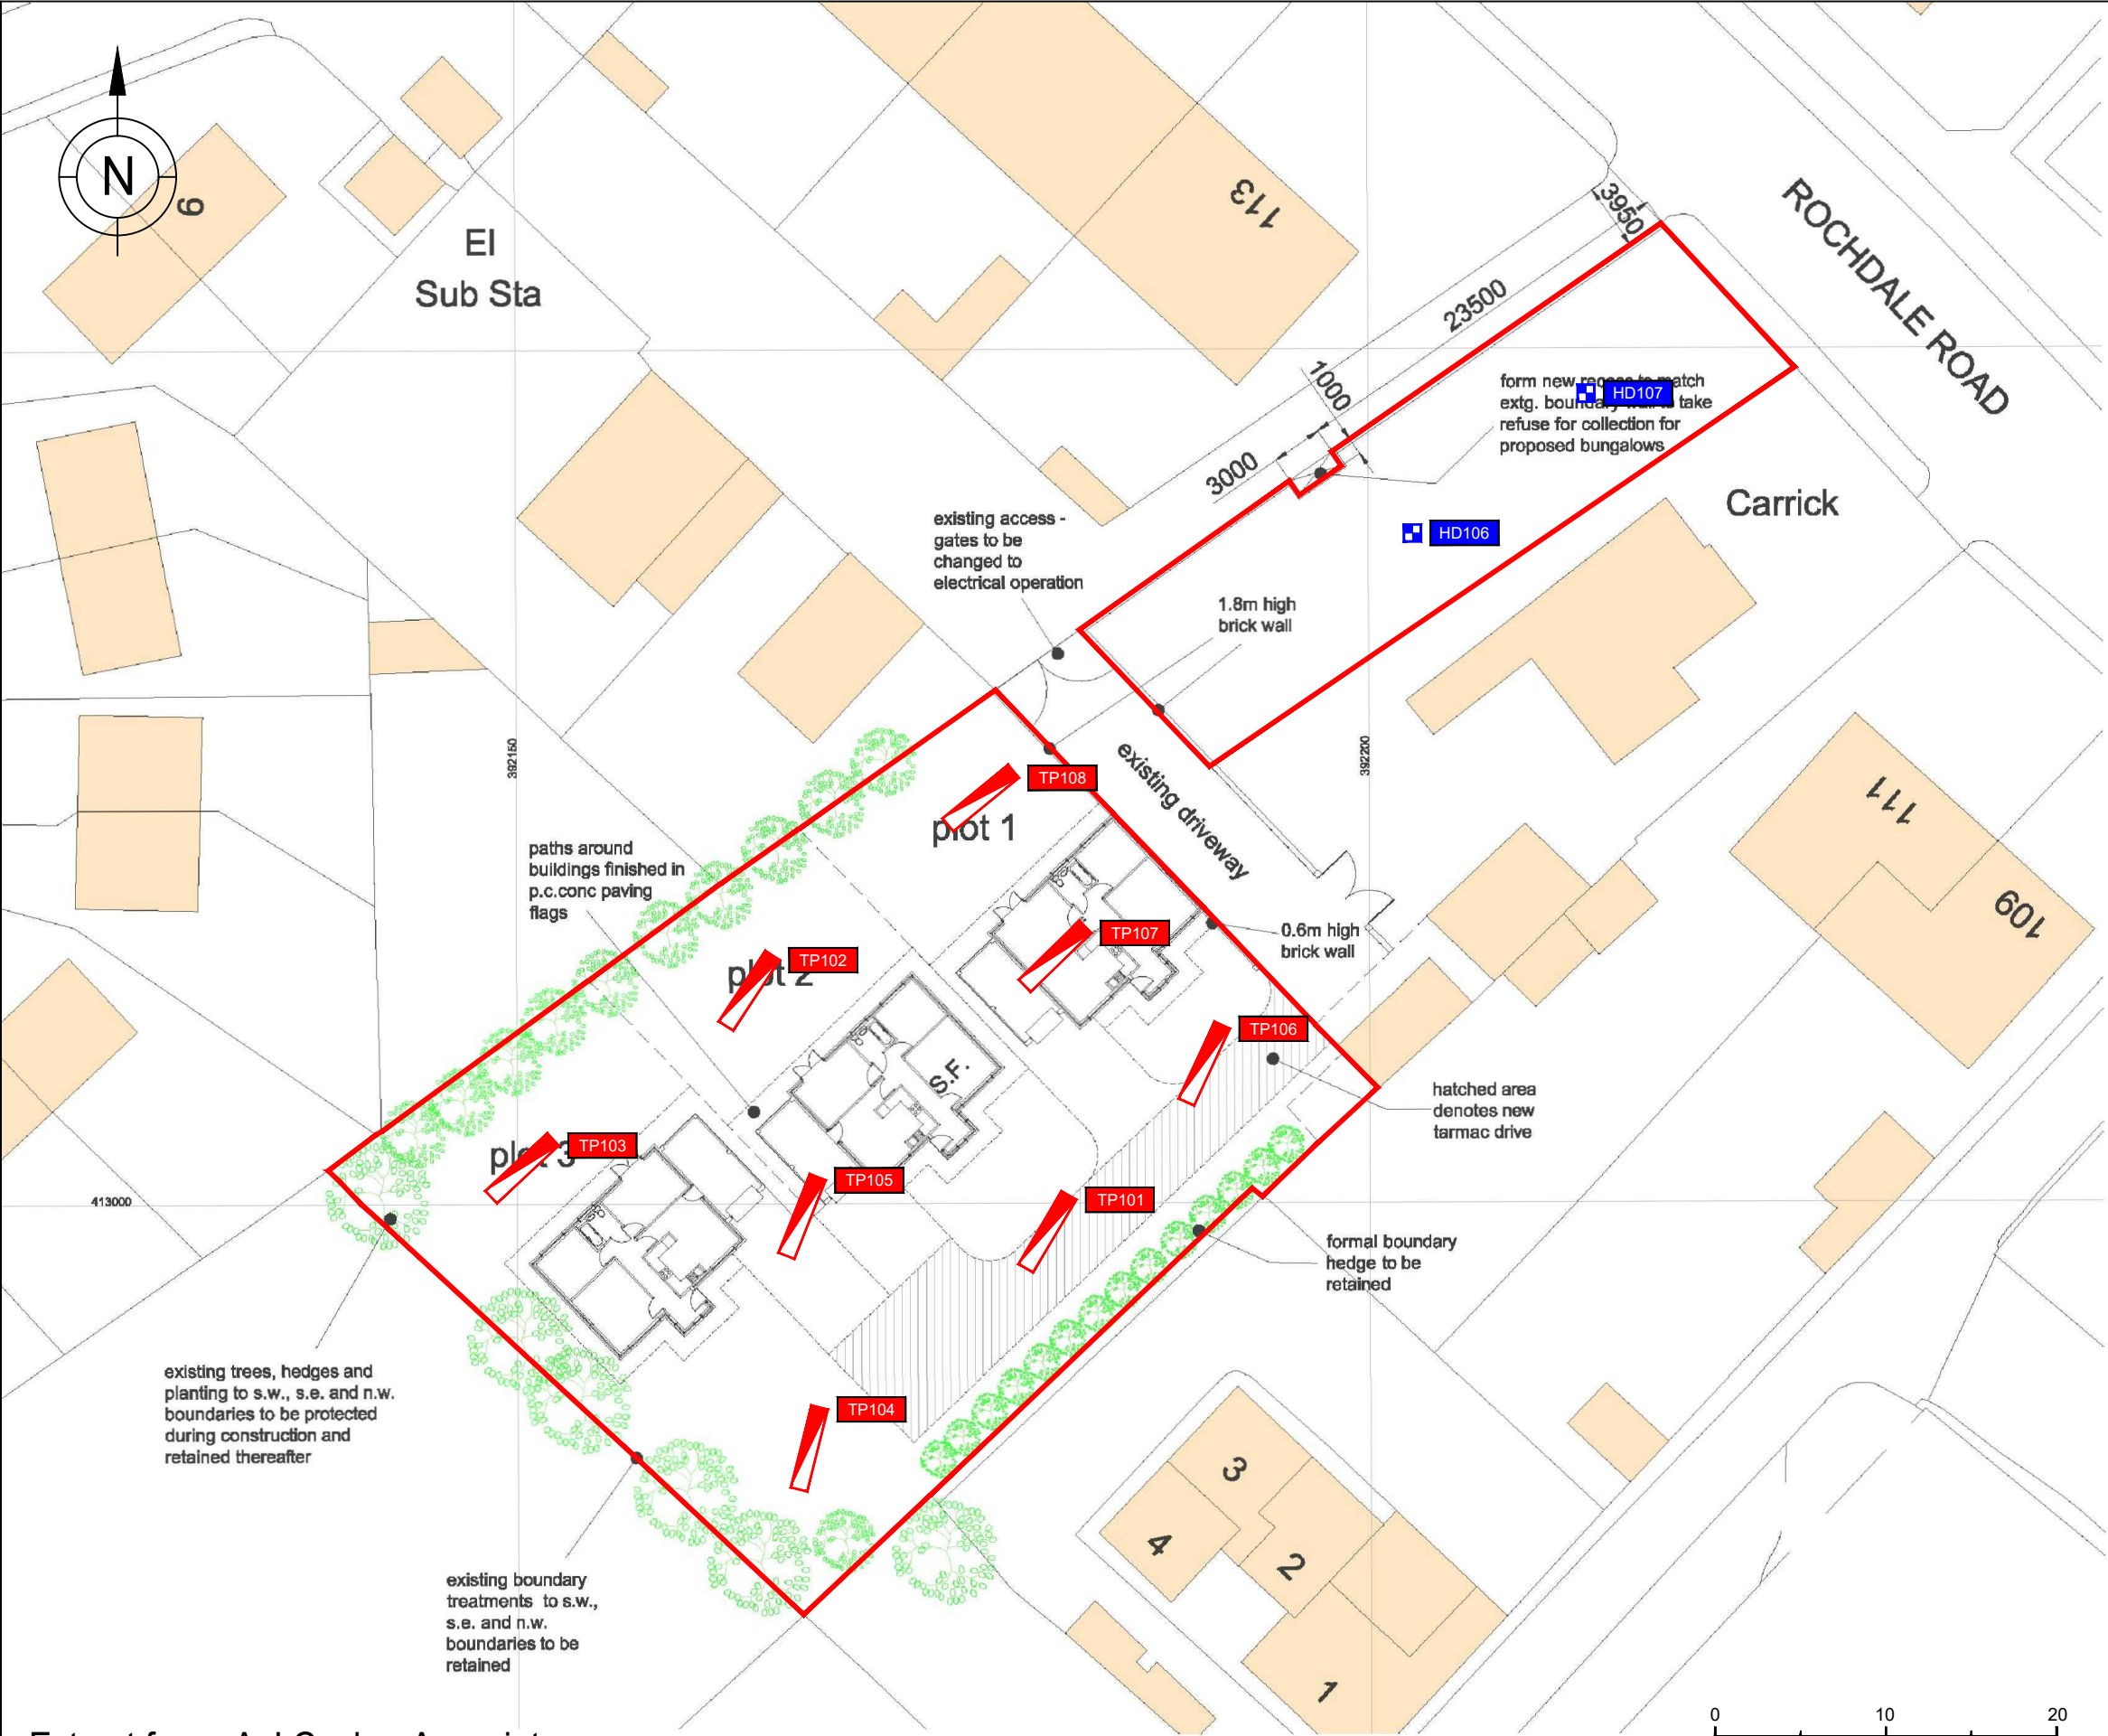

KEY



Site Boundary



Trial Pit (TP)



Hand Dug Trial Pit (HD)

Sampling Locations and features annotated by LK Consult Ltd are approximate and are based upon observed measurements unless otherwise stated. Do not scale from this drawing and work from marked dimensions only. All dimensions and features should be confirmed on site by the Contractor. Where this drawing includes information provided to LK Consult Ltd by others, LK Consult Ltd gives no warranty, representation or assurance as to the accuracy of such information.



Client: Christina Mahboob

Site: Carrick, Rochdale Road, Milnrow

Title: Site Investigation Location Plan

Job No.: LKC 20 1546	Scale (See Scale Bar): See Scale Bar	Figure: 3	Revision: A
Drawn By: AC	Checked By: RC	Drawn: Dec 2022	

Appendix A – Profile Logs



CONSULT

» Eton Business Park, Eton Hill Rd, Radcliffe, Greater Manchester M26 2ZS
» 0161 763 7200 » info@thelkgroup.com » www.thelkgroup.com

**LK CONSULT LTD**Eton Business Park, Eton Hill Road, Radcliffe, M26 2ZS
Tel: 0161 763 7200 web: www.thelkgroup.com**Site**

Carrick, Rochdale Road, Milnrow

**Trial Pit
Number
HD101****Excavation Method**Hand Excavated Trial Pit to
0.35mbgl.**Dimensions**

0.30m x 0.30m x 0.35m

Ground Level (mOD)

154.00

Client

Christina Mahboob

**Job
Number**
LKC 20 1546**Location**

392207 E 413041 N

Dates

29/09/2022

Engineer

LKC

Sheet
1/1

Depth (m)	Sample / Tests	Water Depth (m)	Field Records	Level (mOD)	Depth (m) (Thickness)	Description	Legend	Water
0.10-0.15	ES PID=0.4ppm				(0.15)	TOPSOIL: Dark brown gravelly sandy SILT with frequent rootlets and rare coal fragments. Sand is fine to coarse. Gravel is fine to coarse, angular to subrounded of sandstone, mudstone and siltstone.		
0.15-0.35	ES			153.85	0.15	Firm becoming stiff very gravelly silty CLAY with rare coal fragments and rootlets. Gravel is fine to coarse, angular to subrounded of sandstone, mudstone and siltstone.		
					(0.20)	Clay is friable due to high gravel content.		
				153.65	0.35	Complete at 0.35m		

No image available

RemarksHand excavated trial pit dry and stable.
Grid reference estimated using www.gridreferencefinder.com
Elevation estimated using www.freemaptools.com/elevation-finder.htm**Scale (approx)**

1:5

Logged By

JW

Figure No.

LKC 20 1546.HD101

Excavation Method

Hand Excavated Trial Pit to
0.60mbgl.

Dimensions

0.30m x 0.30m x 0.60m

Ground Level (mOD)

154.00

Client

Christina Mahboob

**Job
Number**
LKC 20 1546

Location

392218 E 413052 N



Dates

29/09/2022

Engineer

LKC

Sheet
1/1

Depth (m)	Sample / Tests	Water Depth (m)	Field Records	Level (mOD)	Depth (m) (Thickness)	Description	Legend	Water
						TOPSOIL: Dark brown gravelly sandy SILT with frequent rootlets and rare coal fragments. Sand is fine to coarse. Gravel is fine to coarse, angular to subrounded of sandstone, mudstone and siltstone.		
				153.60	0.40	Firm becoming stiff very gravelly silty CLAY with rare coal fragments and rootlets. Gravel is fine to coarse, angular to subrounded of sandstone, mudstone and siltstone.		
				153.40	0.60	Clay is friable due to high gravel content.		
						Complete at 0.60m		

No image available

Remarks

Hand excavated trial pit dry and stable.
Grid reference estimated using www.gridreferencefinder.com
Elevation estimated using www.freemaptools.com/elevation-finder.htm
Scale (approx)

1:5

Logged By

JW

Figure No.

LKC 20 1546.HD102

Appendix B – Certificate of Analysis – Soil



CONSULT

» Eton Business Park, Eton Hill Rd, Radcliffe, Greater Manchester M26 2ZS
» 0161 763 7200 » info@thelkgroup.com » www.thelkgroup.com



Final Report

Report No.:	22-37384-1		
Initial Date of Issue:	14-Oct-2022		
Client	LK Consult		
Client Address:	Unit 29 Eton Business Park Eton Hill Road Radcliffe Manchester Lancashire M26 2ZS		
Contact(s):	Contaminated Land Emma Khadun		
Project	LKC 20 1546 Carrick Milnrow		
Quotation No.:		Date Received:	30-Sep-2022
Order No.:	740618	Date Instructed:	30-Sep-2022
No. of Samples:	6		
Turnaround (Wkdays):	5	Results Due:	06-Oct-2022
Date Approved:	14-Oct-2022		
Approved By:			
Details:	Stuart Henderson, Technical Manager		

Results - Soil

Project: LKC 20 1546 Carrick Milnrow


Client: LK Consult	Chemtest Job No.:		22-37384	22-37384	22-37384	22-37384	22-37384	22-37384	22-37384
Quotation No.:	Chemtest Sample ID.:		1516063	1516064	1516065	1516066	1516067	1516068	
	Sample Location:		TS1	TS2	TS3	SS1	SS2	SS3	
	Sample Type:		SOIL	SOIL	SOIL	SOIL	SOIL	SOIL	
	Top Depth (m):		0.00	0.00	0.00	0.15	0.15	0.15	
	Bottom Depth (m):		0.15	0.15	0.15	0.35	0.35	0.35	
	Date Sampled:		29-Sep-2022	29-Sep-2022	29-Sep-2022	29-Sep-2022	29-Sep-2022	29-Sep-2022	
	Asbestos Lab:		COVENTRY	COVENTRY	COVENTRY	COVENTRY	COVENTRY	COVENTRY	
Determinand	Accred.	SOP	Units	LOD					
ACM Type	U	2192		N/A	-	-	-	-	-
Asbestos Identification	U	2192		N/A	No Asbestos Detected	No Asbestos Detected	No Asbestos Detected	No Asbestos Detected	No Asbestos Detected
Moisture	N	2030	%	0.020	16	19	17	16	15
Soil Colour	N	2040		N/A	Brown	Brown	Brown	Brown	Brown
Other Material	N	2040		N/A	Stones and Roots	Stones and Roots	Stones and Roots	Stones and Roots	Stones and Roots
Soil Texture	N	2040		N/A	Sand	Sand	Sand	Sand	Sand
Chromatogram (TPH)	N			N/A	See Attached	See Attached	See Attached	See Attached	See Attached
pH	M	2010		4.0	6.8	6.8	5.9	6.6	6.2
Boron (Hot Water Soluble)	M	2120	mg/kg	0.40	1.1	0.73	0.57	< 0.40	< 0.40
Sulphate (2:1 Water Soluble) as SO4	M	2120	g/l	0.010	< 0.010	< 0.010	< 0.010	< 0.010	< 0.010
Cyanide (Free)	M	2300	mg/kg	0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Cyanide (Total)	M	2300	mg/kg	0.50	1.2	0.60	< 0.50	< 0.50	< 0.50
Arsenic	M	2455	mg/kg	0.5	16	13	11	5.4	5.6
Cadmium	M	2455	mg/kg	0.10	0.30	0.24	0.18	< 0.10	< 0.10
Chromium	M	2455	mg/kg	0.5	20	16	14	13	15
Copper	M	2455	mg/kg	0.50	49	39	34	16	16
Mercury	M	2455	mg/kg	0.05	0.41	0.30	0.25	0.10	0.13
Nickel	M	2455	mg/kg	0.50	17	13	12	12	13
Lead	M	2455	mg/kg	0.50	110	84	68	22	23
Selenium	M	2455	mg/kg	0.25	0.73	0.57	0.57	0.56	0.56
Vanadium	U	2455	mg/kg	0.5	38	30	26	18	21
Zinc	M	2455	mg/kg	0.50	70	54	48	29	33
Chromium (Hexavalent)	N	2490	mg/kg	0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Organic Matter	M	2625	%	0.40	9.3	11	7.2	4.3	3.6
Diesel Present	N	2670		N/A	False	False	False	False	False
Aliphatic TPH >C5-C6	N	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aliphatic TPH >C6-C8	N	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aliphatic TPH >C8-C10	M	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aliphatic TPH >C10-C12	M	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aliphatic TPH >C12-C16	M	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aliphatic TPH >C16-C21	M	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aliphatic TPH >C21-C35	M	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aliphatic TPH >C35-C44	N	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total Aliphatic Hydrocarbons	N	2680	mg/kg	5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Aromatic TPH >C5-C7	N	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aromatic TPH >C7-C8	N	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0

Results - Soil


Project: LKC 20 1546 Carrick Milnrow

Client: LK Consult	Chemtest Job No.:		22-37384	22-37384	22-37384	22-37384	22-37384	22-37384
Quotation No.:	Chemtest Sample ID.:		1516063	1516064	1516065	1516066	1516067	1516068
	Sample Location:		TS1	TS2	TS3	SS1	SS2	SS3
	Sample Type:		SOIL	SOIL	SOIL	SOIL	SOIL	SOIL
	Top Depth (m):		0.00	0.00	0.00	0.15	0.15	0.15
	Bottom Depth (m):		0.15	0.15	0.15	0.35	0.35	0.35
	Date Sampled:		29-Sep-2022	29-Sep-2022	29-Sep-2022	29-Sep-2022	29-Sep-2022	29-Sep-2022
	Asbestos Lab:		COVENTRY	COVENTRY	COVENTRY	COVENTRY	COVENTRY	COVENTRY
Determinand	Accred.	SOP	Units	LOD				
Aromatic TPH >C8-C10	M	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aromatic TPH >C10-C12	U	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aromatic TPH >C12-C16	U	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aromatic TPH >C16-C21	N	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aromatic TPH >C21-C35	M	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Aromatic TPH >C35-C44	N	2680	mg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total Aromatic Hydrocarbons	N	2680	mg/kg	5.0	< 5.0	< 5.0	< 5.0	< 5.0
Total Petroleum Hydrocarbons	N	2680	mg/kg	10.0	< 10	< 10	< 10	< 10
Benzene	M	2760	µg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	M	2760	µg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Ethylbenzene	M	2760	µg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0
m & p-Xylene	M	2760	µg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	M	2760	µg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl Tert-Butyl Ether	M	2760	µg/kg	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Naphthalene	M	2800	mg/kg	0.10	< 0.10	< 0.10	< 0.10	0.43
Acenaphthylene	N	2800	mg/kg	0.10	< 0.10	< 0.10	< 0.10	0.32
Acenaphthene	M	2800	mg/kg	0.10	< 0.10	< 0.10	< 0.10	0.75
Fluorene	M	2800	mg/kg	0.10	< 0.10	< 0.10	< 0.10	0.70
Phenanthrene	M	2800	mg/kg	0.10	7.7	5.6	1.2	6.7
Anthracene	M	2800	mg/kg	0.10	1.6	1.0	0.32	1.4
Fluoranthene	M	2800	mg/kg	0.10	9.1	8.8	2.4	6.7
Pyrene	M	2800	mg/kg	0.10	6.8	6.8	1.8	5.0
Benzo[a]anthracene	M	2800	mg/kg	0.10	3.7	3.9	1.1	2.7
Chrysene	M	2800	mg/kg	0.10	3.5	3.8	0.98	2.5
Benzo[b]fluoranthene	M	2800	mg/kg	0.10	4.4	4.5	< 0.10	3.0
Benzo[k]fluoranthene	M	2800	mg/kg	0.10	1.4	1.5	< 0.10	0.98
Benzo[a]pyrene	M	2800	mg/kg	0.10	3.9	3.9	< 0.10	2.6
Indeno(1,2,3-c,d)Pyrene	M	2800	mg/kg	0.10	2.5	2.5	< 0.10	1.5
Dibenz(a,h)Anthracene	N	2800	mg/kg	0.10	0.57	0.51	< 0.10	0.33
Benzo[g,h,i]perylene	M	2800	mg/kg	0.10	1.9	2.1	< 0.10	1.2
Total Of 16 PAH's	N	2800	mg/kg	2.0	47	45	7.9	37
Total Phenols	M	2920	mg/kg	0.10	< 0.10	< 0.10	< 0.10	< 0.10


TPH Chromatogram on Soil Sample: 1516063

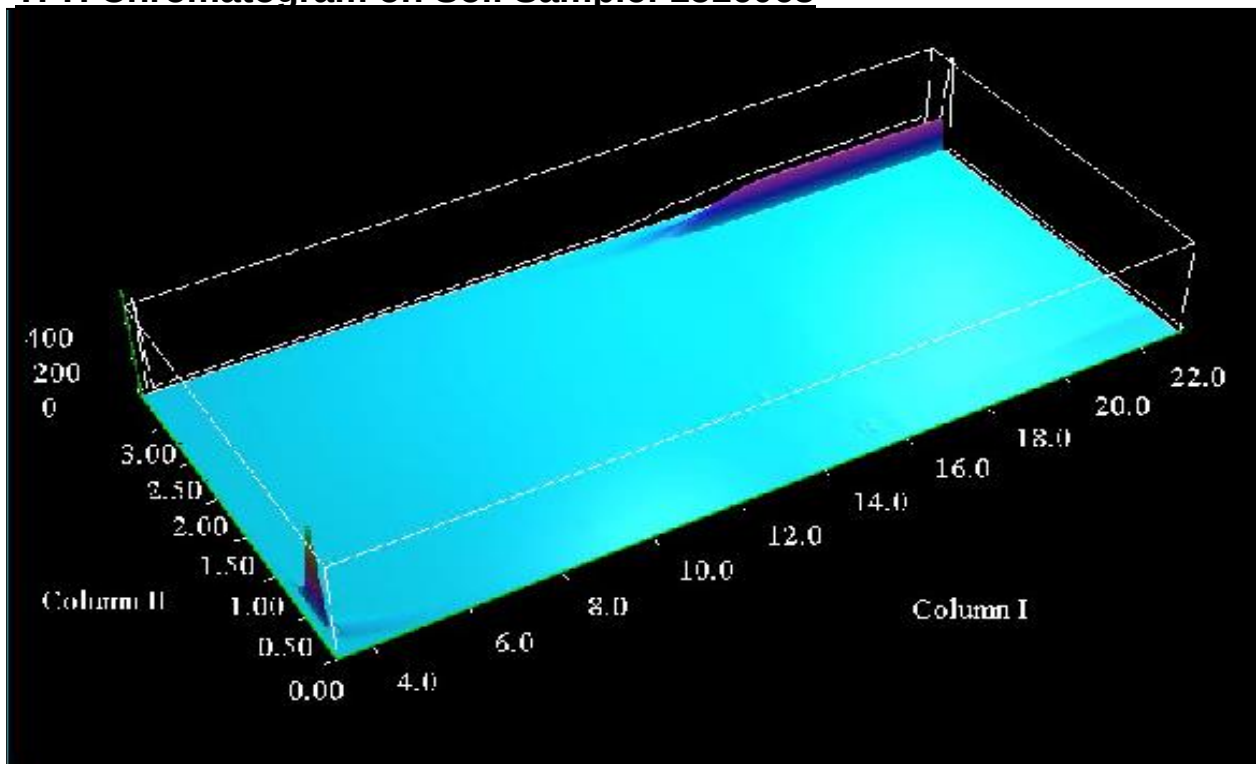


TPH Chromatogram on Soil Sample: 1516064

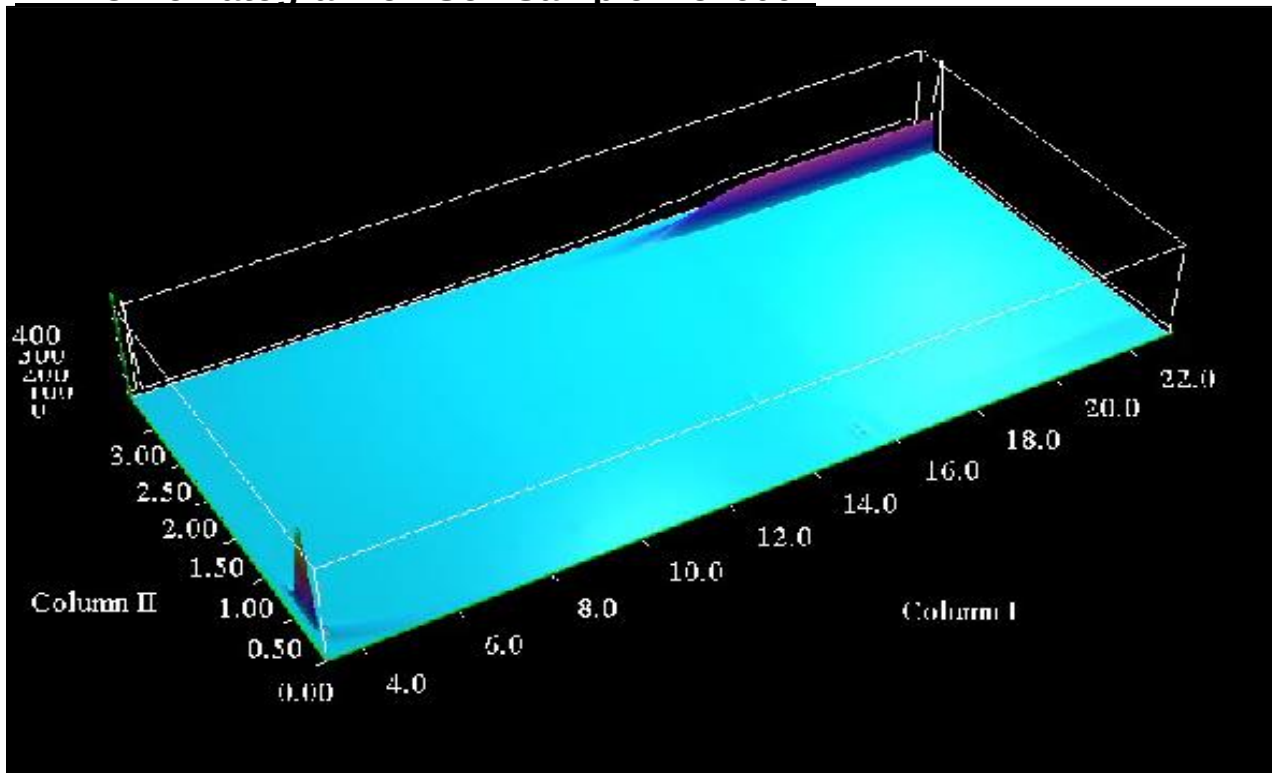


TPH Chromatogram on Soil Sample: 1516065

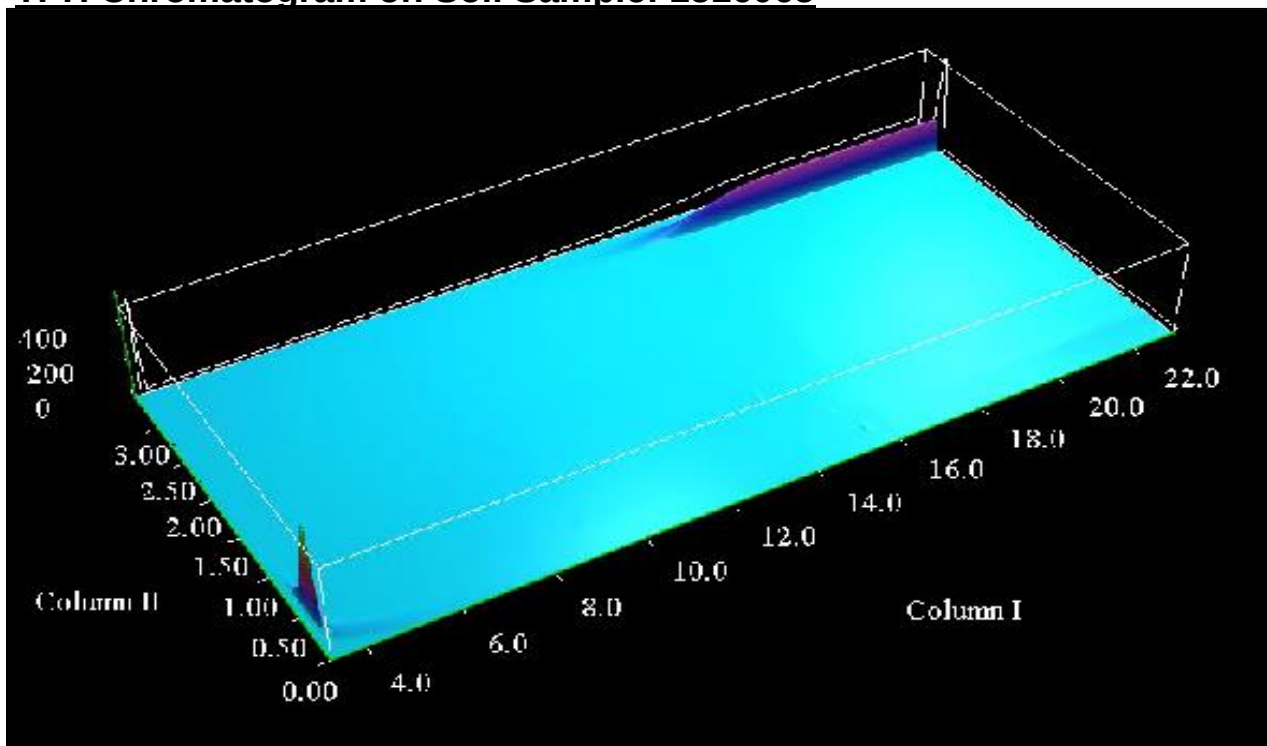


TPH Chromatogram on Soil Sample: 1516066

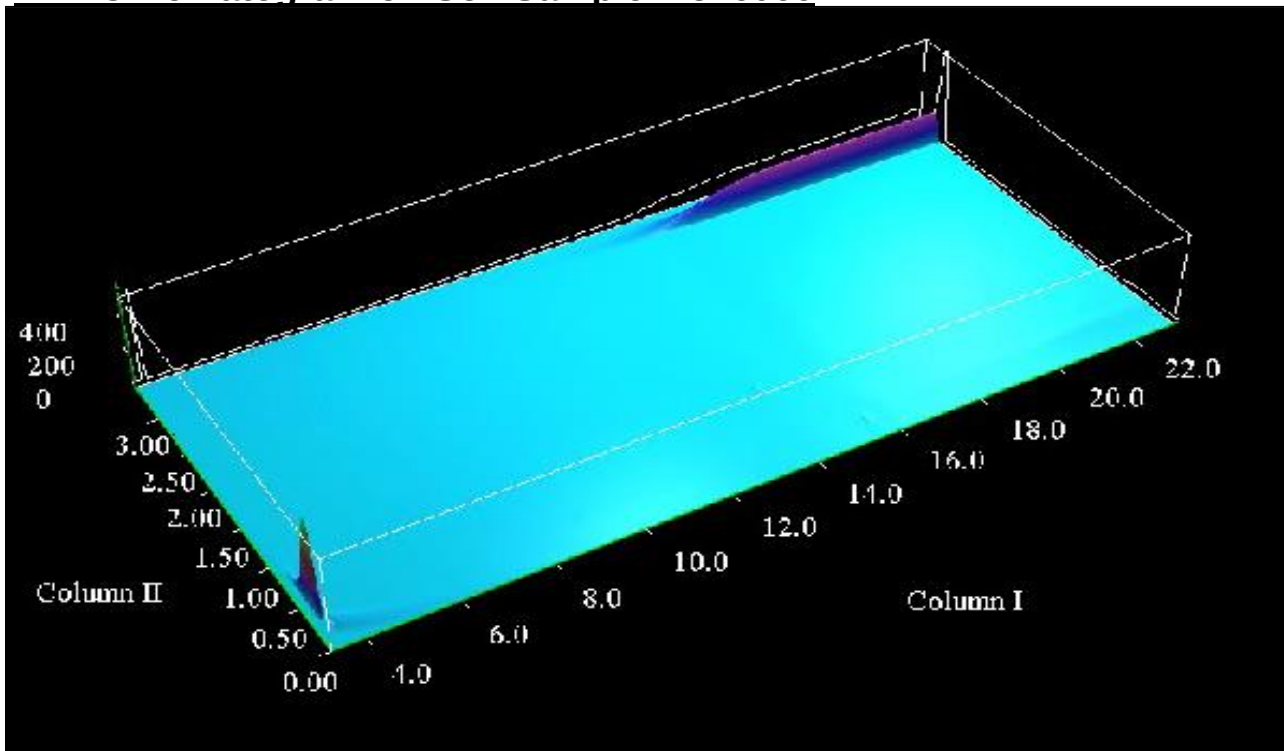

TPH Chromatogram on Soil Sample: 1516067

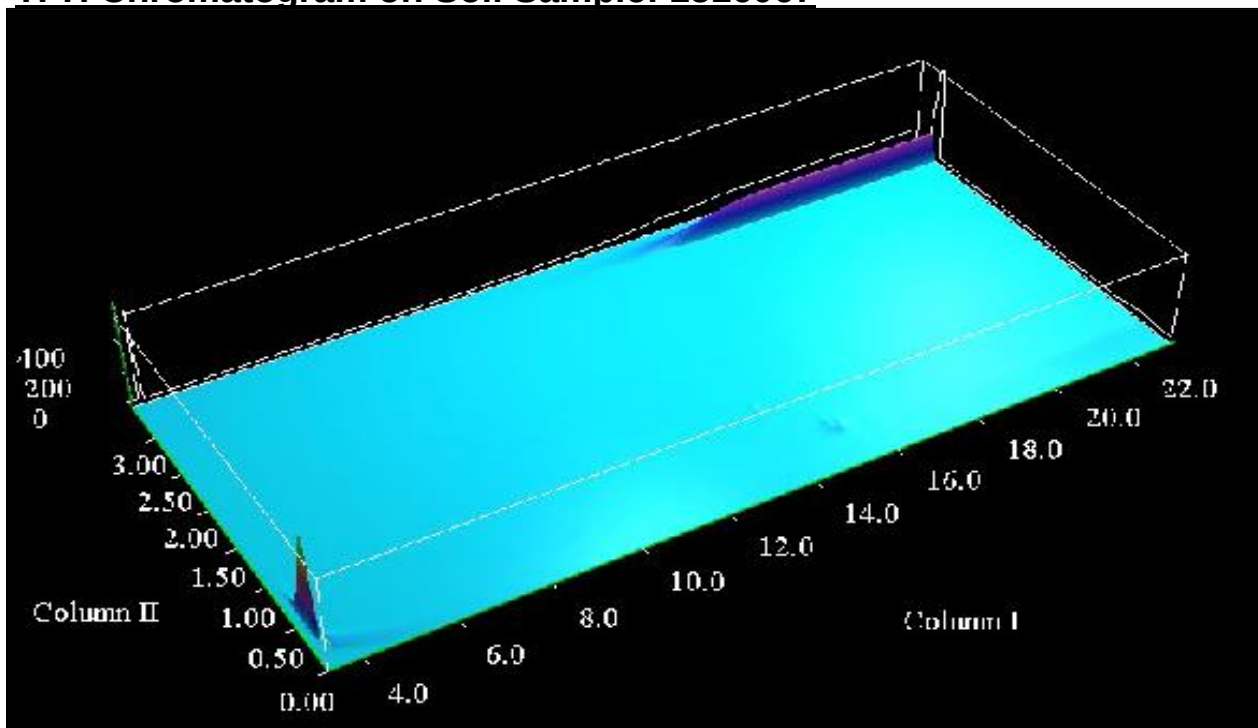

TPH Chromatogram on Soil Sample: 1516068

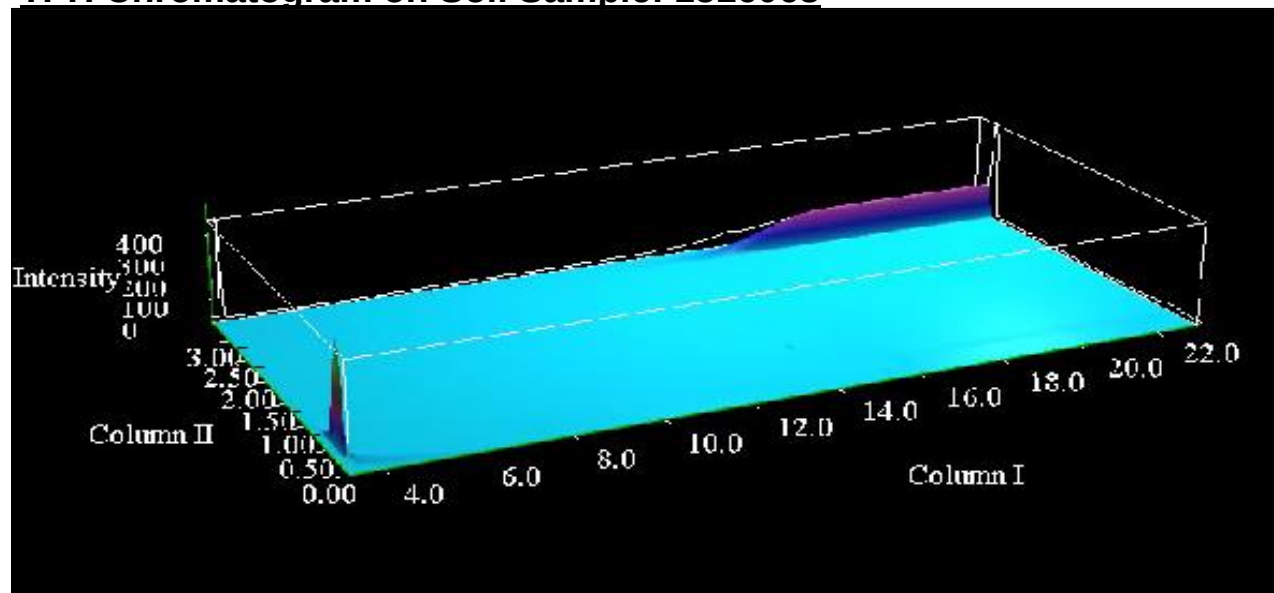

TPH Interpretation

Job	Sample	Matrix	Location	Sample Ref	Sample ID	Sample Depth (m)	Gasoline / Diesel Present	TPH Interpretation
22-37384	1516063	S	TS1			0.00	No	N/A
22-37384	1516064	S	TS2			0.00	No	N/A
22-37384	1516065	S	TS3			0.00	No	N/A
22-37384	1516066	S	SS1			0.15	No	N/A
22-37384	1516067	S	SS2			0.15	No	N/A
22-37384	1516068	S	SS3			0.15	No	N/A

Test Methods

SOP	Title	Parameters included	Method summary
2010	pH Value of Soils	pH	pH Meter
2030	Moisture and Stone Content of Soils(Requirement of MCERTS)	Moisture content	Determination of moisture content of soil as a percentage of its as received mass obtained at <37°C.
2040	Soil Description(Requirement of MCERTS)	Soil description	As received soil is described based upon BS5930
2120	Water Soluble Boron, Sulphate, Magnesium & Chromium	Boron; Sulphate; Magnesium; Chromium	Aqueous extraction / ICP-OES
2192	Asbestos	Asbestos	Polarised light microscopy / Gravimetry
2300	Cyanides & Thiocyanate in Soils	Free (or easy liberatable) Cyanide; total Cyanide; complex Cyanide; Thiocyanate	Alkaline extraction followed by colorimetric determination using Automated Flow Injection Analyser.
2455	Acid Soluble Metals in Soils	Metals, including: Arsenic; Barium; Beryllium; Cadmium; Chromium; Cobalt; Copper; Lead; Manganese; Mercury; Molybdenum; Nickel; Selenium; Vanadium; Zinc	Acid digestion followed by determination of metals in extract by ICP-MS.
2490	Hexavalent Chromium in Soils	Chromium [VI]	Soil extracts are prepared by extracting dried and ground soil samples into boiling water. Chromium [VI] is determined by 'Aquakem 600' Discrete Analyser using 1,5-diphenylcarbazide.
2625	Total Organic Carbon in Soils	Total organic Carbon (TOC)	Determined by high temperature combustion under oxygen, using an Eltra elemental analyser.
2670	Total Petroleum Hydrocarbons (TPH) in Soils by GC-FID	TPH (C6–C40); optional carbon banding, e.g. 3-band – GRO, DRO & LRO*TPH C8–C40	Dichloromethane extraction / GC-FID
2680	TPH A/A Split	Aliphatics: >C5–C6, >C6–C8,>C8–C10, >C10–C12, >C12–C16, >C16–C21, >C21–C35, >C35– C44Aromatics: >C5–C7, >C7–C8, >C8– C10, >C10–C12, >C12–C16, >C16– C21, >C21– C35, >C35– C44	Dichloromethane extraction / GCxGC FID detection
2760	Volatile Organic Compounds (VOCs) in Soils by Headspace GC-MS	Volatile organic compounds, including BTEX and halogenated Aliphatic/Aromatics.(cf. USEPA Method 8260)*please refer to UKAS schedule	Automated headspace gas chromatographic (GC) analysis of a soil sample, as received, with mass spectrometric (MS) detection of volatile organic compounds.
2800	Speciated Polynuclear Aromatic Hydrocarbons (PAH) in Soil by GC-MS	Acenaphthene*; Acenaphthylene; Anthracene*; Benzo[a]Anthracene*; Benzo[a]Pyrene*; Benzo[b]Fluoranthene*; Benzo[ghi]Perylene*; Benzo[k]Fluoranthene; Chrysene*; Dibenzo[ah]Anthracene; Fluoranthene*; Fluorene*; Indeno[123cd]Pyrene*; Naphthalene*; Phenanthrene*; Pyrene*	Dichloromethane extraction / GC-MS
2920	Phenols in Soils by HPLC	Phenolic compounds including Resorcinol, Phenol, Methylphenols, Dimethylphenols, 1-Naphthol and TrimethylphenolsNote: chlorophenols are excluded.	60:40 methanol/water mixture extraction, followed by HPLC determination using electrochemical detection.

Report Information

Key

U	UKAS accredited
M	MCERTS and UKAS accredited
N	Unaccredited
S	This analysis has been subcontracted to a UKAS accredited laboratory that is accredited for this analysis
SN	This analysis has been subcontracted to a UKAS accredited laboratory that is not accredited for this analysis
T	This analysis has been subcontracted to an unaccredited laboratory
I/S	Insufficient Sample
U/S	Unsuitable Sample
N/E	not evaluated
<	"less than"
>	"greater than"
SOP	Standard operating procedure
LOD	Limit of detection

Comments or interpretations are beyond the scope of UKAS accreditation

The results relate only to the items tested

Uncertainty of measurement for the determinands tested are available upon request

None of the results in this report have been recovery corrected

All results are expressed on a dry weight basis

The following tests were analysed on samples as received and the results subsequently corrected to a dry weight basis TPH, BTEX, VOCs, SVOCs, PCBs, Phenols

For all other tests the samples were dried at < 37°C prior to analysis

All Asbestos testing is performed at the indicated laboratory

Issue numbers are sequential starting with 1 all subsequent reports are incremented by 1

Sample Deviation Codes

- A - Date of sampling not supplied
- B - Sample age exceeds stability time (sampling to extraction)
- C - Sample not received in appropriate containers
- D - Broken Container
- E - Insufficient Sample (Applies to LOI in Trommel Fines Only)

Sample Retention and Disposal

All soil samples will be retained for a period of 30 days from the date of receipt

All water samples will be retained for 14 days from the date of receipt

Charges may apply to extended sample storage

If you require extended retention of samples, please email your requirements to:

customerservices@chemtest.com

Appendix C – Generic Assessment Criteria Values



CONSULT

» Eton Business Park, Eton Hill Rd, Radcliffe, Greater Manchester M26 2ZS
» 0161 763 7200 » info@thelkgroup.com » www.thelkgroup.com

CATEGORY 4 SCREENING LEVELS

Substance	Residential (with home- grown produce)	Residential (without home- grown produce)	Allotments	Commercial	Public Open Space 1	Public Open Space 2
Arsenic	37 mg/kg	40 mg/kg	49 mg/kg	640 mg/kg	79 mg/kg	170 mg/kg
Benzene	0.87 mg/kg	3.3 mg/kg	0.18 mg/kg	98 mg/kg	140 mg/kg	230 mg/kg
Benzo(a)pyrene	5.0 mg/kg	5.3 mg/kg	5.7 mg/kg	77 mg/kg	10 mg/kg	21 mg/kg
Cadmium	22 mg/kg	150 mg/kg	3.9 mg/kg	410 mg/kg	220 mg/kg	880 mg/kg
Chromium VI	21 mg/kg	21 mg/kg	170 mg/kg	49 mg/kg	21 mg/kg	250 mg/kg
Lead	200 mg/kg	310 mg/kg	80 mg/kg	2300 mg/kg	630 mg/kg	1300 mg/kg

Tetrachlorethene (PCE) – 1% SOM	0.31 mg/kg	0.32 mg/kg	2.0 mg/kg	24 mg/kg	3,200 mg/kg	1,400 mg/kg
Tetrachlorethene (PCE) – 2.5% SOM	0.70 mg/kg	0.71 mg/kg	4.8 mg/kg	55 mg/kg	3,300 mg/kg	1,900 mg/kg
Tetrachlorethene (PCE) – 6% SOM	1.6 mg/kg	1.6 mg/kg	11 mg/kg	130 mg/kg	3,400 mg/kg	2,500 mg/kg
Trichlorethene (TCE) – 1% SOM	0.0093 mg/kg	0.0097 mg/kg	0.032 mg/kg	0.73 mg/kg	76 mg/kg	41 mg/kg
Trichlorethene (TCE) – 2.5% SOM	0.020 mg/kg	0.020 mg/kg	0.072 mg/kg	1.5 mg/kg	78 mg/kg	54 mg/kg
Trichlorethene (TCE) – 6% SOM	0.043 mg/kg	0.045 mg/kg	0.16 mg/kg	3.4 mg/kg	79 mg/kg	69 mg/kg
Vinyl Chloride (VC) – 1% SOM	0.0064 mg/kg	0.015 mg/kg	0.0017 mg/kg	1.1 mg/kg	7.8 mg/kg	18 mg/kg
Vinyl Chloride (VC) – 2.5% SOM	0.010 mg/kg	0.019 mg/kg	0.0031 mg/kg	1.4 mg/kg	7.8 mg/kg	19 mg/kg
Vinyl Chloride (VC) – 6% SOM	0.017 mg/kg	0.029 mg/kg	0.0058 mg/kg	2.2 mg/kg	7.8 mg/kg	19 mg/kg
1,2-Dichloroethane 1% SOM	0.11 mg/kg	0.16 mg/kg	0.054 mg/kg	12 mg/kg	300 mg/kg	300 mg/kg
1,2-Dichloroethane 2.5% SOM	0.18 mg/kg	0.24 mg/kg	0.10 mg/kg	17 mg/kg	310 mg/kg	330 mg/kg
1,2-Dichloroethane 6% SOM	0.31 mg/kg	0.41 mg/kg	0.19 mg/kg	29 mg/kg	310 mg/kg	380 mg/kg

Summary Table for the Generic Assessment Criteria for Human Health Risk Assessment Land Quality Management (LQM) S4ULs.

All GAC are based on sandy
loam soils with a pH 7.

All GAC are based on sandy loam soils with a pH 7.			LQM Generic Assessment Criteria (mg/kg) Dry weight soil					
Contaminant		SOM	Res +	Res -	Allot.	Comm.	POS _{resi}	POS _{park}
Metals	Inorganic Arsenic	6%	37	40	43	640	79	170
	Beryllium	6%	1.7	1.7	35	12	2.2	63
	Boron	6%	290	11,000	45	240,000	21,000	46,000
	Cadmium	6%	11	85	1.9	190	120	532
	Chromium (III)	6%	910	910	18,000	8,600	1,500	33,000
	Chromium (VI)	6%	6.0	6.0	1.8	33	7.7	220
	Copper	6%	2,400	7,100	520	68,000	12,000	44,000
	Elemental Mercury	6%	1.2	1.2	21	58 (25.8) ^{vap}	16	30 (25.8) ^{vap}
	Inorganic Mercury	6%	40	56	19	1,100	120	240
	Methylmercury	6%	11	15	6.0	320	40	68
	Nickel (update 2015)	6%	126	181	53	983	231	804
	Selenium	6%	250	430	88	12,000	1,100	1,800
	Vanadium	6%	410	1,200	91	9,000	2,000	5,000
Zinc	6%	3,700	40,000	620	730,000	81,000	170,000	
BTEX Compounds	Benzene	1%	0.087	0.38	0.017	27	72	90
		2.5%	0.17	0.70	0.034	47	72	100
		6%	0.37	1.4	0.075	90	73	110
	Toluene	1%	130	880 (869) ^{vap}	22	56,000 (869) ^{vap}	56,000	87,000 (869) ^{vap}
		2.5%	290	1,900	51	110,000 (1,920) ^{vap}	56,000	95,000 (1,920) ^{vap}
		6%	660	3,900	120	180,000 (4,360) ^{vap}	56,000	100,000 (4,360) ^{vap}
	Ethylbenzene	1%	47	83	16	5,700 (518) ^{vap}	24,000	17,000 (518) ^{vap}
		2.5%	110	190	39	13,000 (1,220) ^{vap}	24,000	22,000 (1,220) ^{vap}
		6%	260	440	91	27,000 (2,840) ^{vap}	25,000	27,000 (2,840) ^{vap}
	o-xylene	1%	60	88	28	6,600 (478) ^{sol}	41,000	17,000 (478) ^{sol}
		2.5%	140	210	67	15,000 (1,120) ^{sol}	42,000	24,000 (1,120) ^{sol}
		6%	330	480	160	33,000 (2,620) ^{sol}	43,000	33,000 (2,620) ^{sol}
	m-xylene	1%	59	82	31	6,200 (625) ^{vap}	41,000	17,000 (625) ^{vap}
		2.5%	140	190	74	14,000 (1,470) ^{vap}	42,000	24,000 (1,470) ^{vap}
		6%	320	450	170	31,000 (3,460) ^{vap}	43,000	32,000 (3,460) ^{vap}
	p-xylene	1%	56	79	29	5,900 (576) ^{sol}	41,000	17,000 (576) ^{sol}
		2.5%	130	180	69	14,000 (1,350) ^{sol}	42,000	23,000 (1,350) ^{sol}
		6%	310	430	160	30,000 (3,170) ^{sol}	43,000	31,000 (3,170) ^{sol}

NOTES

^{sol} / ^{vap} = solubility / vapour limit (potentially use if free product identified, although highly conservative).

f = oral, dermal and inhalation exposures compared to oral HCV.

All GAC are based on sandy loam soils with a pH 7.

All GAC are based on sandy loam soils with a pH 7.			LQM Generic Assessment Criteria (mg/kg) Dry weight soil					
Contaminant		SOM	Res +	Res -	Allot.	Comm.	POS _{resi}	POS _{park}
Polycyclic Aromatic Hydrocarbons (PAHs)	Acenaphthene	1%	210	3,000 (57.1) ^{sol}	34	84,000 (57.0) ^{sol}	15,000	29,000
		2.5%	510	4,700 (141) ^{sol}	85	97,000 (141) ^{sol}	15,000	30,000
		6%	1,100	6,000 (336) ^{sol}	200	100,000	15,000	30,000
	Acenaphthylene	1%	170	2,900 (86.1) ^{sol}	28	83,000 (86.1) ^{sol}	15,000	29,000
		2.5%	420	4,600 (212) ^{sol}	69	97,000 (212) ^{sol}	15,000	30,000
		6%	920	6,000 (506) ^{sol}	160	100,000	15,000	30,000
	Anthracene	1%	2,400	31,000 (1.17) ^{vap}	380	520,000	74,000	150,000
		2.5%	5,400	35,000	950	540,000	74,000	150,000
		6%	11,000	37,000	2,200	540,000	74,000	150,000
	Benz(a)anthracene	1%	7.2	11	2.9	170	29	49
		2.5%	11	14	6.5	170	29	56
		6%	13	15	13	180	29	62
	Benzo(a)pyrene (only)	1%	2.2	3.2	0.97	35	5.7	11
		2.5%	2.7	3.2	2.0	35	5.7	12
		6%	3.0	3.2	3.5	36	5.7	13
	Benzo(b)fluoranthene	1%	2.6	3.9	0.99	44	7.1	13
		2.5%	3.3	4.0	2.1	44	7.2	15
		6%	3.7	4.0	3.9	45	7.2	16
	Benzo(ghi)perylene	1%	320	360	290	3,900	640	1,400
		2.5%	340	360	470	4,000	640	1,500
		6%	350	360	640	4,000	640	1,600
	Benzo(k)fluoranthene	1%	77	110	37	1,200	190	370
		2.5%	93	110	75	1,200	190	410
		6%	100	110	130	1,200	190	440
	Chrysene	1%	15	30	4.1	350	57	93
		2.5%	22	31	9.4	350	57	110
		6%	27	32	19	350	57	120
	Dibenzo(ah)anthracene	1%	0.24	0.31	0.14	3.5	0.57	1.1
		2.5%	0.28	0.32	0.27	3.6	0.58	1.3
		6%	0.3	0.32	0.43	3.6	0.58	1.4
	Fluoranthene	1%	280	1,500	52	23,000	3,100	6,300
		2.5%	560	1,600	130	23,000	3,100	6,300
		6%	890	1,600	290	23,000	3,100	6,400
	Fluorene	1%	170	2,800 (36.0) ^{sol}	27	63,000 (30.9) ^{sol}	9,900	20,000
		2.5%	400	3,800 (76.5) ^{sol}	67	68,000	9,900	20,000
		6%	860	4,500 (183) ^{sol}	160	71,000	9,900	20,000
	Indeno(123-cd)pyrene	1%	27	45	9.5	500	82	150
		2.5%	36	46	21	510	82	170
		6%	41	46	39	510	82	180
	Naphthalene	1%	2.3 ^f	2.3 ^f	4.1 ^f	190 ^f (76.4) ^{sol}	4,900 ^f	1,200 ^f (76.4) ^{sol}
		2.5%	5.6 ^f	5.6 ^f	10 ^f	460 ^f (183) ^{sol}	4,900 ^f	1,900 ^f (183) ^{sol}
		6%	13 ^f	13 ^f	24 ^f	1,100 ^f (432) ^{sol}	4,900 ^f	3,000
	Phenanthrene	1%	95	1,300 (36.0) ^{sol}	15	22,000	3,100	6,200
		2.5%	220	1,500	38	22,000	3,100	6,200
		6%	440	1,500	90	22,000	3,100	6,300
	Pyrene	1%	620	3,700	110	54,000	7,400	15,000
		2.5%	1,200	3,800	270	54,000	7,400	15,000
		6%	2,000	3,800	620	54,000	7,400	15,000
Coal Tar (B(a)P as surrogate marker)	1%	0.79	1.2	0.32	15	2.2	4.4	
	2.5%	0.98	1.2	0.67	15	2.2	4.7	
	6%	1.1	1.2	1.2	15	2.2	4.8	

NOTES

^{Sol / vap} = solubility / vapour limit (potentially use if free product identified, although highly conservative).

^f = naphthalene is based on comparison of inhalation exposure with TDI_{Inhal} for localised effect.

All GAC are based on sandy loam soils with a pH 7.

LQM Generic Assessment Criteria (mg/kg) Dry weight soil

Contaminant	SOM	Res +	Res -	Allot.	Comm.	POS _{resi}	POS _{park}
Aliphatic							
EC 5-6	1%	42	42	730	3,200 (304) ^{sol}	570,000(304) ^{sol}	95,000 (304) ^{sol}
EC>6-8	1%	100	100	2,300	7,800 (144) ^{sol}	600,000	150,000 (144) ^{sol}
EC>8-10	1%	27	27	320	2,000 (78) ^{sol}	13,000	14,000 (78) ^{vap}
EC>10-12	1%	130 (48) ^{vap}	130 (48) ^{vap}	2,200	9,700 (48) ^{sol}	13,000	21,000 (48) ^{vap}
EC>12-16	1%	1,100 (24) ^{sol}	1,100 (24) ^{sol}	11,000	59,000 (24) ^{sol}	13,000	25,000 (24) ^{sol}
EC>16-35	1%	65,000 (8.48) ^{f, sol}	65,000 (8.48) ^{f, sol}	260,000 ^f	160,000 ^f	250,000 ^f	450,000 ^f
EC>35-44	1%	65,000 (8.48) ^{f, sol}	65,000 (8.48) ^{f, sol}	260,000 ^f	160,000 ^f	250,000 ^f	450,000 ^f
Aliphatic							
EC 5-6	2.5%	78	78	1,700	5,900 (558) ^{sol}	590,000	130,000 (558) ^{sol}
EC>6-8	2.5%	230	230	5,600	17,000 (322) ^{sol}	610,000	220,000 (322) ^{sol}
EC>8-10	2.5%	65	65	770	4,800 (190) ^{vap}	13,000	18,000 (190) ^{vap}
EC>10-12	2.5%	330 (118) ^{vap}	330 (118) ^{vap}	4,400	23,000 (118) ^{vap}	13,000	23,000 (118) ^{vap}
EC>12-16	2.5%	2,400 (59) ^{sol}	2,400 (59) ^{sol}	13,000	82,000 (59) ^{sol}	13,000	25,000 (59) ^{sol}
EC>16-35	2.5%	92,000 (21) ^{f, sol}	92,000 (21) ^{f, sol}	270,000 ^f	1,700,000 ^f	250,000 ^f	480,000 ^f
EC>35-44	2.5%	92,000 (21) ^{f, sol}	92,000 (21) ^{f, sol}	270,000 ^f	1,700,000 ^f	250,000 ^f	480,000 ^f
Aliphatic							
EC 5-6	6%	160	160	3,900	12,000 (1,150) ^{sol}	600,000	180,000 (1,150) ^{sol}
EC>6-8	6%	530	530	13,000	40,000 (736) ^{sol}	620,000	320,000 (736) ^{sol}
EC>8-10	6%	150	150	1,700	11,000 (451) ^{vap}	13,000	21,000 (451) ^{vap}
EC>10-12	6%	760 (283) ^{vap}	760 (283) ^{vap}	7,300	47,000 (283) ^{vap}	13,000	24,000 (283) ^{vap}
EC>12-16	6%	4,300 (142) ^{sol}	4,400 (142) ^{sol}	13,000	90,000 (142) ^{sol}	13,000	26,000 (142) ^{sol}
EC>16-35	6%	110,000 ^f	110,000 ^f	270,000 ^f	1,800,000 ^f	250,000 ^f	490,000 ^f
EC>35-44	6%	110,000 ^f	110,000 ^f	270,000 ^f	1,800,000 ^f	250,000 ^f	490,000 ^f
Aromatic							
EC5-7(benzene as non-threshold)	1%	70	370	13	26,000 (1,220) ^{sol}	56,000	76,000 (1,220) ^{sol}
EC>7-8(toluene)	1%	130	860	22	56,000 (869) ^{vap}	56,000	87,000 (869) ^{vap}
EC>8-10	1%	34	47	8.6	3,500 (613) ^{vap}	5,000	7,200 (613) ^{vap}
EC>10-12	1%	74	250	13	16,000 (364) ^{sol}	5,000	9,200 (364) ^{sol}
EC>12-16	1%	140	1,800	23	36,000 (169) ^{sol}	5,100	10,000
EC>16-21	1%	260 ^f	1,900 ^f	46 ^f	28,000 ^f	3,800 ^f	7,600 ^f
EC>21-35	1%	1,100 ^f	1,900 ^f	370 ^f	28,000 ^f	3,800 ^f	7,800 ^f
EC>35-44	1%	1,100 ^f	1,900 ^f	370 ^f	28,000 ^f	3,800 ^f	7,800 ^f
Aromatic							
EC5-7(benzene as non-threshold)	2.5%	140	690	27	46,000 (2,260) ^{sol}	56,000	84,000 (2,260) ^{sol}
EC>7-8(toluene)	2.5%	290	1,800	51	110,000 (1,920) ^{sol}	56,000	95,000 (1,920) ^{sol}
EC>8-10	2.5%	83	110	21	8,100 (1,500) ^{vap}	5,000	8,500 (1,500) ^{vap}
EC>10-12	2.5%	180	590	31	28,000 (899) ^{sol}	5,000	9,700 (899) ^{sol}
EC>12-16	2.5%	330	2,300 (419) ^{sol}	57	37,000	5,100	10,000
EC>16-21	2.5%	540 ^f	1,900 ^f	110 ^f	28,000 ^f	3,800 ^f	7,700 ^f
EC>21-35	2.5%	1,500 ^f	1,900 ^f	820 ^f	28,000 ^f	3,800 ^f	7,800 ^f
EC>35-44	2.5%	1,500 ^f	1,900 ^f	820 ^f	28,000 ^f	3,800 ^f	7,800 ^f
Aromatic							
EC5-7(benzene as non-threshold)	6%	300	1,400	57	86,000 (4,710) ^{sol}	56,000	92,000 (4,710) ^{sol}
EC>7-8(toluene)	6%	660	3,900	120	180,000 (4,360) ^{vap}	56,000	100,000 (4,360) ^{vap}
EC>8-10	6%	190	270	51	17,000 (3,580) ^{vap}	5,000	9,300 (3,580) ^{vap}
EC>10-12	6%	380	1,200	74	34,000 (2,150) ^{sol}	5,000	10,000
EC>12-16	6%	660	2,500	130	38,000	5,100	10,000
EC>16-21	6%	930 ^f	1,900 ^f	260 ^f	28,000 ^f	3,800 ^f	7,800 ^f
EC>21-35	6%	1,700 ^f	1,900 ^f	1,600 ^f	28,000 ^f	3,800 ^f	7,900 ^f
EC>35-44	6%	1,700 ^f	1,900 ^f	1,600 ^f	28,000 ^f	3,800 ^f	7,900 ^f
Aliphatic +Aromatic >EC44	1%	1,600 ^f	1,900 ^f	1,200 ^f	28,000 ^f	3,800 ^f	7,800 ^f
	2.5%	1,800 ^f	1,900 ^f	2,100 ^f	28,000 ^f	3,800 ^f	7,800 ^f
	6%	1,900 ^f	1,900 ^f	3,000 ^f	28,000 ^f	3,800 ^f	7,900 ^f

NOTES

Sol / vap = solubility / vapour limit (potentially use if free product identified, although highly conservative).

f = oral, dermal and inhalation exposures compared to oral HCV.

All GAC are based on sandy loam soils with a pH 7.

All GAC are based on sandy loam soils with a pH 7.			LQM Generic Assessment Criteria (mg/kg) Dry weight soil					
Contaminant		SOM	Res +	Res -	Allot.	Comm.	POS _{resi}	POS _{park}
Chloalkanes and Alkenes & Explosives	1,2 Dichloroethane (DCA)	1%	7.1E-03	9.2E-03	4.6E-03	0.67	29	21
		2.5%	1.1E-02	1.3E-02	8.3E-03	0.97	29	24
		6%	1.9E-02	2.3E-02	1.6E-02	1.7	29	28
	1,1,1 Trichloroethane (TCA)	1%	8.8	9.0	48	660	140,000	57,000 (1,425) ^{vap}
		2.5%	18	18	110	1,300	140,000	76,000 (2,915) ^{vap}
		6%	39	40	240	3,000	140,000	100,000 (6,392) ^{vap}
	1,1,2,2-Tetrachloroethanes (PCA)	1%	1.6	3.9	0.41	270	1,400	1,800
		2.5%	3.4	8.0	0.89	550	1,400	2,100
		6%	7.5	17	2.0	1,100	1,400	2,300
	1,1,1,2-Tetrachloroethanes (PCA)	1%	1.2	1.5	0.79	110	1,400	1,500
		2.5%	2.8	3.5	1.9	250	1,400	1,800
		6%	6.4	8.2	4.4	560	1,400	2,100
	Tetrachloroethene (PCE)	1%	0.18	0.18	0.65	19	1,400	810 (424) ^{sol}
		2.5%	0.39	0.40	1.5	42	1,400	1,100 (951) ^{sol}
		6%	0.90	0.92	3.6	95	1,400	1,500
	Tetrachloromethane (carbon tetrachloride)	1%	2.6E-02	2.6E-02	0.45	2.9	890	190
		2.5%	5.6E-02	5.6E-02	1.0	6.3	920	270
		6%	0.13	0.13	2.4	14	950	400
	Trichloroethene (TCE)	1%	1.6E-02	1.7E-02	4.1E-02	1.2	120	70
		2.5%	3.4E-02	3.6E-02	9.1E-02	2.6	120	91
		6%	7.5E-02	8.0E-02	0.21	5.7	120	120
	Trichloromethane (chloroform)	1%	0.91	1.2	0.42	99	2,500	2,600
		2.5%	1.7	2.1	0.83	170	2,500	2,800
		6%	3.4	4.2	1.7	350	2,500	3,100
	Chloroethene (vinyl chloride)	1%	6.4E-04	7.7E-04	5.5E-04	5.9E-02	3.5	4.8
		2.5%	8.7E-04	1.0E-03	1.0E-03	7.7E-02	3.5	5.0
		6%	1.4E-03	1.5E-03	1.8E-03	0.12	3.5	5.4
	2,4,6-Trinitrotoluene (TNT)	1%	1.6	65	0.24	1,000	130	260
		2.5%	3.7	66	0.58	1,000	130	270
		6%	8.1	66	1.4	1,000	130	270
	RDX	1%	120	13,000	17	210,000	26,000	49,000 (18.7) ^{sol}
		2.5%	250	13,000	38	210,000	26,000	51,000
		6%	540	13,000	85	210,000	27,000	53,000
	HMX	1%	5.7	6,700	0.86	110,000	13,000	23,000 (0.35) ^{vap}
		2.5%	13	6,700	1.9	110,000	13,000	23,000 (0.39) ^{vap}
		6%	26	6,700	3.9	110,000	13,000	24,000 (0.48) ^{vap}
Pesticides	Aldrin	1%	5.7	7.3	3.2	170	18	30
		2.5%	6.6	7.4	6.1	170	18	31
		6%	7.1	7.5	9.8	170	18	31
	Dieldrin	1%	0.97	7.0	0.17	170	18	30
		2.5%	2.0	7.3	0.41	170	18	30
		6%	3.5	7.4	0.96	170	18	31
	Atrazine	1%	3.3	610	0.5	9,300	1,200	2,300
		2.5%	7.8	620	1.2	9,400	1,200	2,400
		6%	17.4	620	2.7	9,400	1,200	2,400
	Dichlorvos	1%	3.2E-02	6.4	4.9E-03	140	16	26
		2.5%	6.6E-02	6.5	1.0E-02	140	16	26
		6%	0.14	6.6	2.2E-02	140	16	27
	Endosulfanns (2 isomers)	1%	7.4	160 (3.0E-03) ^{vap}	1.2	5,600 (3.0E-03) ^{vap}	1,200	2,300
		2.5%	18	280 (7.0E-03) ^{vap}	2.9	7,400 (7.0E-03) ^{vap}	1,200	2,400
		6%	41	410 (1.6E-02) ^{vap}	6.8	8,400 (1.6E-02) ^{vap}	1,200	2,500
	Hexachlorocyclohexane (3 isomers), inc Lindane	1%	8.5E-02	3.7	1.3E-02	65	8.1	15
		2.5%	0.2	3.8	3.2E-02	65	8.1	15
		6%	0.46	3.8	7.7E-02	65	8.1	16

NOTES

Sol / vap = solubility / vapour limit (potentially use if free product identified, although highly conservative).

All GAC are based on
sandy loam soils with a pH
7.

All GAC are based on sandy loam soils with a pH 7.			LQM Generic Assessment Criteria (mg/kg) Dry weight soil					
Contaminant		SOM	Res +	Res -	Allot.	Comm.	POS _{resi}	POS _{park}
Chlorobenzenes	Chlorobenzene	1%	0.46	0.46	5.9	56	11,000	1,300 (675) ^{sol}
		2.5%	1.0	1.0	14	130	13,000	2,000 (1,520) ^{sol}
		6%	2.4	2.4	32	290	14,000	2,900
	Dichlorobenzenes (3 isomers)	1%	23	24	94	2,000 (571) ^{sol}	90,000	24,000 (571) ^{sol}
		2.5%	55	57	230	4,800 (1,370) ^{sol}	95,000	36,000 (1,370) ^{sol}
		6%	130	130	540	11,000 (3,240) ^{sol}	98,000	51,000 (3,270) ^{sol}
	Trichlorobenzenes (3 isomers)	1%	2.6	2.6	55	220	15,000	1,700 (318) ^{vap}
		2.5%	6.4	6.4	140	530	17,000	2,600 (786) ^{vap}
		6%	15	15	320	1,300	19,000	4,000 (1,880) ^{vap}
	Tetrachlorobenzenes (3 isomers)	1%	0.66	0.75	0.38	49 (39.4) ^{vap}	78	110 (39) ^{vap}
		2.5%	1.6	1.9	0.90	120 (98.1) ^{vap}	79	120
		6%	3.7	4.3	2.2	240 (235) ^{vap}	79	130
	Pentachlorobenzene	1%	5.8	19	1.2	640 (43.0) ^{sol}	100	190
		2.5%	12	30	3.1	770 (107) ^{sol}	100	190
		6%	22	38	7.0	830	100	190
	Hexachlorobenzene	1%	1.8 (0.20) ^{vap}	4.1 (0.20) ^{vap}	0.47	110 (0.20) ^{vap}	16	30
		2.5%	3.3 (0.50) ^{vap}	5.7 (0.50) ^{vap}	1.1	120	16	30
		6%	4.9	6.7 (1.2) ^{vap}	2.5	120	16	30
Chlorophenol	Chlorophenols (4 congeners)	1%	0.87 ^g	94	0.13 ^g	3,500	620	1,100
		2.5%	2.0	150	0.30	4,000	620	1,100
		6%	4.5	210	0.70	4,300	620	1,100
	Pentachlorophenol	1%	0.22	27 (16.4) ^{vap}	3.0E-02	400	60	110
		2.5%	0.52	29	8.0E-02	400	60	120
		6%	1.2	31	0.19	400	60	120
Others	Carbon Disulphide	1%	0.14	0.14	4.8	11	11,000	1,300
		2.5%	0.29	0.29	10	22	11,000	1,900
		6%	0.62	0.62	23	47	11,000	2,700
	Hexachlorobutadiene	1%	0.29	0.32	0.25	31	25	48
		2.5%	0.7	0.78	0.61	66	25	50
		6%	1.6	1.8	1.4	120	25	51
	Phenol	1%	280	750	66	760 ^{dir} (31,000)	760 ^{dir} (11,000)	760 ^{dir} (8,600)
		2.5%	550	1,300	140	1,500 ^{dir} (35,000)	1,500 ^{dir} (11,000)	1,500 ^{dir} (9,700)
		6%	1,100	2,300	280	3,200 ^{dir} (37,000)	3,200 ^{dir} (11,000)	3,200 ^{dir} (11,000)

NOTES

^{sol} / ^{vap} = solubility / vapour limit (potentially use if free product identified, although highly conservative).

^{dir} = S4uls based on threshold protective of direct skin contact with phenol (brackets long term exposure for illustration purposes).

^g = derived based on 2,3,4,6-tetrachlorophenol.