From: phil dean <Phil@wfst.co.uk>
Sent: 24 January 2019 21:53
To: Simon Ellis <simon.ellis@architect-ct.co.uk>
Cc: Neil Flynn <neilflynn@wfst.co.uk>
Subject: Re: JDW Rochdale Regal Moon

Hi Simon,


I have placed a picture below of the intended disabled evacuation from the garden area.

I have placed the refuge point in a position which would be guarded from radiant heat from any developing fire as the external walls and fire doors in this area would provide protection to the persons. This area is a minimum distance of 1.8m from any opening (this distance is used on external fire escapes as a safe distance from openable windows when escaping. I have used the same rationale here).

From here the staff will be able to gain access to the refuge from multiple areas and will be able to take the person in an alternative direction.

With this option it must be able to be completed at all material times the pub is in operation and the following put in place as part of the Personal Emergency Evacuation Plan (PEEP) for any visitor:

- Sufficient amount of people that are to be nominated and are available at all times to provide assistance.
- Manual handling risk assessment are to be completed in addition to JDW PEEP templates for this task and all information inserted into the PEEP so it can be communicated to the nominated staff so they understand the procedure to take.
- The plan must be tested to ensure it works and staff are able to lift and evacuate the person safely.

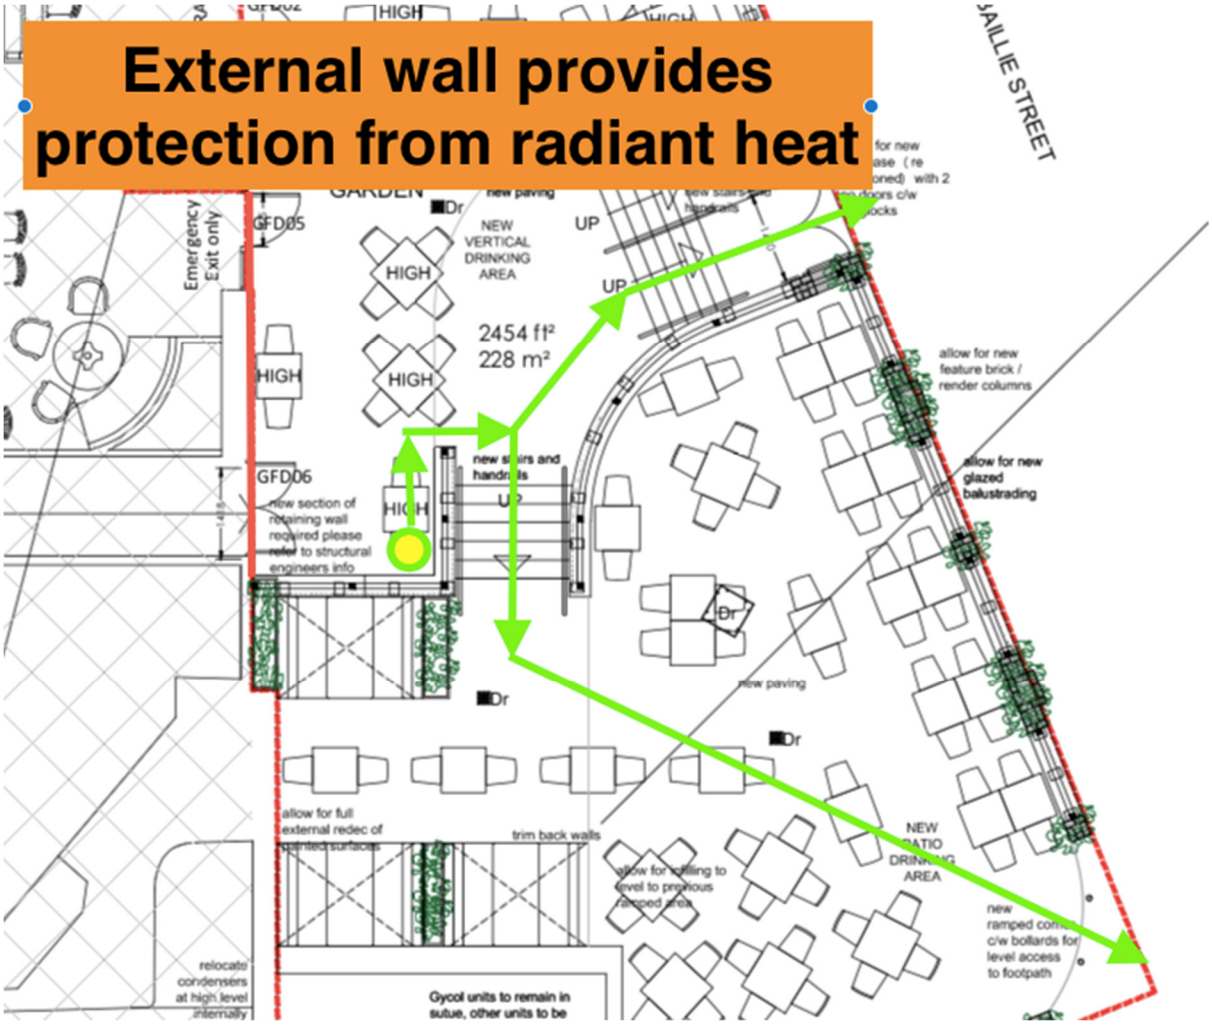

Kind Regards,

Philip Dean MIFireE MCMI MInstLM

Training and Development Director

WFST Ltd

m: 07956 00 36 59
t: 0800 6894 999
w: www.wfst.co.uk

CONFIDENTIALITY AND NON-DISCLOSURE NOTICE
This e-mail was sent on behalf of Workplace Fire & Safety Training Ltd. This e-mail and the information it

contains may be privileged and/or confidential. It is for the intended addressee(s) only. The unauthorised use, disclosure or copying of this e-mail or any information it contains, is prohibited and could, in certain circumstances be a criminal offence. If you are not the intended recipient please notify enquiries@wfst.co.uk immediately and delete this message from your system. Workplace Fire & Safety Training Ltd does not enter into any form of contract by means of Internet e-mail. The views expressed in this communication are specific to the sender and may not necessarily represent the views held by Workplace Fire & Safety Training Ltd.
Registered company number 8660475
VAT number 174549773
WARNING: Computer viruses can be transmitted by Email. The recipient should check this email and any attachments for the presence of viruses. Workplace Fire & Safety Training Ltd accepts no liability for any damage caused by any virus transmitted by this email.