

Acoustic assessment of proposed bar to nearby residential properties

854 Manchester Road, Castleton, Rochdale



Client: Patsy's Cocktail Bar

Report Reference: 240612-R001

Date: 9th July 2024

Revision:	Date:	Author:	Checked:
-	09/08/2024	Tommy Burn BSc (Hons) MIOA	Sam Message BSc (Hons) MIOA

This report has been prepared by ACA Acoustics Limited (ACA) with all reasonable skill, care, and diligence in accordance with generally accepted acoustic consultancy principles and taking account of the services and terms agreed between ACA and our client. Any information provided by third parties and referred to herein may not have been checked or verified by ACA unless expressly stated otherwise. Certain statements made in the report may constitute estimates or projections and even though these are based on reasonable assumptions and good industry practice, such forward-looking statements by their nature involve risks and uncertainties which could cause actual results to differ materially from the results predicted. ACA does not guarantee or warrant any estimate or projection contained in this report.

Note that consideration of non-acoustic aspects including, but not limited to structural calculations, compliance with Building Regulations and other statutory requirements, or any assessment of fire regulations are outside the scope of ACA Acoustics Limited and should be considered by others accordingly.

This report is confidential to the client and ACA accepts no responsibility whatsoever to third parties unless formally agreed by ACA. Any such party relies upon the report at their own risk. © 2024 ACA Acoustics Limited.

CONTENTS

0. SUMMARY	2
1. INTRODUCTION	3
2. ACOUSTIC CRITERIA	3
2.1. Operational Noise Breakout	3
3. REVIEW OF SITE LOCATION & DEVELOPMENT PROPOSALS	4
4. SOUND LEVEL SURVEY	5
5. ASSESSMENT OF OPERATIONAL NOISE TO NEARBY PROPERTIES	7
5.1. Source Sound Levels	7
5.2. Acoustic Assessment of Operational Noise Transmission through the external façade	8
6. Acoustic Mitigation Treatments	9
6.1. Façade acoustic treatments	9
6.2. Door Lobbies	9
6.3. Music Volume Limiter	10
7. CONCLUSION.....	10

0. SUMMARY

- 0.1. ACA Acoustics Limited have been commissioned to assess the acoustic impact of the proposed conversion of a commercial unit to a new bar at 854 Manchester Road, Castleton, Rochdale.
- 0.2. The assessment is required to provide evidence that noise emissions from the new bar will not be detrimental to the amenity of nearby residents and complies with relevant criteria.
- 0.3. To protect the amenity of residents of nearby habitable properties, ACA Acoustics recommends that noise emissions from the bar should be controlled such that the LAeq does not exceed the measured background sound levels and with low frequencies in the L10 indices not exceeding the corresponding L90 background values, outside the nearby properties.
- 0.4. Nearby residential properties on Manchester Road overlook the front façade of the development site, and properties on Charlton Street overlook the rear of the site.
- 0.5. A background sound level survey has been carried out over a 24-hour period on the 4th – 5th July 2024. Whilst on site the author considered the sound climate primarily consists of traffic activity from nearby routes.
- 0.6. Source sound levels have been measured within various similar venues to establish likely internal levels when trading. Typical sound levels within the bar are anticipated to not exceed LAeq 94dB during a busy weekend evening period, and maximum permissible music levels within the venue have been suggested in this report.
- 0.7. A computer model has been used to calculate operational sound transmission via the shopfront to outside nearby residential properties close to the development site. A scheme of mitigation measures has been designed to ensure noise emissions comply with the recommended criteria. This will provide a good level of amenity to residents of nearby properties and no further noise mitigation is required.

1. INTRODUCTION

ACA Acoustics Limited has been commissioned to carry out an assessment of noise emissions from a proposed conversion of a commercial unit to a bar at 854 Manchester Road, Castleton, Rochdale. The assessment considers operational noise (patrons and music) from the bar to nearby residential properties.

The objective of the assessment is to determine the impact the proposed use would have on nearby residential properties, and where necessary to make recommendation for suitable noise mitigation treatments.

This report presents results of the sound level surveys and assessment.

2. ACOUSTIC CRITERIA

2.1. Operational Noise Breakout

In March 2003, the Institute of Acoustics (IOA) published a *Good Practice Guide on the Control of Noise from Pubs and Clubs*. The guide is a useful document; however, it does not provide objective noise criteria or measurement procedures for assessment of entertainment noise. To address this, a working group of the IOA has produced a working draft annex on criteria and measurement guidelines which includes suggested numerical criteria for music emissions.

Paragraph A2.3 of the draft annex recommends that for sites where entertainment (music) takes place more than once per week and continues beyond 23:00 hours,

“Criteria applicable for both external and internal assessments at noise-sensitive properties:

- The LAeq of the entertainment noise should not exceed the representative background noise level LA90 (without entertainment noise), and*
- The L10 of the entertainment noise should not exceed the representative background noise level L90 (without entertainment noise) in any 1/3rd octave band between 40Hz and 160Hz.*

If the above criteria are met entertainment noise will be virtually inaudible inside noise-sensitive property.”

3. REVIEW OF SITE LOCATION & DEVELOPMENT PROPOSALS

An existing commercial unit is being redeveloped at 854 Manchester Road, Castleton, Rochdale into a new bar. The unit incorporates ground, first, and second (loft) spaces.

The client has advised that amplified music with DJs will be played. The development unit has no adjoining noise sensitive residential properties. There are existing residential properties to the front of the site overlooking Manchester Road, and also to the rear of the site on Charlton Street.

The bar will operate until 23:00 hours.

Drawings provided by the client are shown in Figure 1 below. The venue will incorporate music at all levels, with no music to be played externally.



Figure 1: Proposed ground floor layout

Location of the nearest residential properties and sound level survey position are shown in Figure 2 below.



Figure 2: Development site, survey location, and nearest residential properties

4. SOUND LEVEL SURVEY

To assess the impact of the proposed bar, a background sound level survey has been conducted at the development site to determine ambient sound levels in the vicinity of nearby residential properties.

The sound level survey was carried out over a 24-hour period between the 4th – 5th July 2024. The survey was carried out using two microphones on pole arrangements extended out of first floor windows of the development site to the front and rear of the site. Sound levels will be representative of those experienced at the windows of the nearby residential properties.

The following equipment was used during the survey; the sound level meter was calibrated before the survey and checked after with no deviation noted.

Equipment	Serial Number
NTi Audio Class 1 sound level meter type XL2-TA complete with weatherproof and lockable outdoor environmental kit	A2A-10964-E0
Svantek Class 1 sound level meter type SVAN971A, complete with MOLES weatherproof and lockable outdoor environmental kit	121131
Svantek calibrator type SV33B. Compliant to IEC 60942-1:2003	83826

Table 1: Equipment used during the sound level survey

Weather conditions during the sound level survey were cool and remained dry and calm throughout the survey.

Results of the survey in terms of raw data are shown in Figure 3 and Figure 4 below.

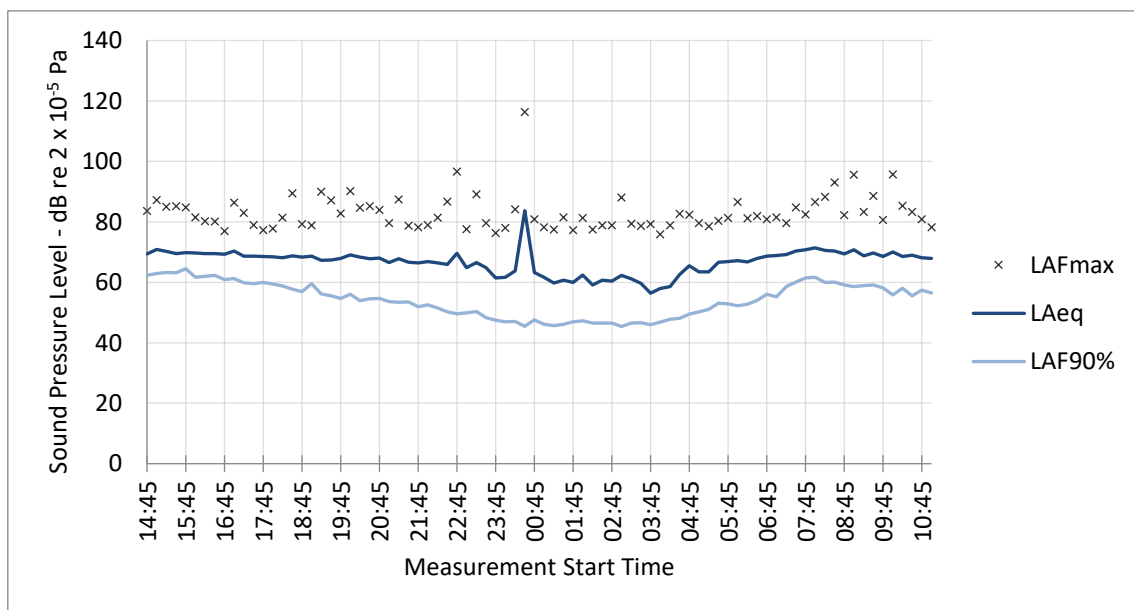


Figure 3: Sound level survey results to the front façade

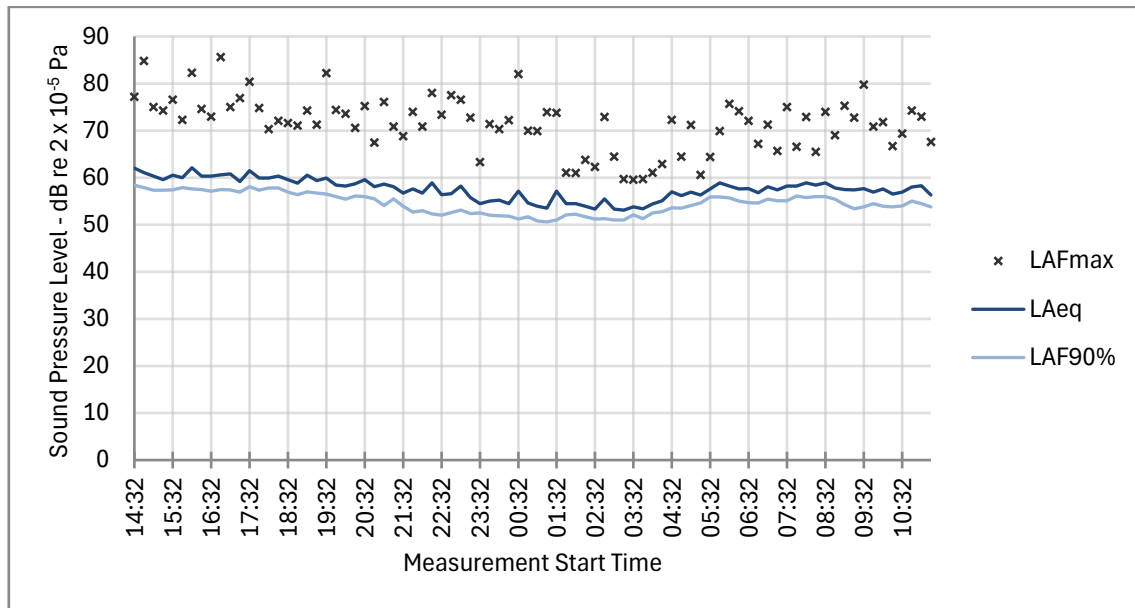


Figure 4: Sound level survey results to the rear facade

Summary of the measured sound level results during the latest proposed opening hours of 11:45 – 00:00 for the LAeq and 23:00 – 00:00 for the LA90 are shown in tabular form in Table 2.

Assessment location	22:00 – 00:00 hours LAeq	22:00 – 00:00 hours LA90	22:00 – 00:00 hours L90	
			63Hz	125Hz
Front façade, Manchester Road	67 dB	51 dB	52	48
Rear façade, Charlton Street	57 dB	52 dB	50	49

Table 2: Summary measured sound level survey results

5. ASSESSMENT OF OPERATIONAL NOISE TO NEARBY PROPERTIES

5.1. Source Sound Levels

To calculate the potential impact of the proposed development it is necessary to establish typical sound levels within the new bar once it is trading; this is the source sound level data.

Sound levels have been recorded in a number of similar venues for previous projects. Spectra used in the assessment equates to an overall sound level of LAeq 94dB. This is representative of the internal sound level within a similar venue on a busy weekend evening, with a DJ playing. The

measurement includes the venue at full capacity with patrons talking and laughing simultaneously and amplified music.

Confirmation of the source sound level data used in the assessment is shown in Table 3 below.

Description	Metric	Octave Band Frequency (Hz) – LAeq (dB)								dBA
		63	125	250	500	1k	2k	4k	8k	
Anticipated sound levels within the venue	Leq	87	97	94	92	89	81	77	73	94
	L10	91	99	99	94	92	82	79	76	96

Table 3: Measured source sound levels inside similar venues

5.2. Acoustic Assessment of Operational Noise Transmission through the external façade

A computer model has been used to calculate sound transmission via the shopfront to within the nearby residential properties. The model assumes windows closed, and uses the methodology of BS EN 12354-4:2000 to predict the transmission of indoor sound to outside and then the environmental corrections of ISO 9613-2:1996 to account for the distance from the shopfront to the residential windows, acoustic reflections, and acoustic screening.

The assessment includes an additional secondary glazed unit behind the existing windows as detailed in Section 6.

Summary of calculated sound emissions via the shopfront to outside the residential windows are shown in the table below.

Operational Usage	Internal Sound Level within the bar	Calculated sound level outside residential windows	Criteria
Calculated sound level to properties at the front façade on Manchester Road	LAeq 94dB L10 63Hz: 91dB L10 125Hz: 99dB	LAeq 35dB L10 63Hz: 44dB L10 125Hz: 47dB	LAeq ≤51dB L10 63Hz: ≤52dB L10 125Hz: ≤48dB
Calculated sound level to properties at the rear façade on Charlton Street		LAeq 27dB L10 63Hz: 34dB L10 125Hz: 40dB	LAeq ≤52dB L10 63Hz: ≤50dB L10 125Hz: ≤49dB

Table 4: Summary of calculated sound emissions via the openable shopfront to outside noise-sensitive properties

The assessment includes façade elements as shown in Table 5 below.

Description	Construction	Sound insulation performance
External façade	Brick-cavity-brick construction	Rw (+Ctr) 54(-6)dB
Glazing	Secondary glazing installed behind existing glazing	Rw (+Ctr) 39(-5)dB
Roof	Tile/slate roof with 25mm (2 no. layers 12.5mm) soundbloc plasterboard ceiling and high density rockwool insulation in the cavity	Rw (+Ctr) 46(-7)dB

Table 5: Façade elements included within the assessment

The current installed glazing specification is unknown, however in order to achieve the recommended sound levels to the nearest residential properties it is recommended that the glazing to both front and rear façades are upgraded to incorporate secondary glazing to the rear of the existing glazing. In addition the roof/ceiling structure should incorporate the construction shown in Table 5.

With benefit of noise control treatments as shown in Section 6, calculated sound levels will achieve the required criteria.

6. Acoustic Mitigation Treatments

6.1. Façade acoustic treatments

As per Table 5 above, it is recommended that secondary glazed panes are installed to the rear of the existing glazing. In addition, the existing roof and ceiling structure should be upgraded to match the performance shown in Table 5

6.2. Door Lobbies

In order to ensure sound levels from venue are minimised when patrons are entering and leaving it is recommended that a door lobby is installed to the front and rear external doors. It is recommended that the lobbies incorporate acoustically absorptive finishes.

Doors should be on closers to ensure that they cannot be left open and should incorporate acoustic P or O type seals.

6.3. Music Volume Limiter

The music system should be a modern networked system such as Soundweb or incorporate a separate volume limiter. This allows the maximum music volume to be set and locked, which cannot be overridden by staff. A suitable limiter will include a graphic equaliser, allowing individual frequencies to be set at the required level such that internal sound levels in Table 3 aren't exceeded.

ACA Acoustics would be able to attend site once the system is installed and set the limiter to a level at which sound levels to the nearest residential properties achieve the requirements of the local authority. Once the system has been installed then should any small excess remain above the criteria at the nearest residential windows then the music volume limiter may be used to mitigate this accordingly.

Where appropriate the music volume limiter would be set in conjunction with the sound engineer, and ACA Acoustics. Music would be played in the venue while noise monitoring and subjective listening is undertaken in the residential rooms above to confirm an acceptable level has been achieved.

7. CONCLUSION

ACA Acoustics have assessed operational noise breakout of a proposed bar at 854 Manchester Road, Castleton, Rochdale.

Sound transmission is below the existing background sound levels and will not be detrimental the amenity of nearby residential properties. It is recommended that planning consent may be granted for the development and no further mitigation measures are required.

