
Noise Impact Assessment

Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Client: GLP Trows LLP & BDW Trading Ltd

Reference: 21.105.1.R6

Issue Date: 27th November 2024



Reference: 21.105.1.R6
Date: 27th November 2024
Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Report Version	2	3	4	5	6
Prepared by	John Goodwin	John Goodwin	Martyn Parker	Martyn Parker	Martyn Parker
Position	Director	Director	Senior Acoustic Consultant	Senior Acoustic Consultant	Principal Acoustic Consultant
Reviewed by	Martyn Parker	Martyn Parker	John Goodwin	John Goodwin	John Goodwin
Position	Senior Acoustic Consultant	Senior Acoustic Consultant	Director	Director	Director
Issue Date	7 th August 2021	11 th July 2022	12 th August 2022	6 th June 2024	27th November 2024
Comments	-	-	-	-	-

Professional Consult Limited

hello@professionalconsult.co.uk

07704 672683

www.professionalconsult.co.uk

This report has been prepared by Professional Consult Limited in accordance with the agreed terms and conditions of the appointment. Professional Consult Limited cannot accept any responsibility for use of, or reliance on, the contents of this report by any third party.

Professional Consult Limited is registered in England (11635570). Registered Office: 534 Edenfield Road, Rochdale, Lancashire OL12 7QJ

EXECUTIVE SUMMARY

This Assessment has been undertaken to identify the key sources of noise surrounding the Site which may adversely impact upon the proposed residential amenity. Accordingly, this Assessment has been completed with due regard to the National Planning Policy Framework and its associated National Planning Policy Guidance in addition to appropriate British Standards and guidance documents relevant to the assessment of noise impacts.

Since the original report comments have been received from the EHO at Rochdale Borough Council stating that the garden areas should not be exposed to noise levels of greater than 58dB $L_{Aeq\ 16hr}$. As such, the layout has been re designed in order to ensure that good acoustic design has been implemented across the scheme specifically for the eastern and south eastern areas of the Site which were previously exposed to noise levels above 58dB $L_{Aeq\ 16hr}$.

With regards to garden areas of proposed dwellings, this Assessment has shown that following noise mitigation, resultant noise levels will achieve the 58dB $L_{Aeq\ 16hr}$ criteria, this is due to the good acoustic design implemented for the scheme.

During the various visits to the Site, there was no audible commercial noise associated with the commercial use to the north of the Site and these uses were observed to be operational at the time of the noise surveys.

With regards to internal noise levels, this Assessment has shown that noise levels in living rooms can meet the internal noise criteria limits provided in BS8233:2014 provided that the appropriate noise mitigation measures for upgraded glazing and alternative ventilation as detailed in this Assessment are adhered to. With regards to noise levels in bedrooms during the night-time period, this Assessment has shown that various Plots will require upgraded glazing and alternative ventilation.

Should the recommended noise mitigation measures be implemented in order to control external noise levels for gardens and internal noise levels in habitable rooms, then the sound climate which future occupiers of the Development will be exposed to will accord with the 'No Observed Adverse Effect Level' as detailed in the PPG and as such, noise should not be deemed to be a determining factor in the granting of planning permission for this Site.

TABLE OF CONTENTS

1	INTRODUCTION	5
2	POLICY & GUIDANCE	6
3	NOISE SURVEYS	14
4	NOISE IMPACT ASSESSMENT	16
5	MITIGATION	18
6	CONCLUSION	20
APPENDIX 1:	LIMITATIONS	21
APPENDIX 2:	GLOSSARY OF ACOUSTIC TERMINOLOGY	22
APPENDIX 3:	NOISE MEASUREMENT POSITIONS	24
APPENDIX 4:	DAYTIME GRID NOISE MAP	25
APPENDIX 5:	NIGHT-TIME GRID NOISE MAP	26
APPENDIX 6:	DAYTIME GRID NOISE MAP – WITH NOISE MITIGATION	27
APPENDIX 7:	MEASURED ROAD TRAFFIC LEVELS – NMP1	28
APPENDIX 8:	MEASURED ROAD TRAFFIC LEVELS – NMP2	29
APPENDIX 9:	DAYTIME FAÇADE NOISE LEVELS	30
APPENDIX 10:	NIGHT-TIME FAÇADE NOISE LEVELS	62
APPENDIX 11:	EXAMPLE ALTERNATIVE VENTILATION SYSTEMS	1
APPENDIX 12:	EXAMPLE SAINT GOBAIN THERMAL GLAZING SOUND REDUCTION SPECIFICATIONS	2

1 INTRODUCTION

1.1 Appointment

- 1.1.1 Professional Consult Limited was instructed by GLP Trows LLP and BDW Trading Ltd ('the Applicant'), to prepare a Noise Impact Assessment ('the Assessment') for a proposed residential development ('the Development') on a parcel of land located at land south of Cowm Top Lane in Castleton, Rochdale OL11 to be referred to hereafter as 'the Site'.

1.2 The Development

- 1.2.1 It is understood that proposals include for the development of up to 445 residential dwellings and associated works.

1.3 Site & Locality

- 1.3.1 The Site will form an extension of the existing residential development located to the west off Leander Drive. To the north of the Site lies a number of commercial uses and to the east and south lies the A627(M) and M62 motorways.

1.4 Purpose of Assessment

- 1.4.1 This Assessment has been undertaken to identify the key sources of noise surrounding the Site which may adversely impact upon the proposed residential amenity. Accordingly, this Assessment has been completed with due regard to the National Planning Policy Framework and its associated National Planning Policy Guidance in addition to appropriate British Standards and guidance documents relevant to the assessment of noise impacts.

1.5 Limitations

- 1.5.1 The limitations of this report are presented in Appendix 1.
- 1.5.2 All acronyms used within this report are defined in the Glossary presented in Appendix 2.

1.6 Confidentiality

- 1.6.1 Professional Consult has prepared this report solely for the use of the Client. Should any third party wish to use or rely upon the contents of the report, written approval must be sought from Professional Consult; a charge may be levied against such approval.

2 POLICY & GUIDANCE

2.1 National Planning Policy Framework & National Planning Practice Guidance

2.1.1 The Government updated the National Planning Policy Framework (NPPF) on 20th December 2023 and its associated National Planning Practice Guidance (NPPG) on 20th November 2023. Together, the NPPF and NPPG set out what the Government expects of local authorities. The overall aim is to ensure the planning system allows land to be used for new homes and jobs, while protecting valuable natural and historic environments.

2.1.2

2.1.3 The NPPG adds further context to the NPPF and it is intended that the two documents should be read together.

2.1.4 Noise needs to be considered when new developments may create additional noise and when new developments would be sensitive to the prevailing acoustic environment. When preparing local or neighbourhood plans, or taking decisions about new development, there may also be opportunities to consider improvements to the acoustic environment.

2.1.5 Local planning authorities' plan-making and decision making should take account of the acoustic environment and in doing so consider:

② Whether or not a significant adverse effect is occurring or likely to occur;

② Whether or not an adverse effect is occurring or likely to occur; and

② Whether or not a good standard of amenity can be achieved.

2.1.6 In line with the Explanatory Note of the Noise Policy Statement for England, this would include identifying whether the overall effect of the noise exposure (including the impact during the construction phase wherever applicable) is, or would be, above or below the significant observed adverse effect level and the lowest observed adverse effect level for the given situation.

2.1.7 The Observed Effect Levels are as follows:

② Significant observed adverse effect level: This is the level of noise exposure above which significant adverse effects on health and quality of life occur;

② Lowest observed adverse effect level: this is the level of noise exposure above which adverse effects on health and quality of life can be detected; and

② No observed effect level: this is the level of noise exposure below which no effect at all on health or quality of life can be detected.

2.1.8 Table 1 summarises the noise exposure hierarchy, based on the likely average response.

Table 1. Noise Exposure Hierarchy

Perception	Examples of Outcomes	Increasing Effect Level	Action
Not Noticeable	No Effect	No Observed Effect	No specific measures required
Noticeable and not intrusive	Noise can be heard but does not cause any change in behaviour or attitude. Can slightly affect the acoustic character of the area but not such that there is a perceived change in the quality of life.	No Observed Adverse Effect	No specific measures required
<i>Lowest Observed Adverse Effect Level</i>			
Noticeable and intrusive	Noise can be heard and causes small changes in behaviour and/or attitude, e.g. turning up volume of television; speaking more loudly; where there is no alternative ventilation, having to close windows for some of the time because of the noise. Potential for some reported sleep disturbance. Affects the acoustic character of the area such that there is a perceived change in the quality of life.	Observed Adverse Effect	Mitigate and reduce to a minimum
<i>Significant Observed Adverse Effect Level</i>			
Noticeable and disruptive	The noise causes a material change in behaviour and/or attitude, e.g. avoiding certain activities during periods of intrusion; where there is no alternative ventilation, having to keep windows closed most of the time because of the noise. Potential for sleep disturbance resulting in difficulty in getting to sleep, premature awakening and difficulty in getting back to sleep. Quality of life diminished due to change in acoustic character of the area.	Significant Observed Effect	Avoid
Noticeable and very disruptive	Extensive and regular changes in behaviour and/or an inability to mitigate effect of noise leading to psychological stress or physiological effects, e.g. regular sleep deprivation/awakening; loss of appetite, significant, medically definable harm, e.g. auditory and non-auditory	Unacceptable Adverse Effect	Prevent

2.1.9 The subjective nature of noise means that there is not a simple relationship between noise levels and the impact on those affected. This will depend on how various factors combine in any particular situation.

2.1.10 These factors include:

- ② The source and absolute level of the noise together with the time of day it occurs. Some types and level of noise will cause a greater adverse effect at night than if they occurred during the day - this is because people tend to be more sensitive to noise at night as they are trying to sleep. The adverse effect can also be greater simply because there is less background noise at night;
- ② For non-continuous sources of noise, the number of noise events, and the frequency and pattern of occurrence of the noise;
- ② the spectral content of the noise and the general character of the noise. The local topology and topography should also be taken into account along with the existing and, where appropriate, the planned character of the area.

2.1.11 More specific factors to consider when relevant:

- ② where applicable, the cumulative impacts of more than one source should be taken into account along with the extent to which the source of noise is intermittent and of limited duration;

- Consideration should also be given to whether adverse internal effects can be completely removed by closing windows and, in the case of new residential development, if the proposed mitigation relies on windows being kept closed most of the time. In both cases a suitable alternative means of ventilation is likely to be necessary. Further information on ventilation can be found in the Building Regulations; and
- If external amenity spaces are an intrinsic part of the overall design, the acoustic environment of those spaces should be considered so that they can be enjoyed as intended.

2.2 BS8233:2014 ‘Guidance on sound insulation and noise reduction for buildings’

Noise Criteria Limits

- 2.2.1 The scope of this standard is the provision of recommendations for the control of noise in and around buildings. It suggests appropriate criteria and limits for different situations, which are primarily intended to guide the design of new buildings or refurbished buildings undergoing a change of use, rather than to assess the effect of changes in the external noise climate.
- 2.2.2 The standard suggests suitable internal noise levels within different types of buildings, including dwellings, as shown in Table 2.

Table 2. BS8233:2014 Internal Target Noise Levels

Criterion	Typical Situation	Design $L_{Aeq,T}$ (dB)
Suitable resting / sleeping conditions	Living Room	35
	Bedroom*	30
*For a Reasonable standard in bedrooms at night, individual noise events (measured with fast time weighting) should not exceed 45dB L_{max}		

- 2.2.3 BS8233 goes on to recommend noise levels for gardens as follows:
- “It is desirable that the external noise level does not exceed 50dB $L_{Aeq,T}$, with an upper guideline value of 55dB $L_{Aeq,T}$ which would be acceptable in noisier environments. However, it is also recognised that these guideline values are not achievable in all circumstances where development might be desirable. In higher noise areas, such as city centres or urban areas adjoining the strategic transport network, a compromise between elevated noise levels and other factors might be warranted”.*
- 2.2.4 BS8233 goes on to say:
- “In such a situation, development should be designed to achieve the lowest practicable levels in these external amenity spaces but should not be prohibited”.*
- 2.2.5 With regards to external noise within balcony areas, BS8233: 2014 provides the following advice:
- “Other locations, such as balconies, roof gardens and terraces, are also important in residential buildings where normal external amenity space might be limited or not available, i.e. in flats, apartment blocks, etc. In these locations, specification of noise limits is not necessarily appropriate. Small balconies may be included for uses such as drying washing or growing pot plants, and noise limits should not be necessary*

for these uses. However, the general guidance on noise in amenity space is still appropriate for larger balconies, roof gardens and terraces, which might be intended to be used for relaxation. In high-noise areas, consideration should be given to protecting these areas by screening or building design to achieve the lowest practicable levels”

Ventilation Requirements

- 2.2.6 Where a partially open window cannot be relied upon to provide an adequate level of facade sound insulation performance, it is necessary to consider alternative ventilation for habitable rooms. Section 8.4.5.4 within BS8233 states:

“The Building Regulations’ supporting documents on ventilation [48, 49, 50] recommend that habitable rooms in dwellings have background ventilation. Where openable windows cannot be relied upon for this ventilation, trickle ventilators can be used and sound attenuating types are available. However, windows may remain openable for rapid or purge ventilation, or at the occupant’s choice.


Alternatively, acoustic ventilation units (see 7.7.2 below) are available for insertion in external walls. These can provide sound reduction comparable with double glazed windows. However, ducted systems with intakes on the quiet side of the building might be required in very noisy situations, or where appearance rules out through-the-wall fans.”

Section 7.7.2 states:

“NOTE 5 If relying on closed windows to meet the guide values, there needs to be an appropriate alternative ventilation that does not compromise the façade insulation or the resulting noise level.”

2.3 INSTITUTE OF ACOUSTICS AND ASSOCIATION OF NOISE CONSULTANTS (2020) ACOUSTICS VENTILATION & OVERHEATING: RESIDENTIAL DESIGN GUIDE

2.3.1 The Acoustics Ventilation and Overheating (AVO) Residential Design Guide provides an approach as to how the competing aspects of thermal and acoustic comfort can be managed. The AVO Guide aims to assist designers to adopt an integrated approach to the acoustic design within the context of the ventilation and thermal comfort requirements. The AVO Guide provides a method for assessing the impact of opening windows and providing whole house ventilation due to the impact of noise via a two-level noise assessment procedure, as below:

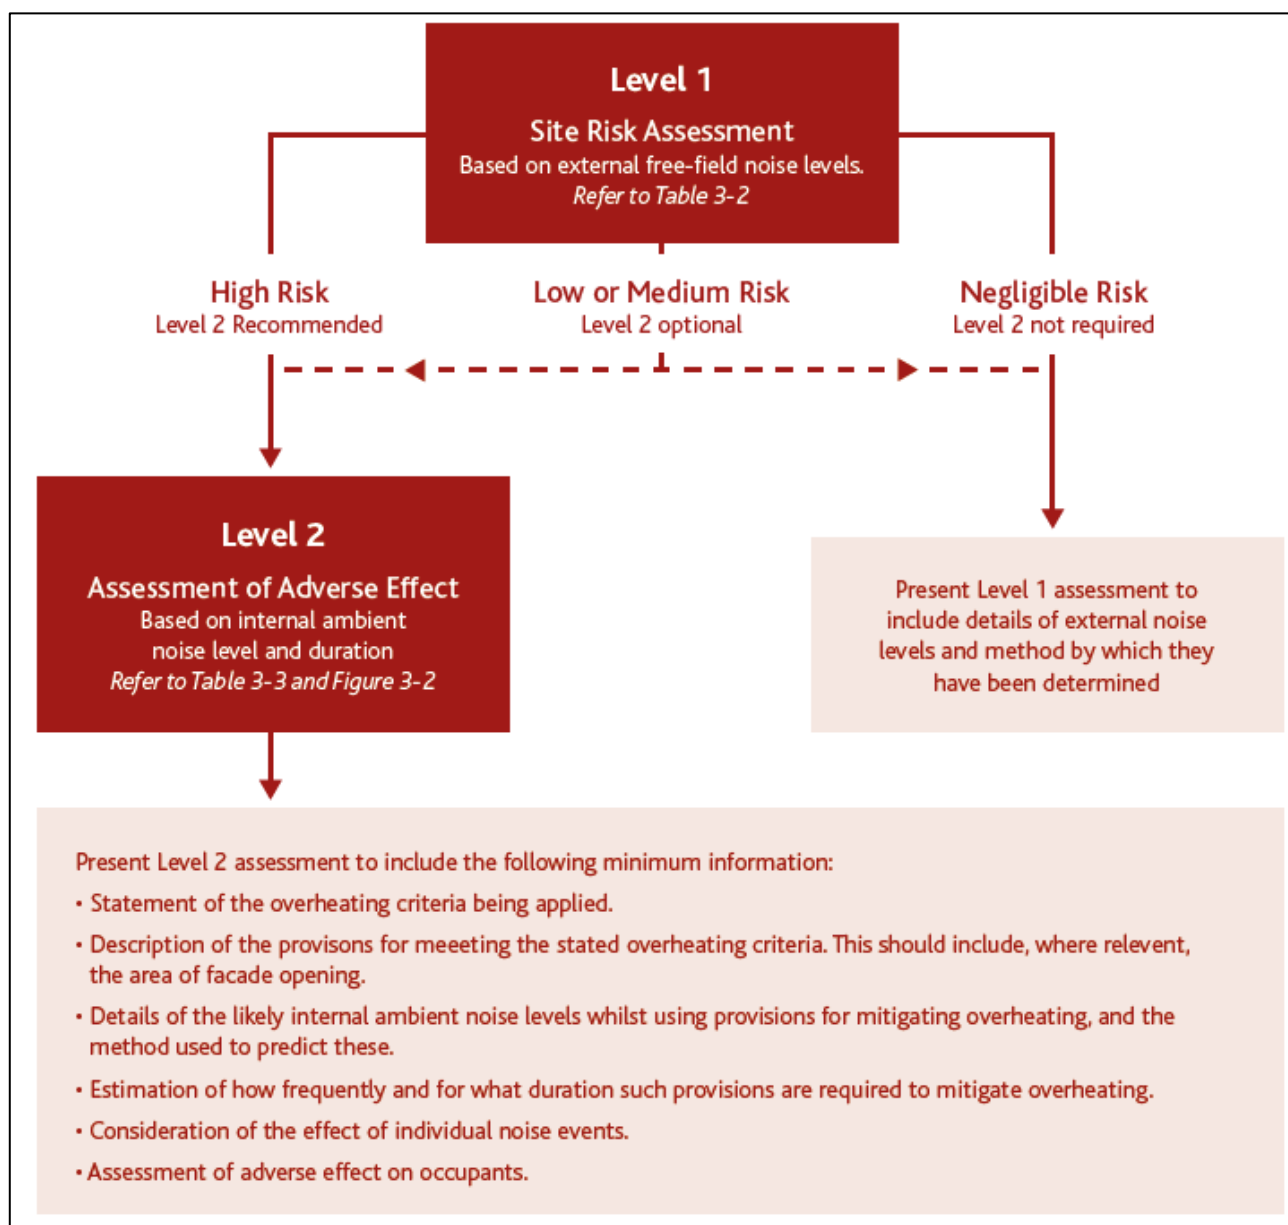

2.3.2 A level 1 risk assessment is based on external free-field noise levels with the assumption of a partially opened window in use for mitigation of overheating. A level 1 assessment is appropriate for scenarios where the risk to a development is deemed 'Negligible'. 'Low' and 'Medium' risk sites only require a level 2 assessment on an optional basis in order to give further confidence in the suitability of internal noise conditions.

2.3.3 The noise levels suggested in Tables 3 and 4 assume steady road traffic noise source but can be adapted for other transport sources.

Table 3. Guidance for Level 1 Site Risk Assessment for Transportation Noise Sources Relating to Overheating Condition


Risk Category for Level 1 Assessment - External		Risk Level	Potential Effect Without Mitigation	Recommendation for Level 2 Assessment
Daytime Noise Level, $L_{Aeq,t}$ (07:00 – 23:00)	Night-time Noise Level, $L_{Aeq,t}$ (23:00 – 07:00)			
$\geq 65\text{dB}$	$\geq 55\text{dB}$	High	Increasing risk of adverse effect	Recommended
$>55\text{dB}$ & $<63\text{dB}$	>45 & $<55\text{dB}$	Medium		Optional
$>50\text{dB}$ & $<55\text{dB}$		Low		
$\leq 50\text{dB}$	$\leq 45\text{dB}$	Negligible	Use of opening windows as means of mitigating overheating is not likely to result in in adverse effect	Not required

2.3.4 A level 2 assessment will be carried out when the risk of adverse effect is 'High' or it is deemed appropriate for a 'low' or 'medium' risk site. An increase in internal ambient noise level can cause a change in human behaviour. At high levels this creates situations where occupants can no longer open windows for ventilation due to high external noise levels. A level 2 assessment identifies these situations and allows for appropriate alternative ventilation systems to be recommended.

Table 4. Guidance for Level 2 Assessment of Noise from Transport Noise Sources Relating to Overheating Condition

Internal Ambient Noise Level			Example of Outcome
Daytime $L_{Aeq,t}$ (07:00 – 23:00)	Night-time $L_{Aeq,t}$ (23:00 – 07:00)	Individual Noise Events During 23:00 – 07:00	
$>50\text{dB}$	$>42\text{dB}$	Normally exceeds 65dB $L_{A_{f,max}}$	Noise causes a material change in behaviour eg. having to keep windows closed most of the time
Increasing noise level			Increasing the likelihood of impact on reliable speech communication during the daytime or sleep disturbance at night

2.3.5 The Table below details guideline external free-field noise limits and determines the appropriate AD-F ventilation system (Systems 1 – 4).

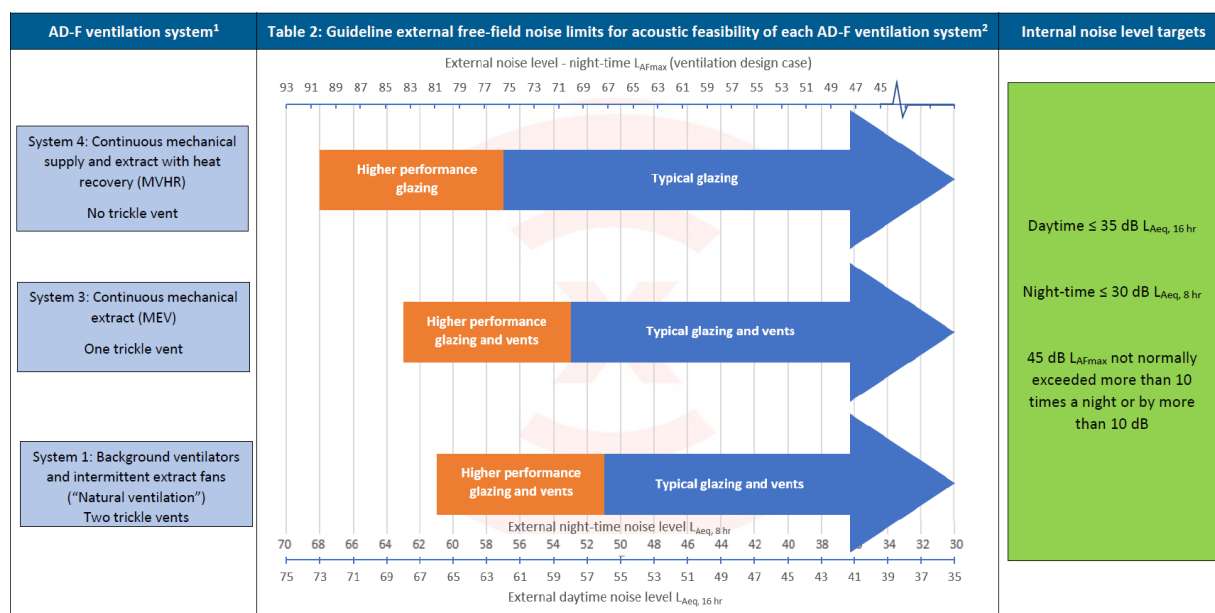

2.3.6 This approved document supports Part O of Schedule 1 to the Building Regulations 2010 and took effect on 15th June 2022 for use in England.

2.3.7 Section 3 of the approved document details the requirements for noise ingress into a bedroom and states the following:

'In locations where external noise may be an issue (for example, where the local planning authority considered external noise to be an issue at the planning stage), the overheating mitigation strategy should take account of the likelihood that windows will be closed during sleeping hours (11pm to 7am).

Windows are likely to be closed during sleeping hours if noise within bedrooms exceeds the following limits.

- a. 40dB $L_{Aeq,T}$ averaged over 8 hours (between 11pm and 7am); and
- b. 55dB L_{Amax} more than 10 times a night (between 11pm and 7am).'

2.3.8 The above internal noise criteria levels are higher than those presented in BS8233:2014 and so the trigger point for alternative ventilation for bedrooms, where required, will be dictated primarily by the assessment which considers compliance with the BS8233:2014 internal noise criteria levels. Nevertheless, compliance with the above noise criteria levels will be observed where the internal average and maximum noise levels with a partially open window, or where recommended appropriate alternative ventilation for the bedroom, results in noise levels not exceeding the above noise criteria levels.

2.3.9 With regards to windows being opened, BS8233:2014 refers to a partially open window and so for the purposes of AD-O and Standard Assessment Procedure (SAP) calculations a 'partially open' window should be taken as being 'fully open' for SAP calculations.

2.4 Rochdale Metropolitan Borough Council's Environmental Health Department

2.4.1 Professional Consult issued the following consultation to Rochdale Metropolitan Borough Council on 13th July 2021:

'We have been appointed by a client to complete a Noise Impact Assessment for a proposed residential development on a parcel of land at Trows Fram in Castleton, Rochdale. The Site is bound by the M62 to the south and the A627(M) to the east with commercial uses to the north.

The Site has recently been subject to a Noise Constraints Assessment by a third party which advised the client of good acoustic design for the residential dwellings in order to ensure that noise levels in gardens are as low as practically possible and this has been borne in mind with the indicative draft layout for the scheme.

We are currently completing noise surveys across the Site for the M62, A627(M) and the commercial uses.

We will complete a Noise Impact Assessment for the Site using Cadna-A noise modelling software and the Assessment will adhere to the following noise criteria limits:

Noise Levels in Habitable Rooms: We will ensure that noise levels in living rooms and bedrooms do not exceed 35dB $L_{Aeq,16hr}$ and 30dB $L_{Aeq,8hr}$ /45dB $L_{Amax,f}$ respectively; and

Noise Levels in Garden Area: We will aim to achieve the lowest practicable noise levels in garden areas which accords with the design advice provided in BS8233:2014 which states:

‘A compromise between elevated noise levels and other factors, such as the convenience of living in these locations or making efficient use of land resources to ensure development needs can be met, might be warranted. In such a situation, development should be designed to achieve the lowest practicable levels in these external amenity spaces, but should not be prohibited.’

Please note that this design principle accords with that adopted for the nearby residential development adjacent to the M62 which was granted planning approval by Rochdale MBC some years ago:

15/00826/FUL | Residential development - 259 dwellings

Wherever possible we will look to specify acoustic fences for certain garden areas where required in order to ensure that lowest practicable noise levels are met.’

- 2.4.2 Since issuing the original report the following correspondence has been received from the EHO at Rochdale Borough Council:

‘I note the comment raised surrounding the wording of BS8233:2014 ‘Guidance on sound insulation and noise reduction for buildings’ provides recommendations and guidance for noise levels in garden areas, and have been aware of such since its publication. As a department we considered the wording and context and in developments that met such criteria adopted an maximum upper limit of 58 dB(A) in garden areas, this was done to give flexibility to the development whilst maintaining an appropriate acoustic environment for the end user. This has been set for all residential developments post 2014, and to maintain a consistency of approach we have continued and will continue to require this level to be met to allow us to support such development.

I understand that the residential development at the former Hill Top Primary School site (ref: 15/00826/FUL), which is a site also bounding the M62 did not meet such requirements in some garden areas, as such we did not support the application. I accepted at the time that the lowest practicable levels have been achieved, however it has to be noted that lowest achievable does not always represent acceptable and I am of the opinion that this is not in line with the context/essence of the standard.’

- 2.4.3 As a result of the above, the aim is to achieve an upper limit of 58dB L_{Aeq 16hr} in the garden areas during the daytime period.

3 NOISE SURVEYS

3.1 Survey Information

- 3.1.1 A series of road traffic noise surveys have been completed over a full 24-hr weekday period in order to accurately quantify the level of noise from vehicles using the adjacent motorways.
- 3.1.2 A noise survey has also been completed for the commercial uses to the north of the Site however there was no discernible noise associated with these uses at the Site boundary and the uses were observed to be operational at the time of the noise surveys.

3.2 Road Traffic Noise Survey – M62

- 3.2.1 Professional Consult has completed a noise measurement as follows:

⌚ Noise Measurement Position 1: Located 26m from the centre of the M62 in free-field conditions. Noise sources at the measurement position comprised of road traffic movements along the motorway.

- 3.2.2 Table 3 summarises the measured road traffic noise levels at the microphone location.

Table 5. Summary of Measured Road Traffic Noise Levels

Measurement Position	Period	Measured Sound Pressure Level, dB		Measurement Distance to Centre of Road (m)
		L _{Aeq,T}	L _{Amax,fast}	
1	Daytime	78.6		26
	Night-time	74.1	86.4	
*10 th highest L _{Amax,fast}				

- 3.2.3 Appendix 7 details the measured road traffic noise levels for the M62.

3.3 Road Traffic Noise Survey – A627(M)

- 3.3.1 Professional Consult has completed a noise measurement as follows:

⌚ Noise Measurement Position 2: Located 29m from the centre of the A627(M) in free-field conditions. Noise sources at the measurement position comprised of road traffic movements along the motorway.

- 3.3.2 Table 4 summarises the measured road traffic noise levels at the microphone location.

Table 6. Summary of Measured Road Traffic Noise Levels

Measurement Position	Period	Measured Sound Pressure Level, dB		Measurement Distance to Centre of Road (m)
		L _{Aeq,T}	L _{Amax,fast}	
1	Daytime	74.7		29

	Night-time	68.6	84.2	
*10 th highest L _{Amax,fast}				

3.3.3 Appendix 8 details the measured road traffic noise levels for the M627(M)

3.4 Noise Survey Equipment

3.4.1 The following equipment was used for the noise surveys.

Table 7. Noise Measurement Equipment

Measurement Position	Equipment Description	Manufacturer & Type No	Serial No.	Calibration Due Date
NMP1	Sound Level Meter	01dB Fusion	11755	03 July 2022
	Pre-amplifier	01dB PRE22	1707173	
	Microphone	GRAS 40CE	291693	
	Calibrator	01dB CAL-31	84086	30 June 2022
NMP2	Sound Level Meter	01dB Fusion	12586	24 June 2022
	Pre-amplifier	01dB PRE22	367351	
	Microphone	GRAS 40CD	2004163	
	Calibrator	01dB CAL-31	92222	30 June 2022

3.4.2 The sound level meters were field calibrated prior to and following the noise surveys and there was no drift beyond the allowable limit of 1dB.

3.4.3 Table 6 indicates a summary of the measured weather conditions.

Table 8. Range of Measured Wind Speeds

Period	Range of Measured Wind Speeds (m/s)	Rainfall Recorded?
All periods	0 – 0.8	No

4 NOISE IMPACT ASSESSMENT

4.1 Assessment Information & Approach

4.1.1 Since the original report comments have been received from the EHO at Rochdale Borough Council stating that the garden areas should not be exposed to noise levels of greater than 58dB $L_{Aeq, 16hr}$. As such, the layout has been re designed in order to ensure that good acoustic design has been implemented across the scheme specifically for the eastern and south eastern areas of the Site which were previously exposed to noise levels above 58dB $L_{Aeq, 16hr}$.

4.2 Road Traffic Noise

4.2.1 For the purposes of this assessment, Professional Consult has used noise modelling software CadnaA to determine the impact of noise from the measured noise levels for the M62 and the A627(M) for the proposed residential dwelling blocks. Accordingly, a noise model has therefore been constructed in order to calculate façade noise levels and external noise levels in amenity areas.

4.2.2 The following inputs have been included in the model:

- ② Site elevations have been taken as existing using 1m contours;
- ② Noise Measurement Positions 1 and 2 has been used in order to calibrate the noise model;
- ② A floor height of 2.5m has been assumed for all proposed dwellings which is a standard separation distance between ground and first floors in a typical dwelling;
- ② A reflection order of 2 has been used in all calculations;
- ② Noise levels generated using ISO 9613-1 and ISO 9613-2 “Acoustics – Attenuation of sound during propagation outdoors” as incorporated into CadnaA software.

External Noise Impact in Garden Areas of Proposed Dwellings

4.2.3 In order to assess noise levels in external amenity areas across the Site, a grid noise map was calculated in the noise model. The grid noise map (Figure 1 of Appendix 4) shows that of the garden areas side on to the M62, the highest noise levels are in the noise contour band 61dB – 63dB $L_{Aeq, 16hr}$, however if most garden areas face away from the M62, noise levels are between 50dB – 58dB $L_{Aeq, 16hr}$. Nevertheless, the following section considers noise mitigation in order to reduce noise levels as low as practically possible.

4.2.4 For the garden areas which lie closest to the A627(M), noise levels lie in the noise contour band 61dB – 63dB $L_{Aeq, 16hr}$ and so the following section considers noise mitigation measures to reduce these noise levels to the lowest practicable.

Internal Noise Impact for Proposed Dwellings

4.2.5 With regards internal noise levels, BS8233:2014 suggests that standard thermal double glazing will afford 33dB R_w of sound reduction, however this is for the pink noise spectrum and the same configuration will afford 30dB $R_w + C_{tr}$ for average noise levels from road traffic noise and so this value has been used to calculate internal noise levels. With regard to the maximum noise level ($L_{Amax, fast}$), the value of 33dB R_w has been used. The AVO Residential Design Guide states that a partially open window provides approximately 13dB of attenuation.

- 4.2.6 Professional Consult uses a library database of glazing configurations issued by Saint Gobain and the glazing configuration 6mm glass / 12mm air space / 6mm glass affords 30dB $R_w + C_{tr}$ and 33dB R_w respectively.
- 4.2.7 Appendix 9 calculates the average daytime noise levels at the various facades of the plots and determines the requirement for upgraded glazing or alternative ventilation. Appendix 9 that standard thermal double glazing will be adequate in controlling external noise to meet the internal noise criteria limit for the majority of Livingrooms. However, the eastern façade of the plots facing the A627(M) requires a glazing unit that provides an attenuation of 36dB $R_w + C_{tr}$. In addition, with a partially open window, the internal noise criteria limit for living rooms will be exceeded in various Plots and so the following section considers appropriate noise mitigation.
- 4.2.8 Appendix 10 calculates the average night-time noise levels at the various facades of the plots and determines the requirement for upgraded glazing or alternative ventilation. Appendix 10 indicates that standard thermal double glazing will be adequate in controlling external noise to meet the internal noise criteria limit for the majority of bedrooms. However, the eastern façade of plots facing the A627(M) requires a glazing unit that provides an attenuation of 36dB $R_w + C_{tr}$. In addition, with a partially open window, the internal noise criteria limit for Bedrooms will be exceeded in various Plots and so the following section considers appropriate noise mitigation.
- 4.2.9 It is also necessary to consider maximum noise levels, for the night-time period for bedrooms only, in addition to the average noise levels.
- 4.2.10 Tables 9 calculates the internal noise level at the closest façade with windows closed and with a partially open window and compares the predicted noise level to the internal $L_{Amax,fast}$ noise criteria in BS8233 and Part O for Bedrooms.

Table 9. Calculation of Maximum Noise Levels within Bedrooms

Noise Source	Applicable Standard / Guidance Document	10th Highest Measured Max Noise Level	Measurement Distance to Centre (m)	Distance to Closest Proposed Dwelling (m)	Calculated Maximum Noise Level at Dwelling	Windows Closed / Open	Sound Reduction of Partially Open Window	Calculated Maximum Noise Level Inside Bedroom	Applicable Internal Noise Criteria Level	Difference +/- (dB)
M62	BS8233:2014	89.9	26	180	69.6	Open	13	56.6	45	+11.6
		89.9	26	180	69.6	Closed	33	36.6	45	-8.4
	Approved Document O	89.9	26	180	69.6	Open	13	56.6	55	+1.6
		86.4	26	180	69.6	Closed	33	36.6	55	-18.4
A627	BS8233:2014	84.2	29	26	85.1	Open	13	72.1	45	+27.1
		84.2	29	26	85.1	Closed	33	52.1	45	+7.1
	Approved Document O	84.2	29	26	85.1	Open	13	72.1	55	+17.1
		84.2	29	26	85.1	Closed	33	52.1	55	-2.9

- 4.2.11 Table 9 indicates that for closest plot (Plot B169). facing the A627 a glazing unit that provides an attenuation of 37dB $R_w + C_{tr}$ is required in order to in control the maximum noise levels in bedrooms during the night-time period. Additionally, with windows open, there will be an exceedance of the noise criteria level and so the following section considers appropriate noise mitigation.

5 MITIGATION

5.1 Road Traffic Noise

External Noise Impact in Garden Areas of Proposed Dwellings

- 5.1.1 The previous section has shown that noise levels in the garden areas closest to the M62 and A627 have noise levels up to 63dB $L_{Aeq,16hr}$ with no noise mitigation in place and so this section will consider the effectiveness of an acoustic barrier for the affected gardens. Appendix 6 details the daytime grid noise map with noise barriers located along the boundary of gardens ranging from 1.8m to 3m and parts of the southern boundary and the resulting noise levels are no higher than 58dB $L_{Aeq,16hr}$ for the majority of the Site.
- 5.1.2 In addition to the garden barriers, two 3.5m barriers have also been positioned to the northeast of Plot B127 and to the east of B167 -B170.
- 5.1.3 Where noise barriers have been recommended and these comprise of a timber fence, the fence should have a minimum mass of 15kg/m² and be free from holes.
- 5.1.4 It should be noted that the majority of garden areas associated with residential dwellings, particularly in the centre of the Site, have noise levels below the 58dB $L_{Aeq,16hr}$.

Internal Noise Impact for Habitable Rooms

- 5.1.5 With regards the average noise levels in habitable rooms, for the daytime period, Appendix 9 has determined that standard thermal double glazing is adequate in order to control external to internal noise break-in. However, the eastern façade of the plots facing the A627(M) requires a glazing unit that provides an attenuation of 36dB_{Rw+Ctr}.
- 5.1.6 For the night-time period, Appendix 10 indicates that standard thermal double glazing will be adequate in controlling external noise to meet the internal noise criteria limit for the majority of bedrooms. However, the eastern façade of plots facing the A627(M) requires a glazing unit that provides an attenuation of 36dB_{Rw+Ctr}.
- 5.1.7 In addition, various Plots will experience exceedances of the average internal noise levels with an open window, as such various living rooms and bedrooms will require alternative ventilation and Appendix 11 details example alternative ventilation specifications which should be read in conjunction with the requirements of Appendices 9 & 10.
- 5.1.8 With regards to maximum noise levels in bedrooms, the previous section has indicated that there will be an exceedance of the internal noise criteria level and Table 10 calculates the distance at which maximum noise levels are sufficiently low so as not to require alternative ventilation.

Table 10. Identification of Bedrooms Requiring Alternative Ventilation for Maximum Noise Events

Noise Source	Applicable Standard / Guidance Document	10th Highest Measured Max Noise Level	Measurement Distance to Centre (m)	Required Distance for No Alternative Ventilation (m)	Calculated Maximum Noise Level at Dwelling	Windows Closed / Open	Sound Reduction of Partially Open Window	Calculated Maximum Noise Level Inside Bedroom	Applicable Internal Noise Criteria Level	Difference +/- (dB)
M62	BS8233:2014	89.9	26	680	58.0	Open	13	45.0	45	0.0
		89.9	26	680	58.0	Closed	33	25.0	45	-20.0
	Approved Document O	89.9	26	680	58.0	Open	13	45.0	55	-10.0
		86.4	26	680	58.0	Closed	33	25.0	55	-30.0
A627	BS8233:2014	84.2	29	600	58.0	Open	13	45.0	45	0.0
		84.2	29	60	77.9	Closed	33	44.9	45	-0.1
	Approved Document O	84.2	29	600	58.0	Open	13	45.0	55	-10.0
		84.2	29	60	77.9	Closed	33	44.9	55	-10.1

5.1.9 Table 10 indicates that any bedroom window located within 60m of the centre of the A627 will require upgraded glazing

5.1.10 Additionally, it has been shown that any bedroom window located within 680m of the centre of the M62 and 600m of the A627 will require the recommended alternative ventilation. Further to this, all bedrooms will have internal maximum noise levels below 55dB, with either bedroom windows closed or by use of the recommended alternative ventilation in order to gain ventilation to the room with windows remaining closed, thus affording compliance with the maximum noise criteria level presented in Approved Document O.

6 CONCLUSION

- 6.1.1 Professional Consult Limited was instructed by GLP Trows LLP and BDW Trading Ltd to prepare a Noise Impact Assessment for a proposed residential development on a parcel of land located at land south of Cowm Top Lane in Castleton, Rochdale OL11 to be referred to hereafter as 'the Site'.
- 6.1.2 It is understood that proposals include for the development of up to 445 residential dwellings and associated works.
- 6.1.3 The Site will form an extension of the existing residential development located to the west off Leander Drive. To the north of the Site lies a number of commercial uses and to the east and south lies the A627(M) and M62 motorways.
- 6.1.4 This Assessment has been undertaken to identify the key sources of noise surrounding the Site which may adversely impact upon the proposed residential amenity. Accordingly, this Assessment has been completed with due regard to the National Planning Policy Framework and its associated National Planning Policy Guidance in addition to appropriate British Standards and guidance documents relevant to the assessment of noise impacts.
- 6.1.5 Since the original report comments have been received from the EHO at Rochdale Borough Council stating that the garden areas should not be exposed to noise levels of greater than 58dB $L_{Aeq\ 16hr}$. As such, the layout has been re designed in order to ensure that good acoustic design has been implemented across the scheme specifically for the eastern and south eastern areas of the Site which were previously exposed to noise levels above 58dB $L_{Aeq\ 16hr}$.
- 6.1.6 With regards to garden areas of proposed dwellings, this Assessment has shown that following noise mitigation, resultant noise levels will achieve the 58dB $L_{Aeq\ 16hr}$ criteria, this is due to the good acoustic design implemented for the scheme.
- 6.1.7 During the various visits to the Site, there was no audible commercial noise associated with the commercial use to the north of the Site and these uses were observed to be operational at the time of the noise surveys.
- 6.1.8 With regards to internal noise levels, this Assessment has shown that noise levels in living rooms can meet the internal noise criteria limits provided in BS8233:2014 provided that the appropriate noise mitigation measures for upgraded glazing and alternative ventilation as detailed in this Assessment are adhered to. With regards to noise levels in bedrooms during the night-time period, this Assessment has shown that various Plots will require upgraded glazing and alternative ventilation.
- 6.1.9 Should the recommended noise mitigation measures be implemented in order to control external noise levels for gardens and internal noise levels in habitable rooms, then the sound climate which future occupiers of the Development will be exposed to will accord with the 'No Observed Adverse Effect Level' as detailed in the PPG and as such, noise should not be deemed to be a determining factor in the granting of planning permission for this Site.

APPENDIX 1: LIMITATIONS

This report and its findings should be considered in relation to the terms of reference and objectives agreed between Professional Consult Limited and the Client.

The executive summary, conclusions and recommendations sections of the report provide an overview and guidance only and should not be specifically relied upon without considering the context of the report in full.

Professional Consult cannot be held responsible for any use of the report or its contents for any purpose other than that for which it was prepared. The copyright in this report and other plans and documents prepared by Professional Consult is owned by them and no such plans or documents may be reproduced, published or adapted without written consent. Complete copies of this may, however, be made and distributed by the client as is expected in dealing with matters related to its commission. Should the client pass copies of the report to other parties for information, the whole report should be copied, but no professional liability or warranties shall be extended to other parties by Professional Consult in this connection without their explicit written agreement there to by Professional Consult.

APPENDIX 2: GLOSSARY OF ACOUSTIC TERMINOLOGY

Noise is defined as unwanted sound. Human ears are able to respond to sound in the frequency range 20 Hz (deep bass) to 20,000 Hz (high treble) and over the audible range of 0 dB (the threshold of perception) to 140 dB (the threshold of pain). The ear does not respond equally to different frequencies of the same magnitude, but is more responsive to mid-frequencies than to lower or higher frequencies. To quantify noise in a manner that approximates the response of the human ear, a weighting mechanism is used. This reduces the importance of lower and higher frequencies, in a similar manner to the human ear.

Furthermore, the perception of noise may be determined by a number of other factors, which may not necessarily be acoustic. In general, the impact of noise depends upon its level, the margin by which it exceeds the background level, its character and its variation over a given period of time. In some cases, the time of day and other acoustic features such as tonality or impulsiveness may be important, as may the disposition of the affected individual. Any assessment of noise should give due consideration to all of these factors when assessing the significance of a noise source.

The most widely used weighting mechanism that best corresponds to the response of the human ear is the ‘A’-weighting scale. This is widely used for environmental noise measurement, and the levels are denoted as dB(A) or L_{Aeq} , L_{A90} etc., according to the parameter being measured.

The decibel scale is logarithmic rather than linear, and hence a 3 dB increase in sound level represents a doubling of the sound energy present. Judgement of sound is subjective, but as a general guide a 10 dB(A) increase can be taken to represent a doubling of loudness, whilst an increase in the order of 3 dB(A) is generally regarded as the minimum difference needed to perceive a change under normal listening conditions.

An indication of the range of sound levels commonly found in the environment is given in the following table.


Table 1: Typical Sound Pressure Levels

Sound Pressure Level (dB)	Location/Example
0	Threshold of hearing
20 - 30	Quiet bedroom at night
30 - 40	Living room during the day
40 - 50	Typical office
50 - 60	Inside a car
60 - 70	Typical high street
70 - 90	Inside factory
100 - 110	Burglar alarm at 1m away
110 - 130	Jet aircraft on take off
140	Threshold of pain


Table 2: Terminology

Descriptor	Explanation
dB (decibel)	The scale on which sound pressure level is expressed. It is defined as 20 times the logarithm of the ratio between the root-mean-square pressure of the sound field and a reference pressure (2x10 ⁻⁵ Pa).
dB(A)	A-weighted decibel. This is a measure of the overall level of sound across the audible spectrum with a frequency weighting (i.e. 'A' weighting) to compensate for the varying sensitivity of the human ear to sound at different frequencies.
L _{Aeq, T}	L _{Aeq} is defined as the notional steady sound level which, over a stated period of time (T), would contain the same amount of acoustical energy as the A - weighted fluctuating sound measured over that period.
L _{Amax}	L _{Amax} is the maximum A - weighted sound pressure level recorded over the period stated. L _{Amax} is sometimes used in assessing environmental noise where occasional loud noises occur, which may have little effect on the overall Leq noise level but will still affect the noise environment. Unless described otherwise, it is measured using the 'fast' sound level meter response.
L ₁₀ & L ₉₀	If a non-steady noise is to be described it is necessary to know both its level and the degree of fluctuation. The Ln indices are used for this purpose, and the term refers to the level exceeded for n% of the time. Hence L ₁₀ is the level exceeded for 10% of the time and as such can be regarded as the 'average maximum level'. Similarly, L ₉₀ is the 'average minimum level' and is often used to describe the background noise. It is common practice to use the L ₁₀ index to describe traffic noise.
Free-field Level	2A sound field determined at a point away from reflective surfaces other than the ground with no significant contributions due to sound from other reflective surfaces. Generally as measured outside and away from buildings.
Fast	A time weighting used in the root mean square section of a sound level meter with a 125millisecond time constant.
Slow	A time weighting used in the root mean square section of a sound level meter with a 1000millisecond time constant.


APPENDIX 3: NOISE MEASUREMENT POSITIONS

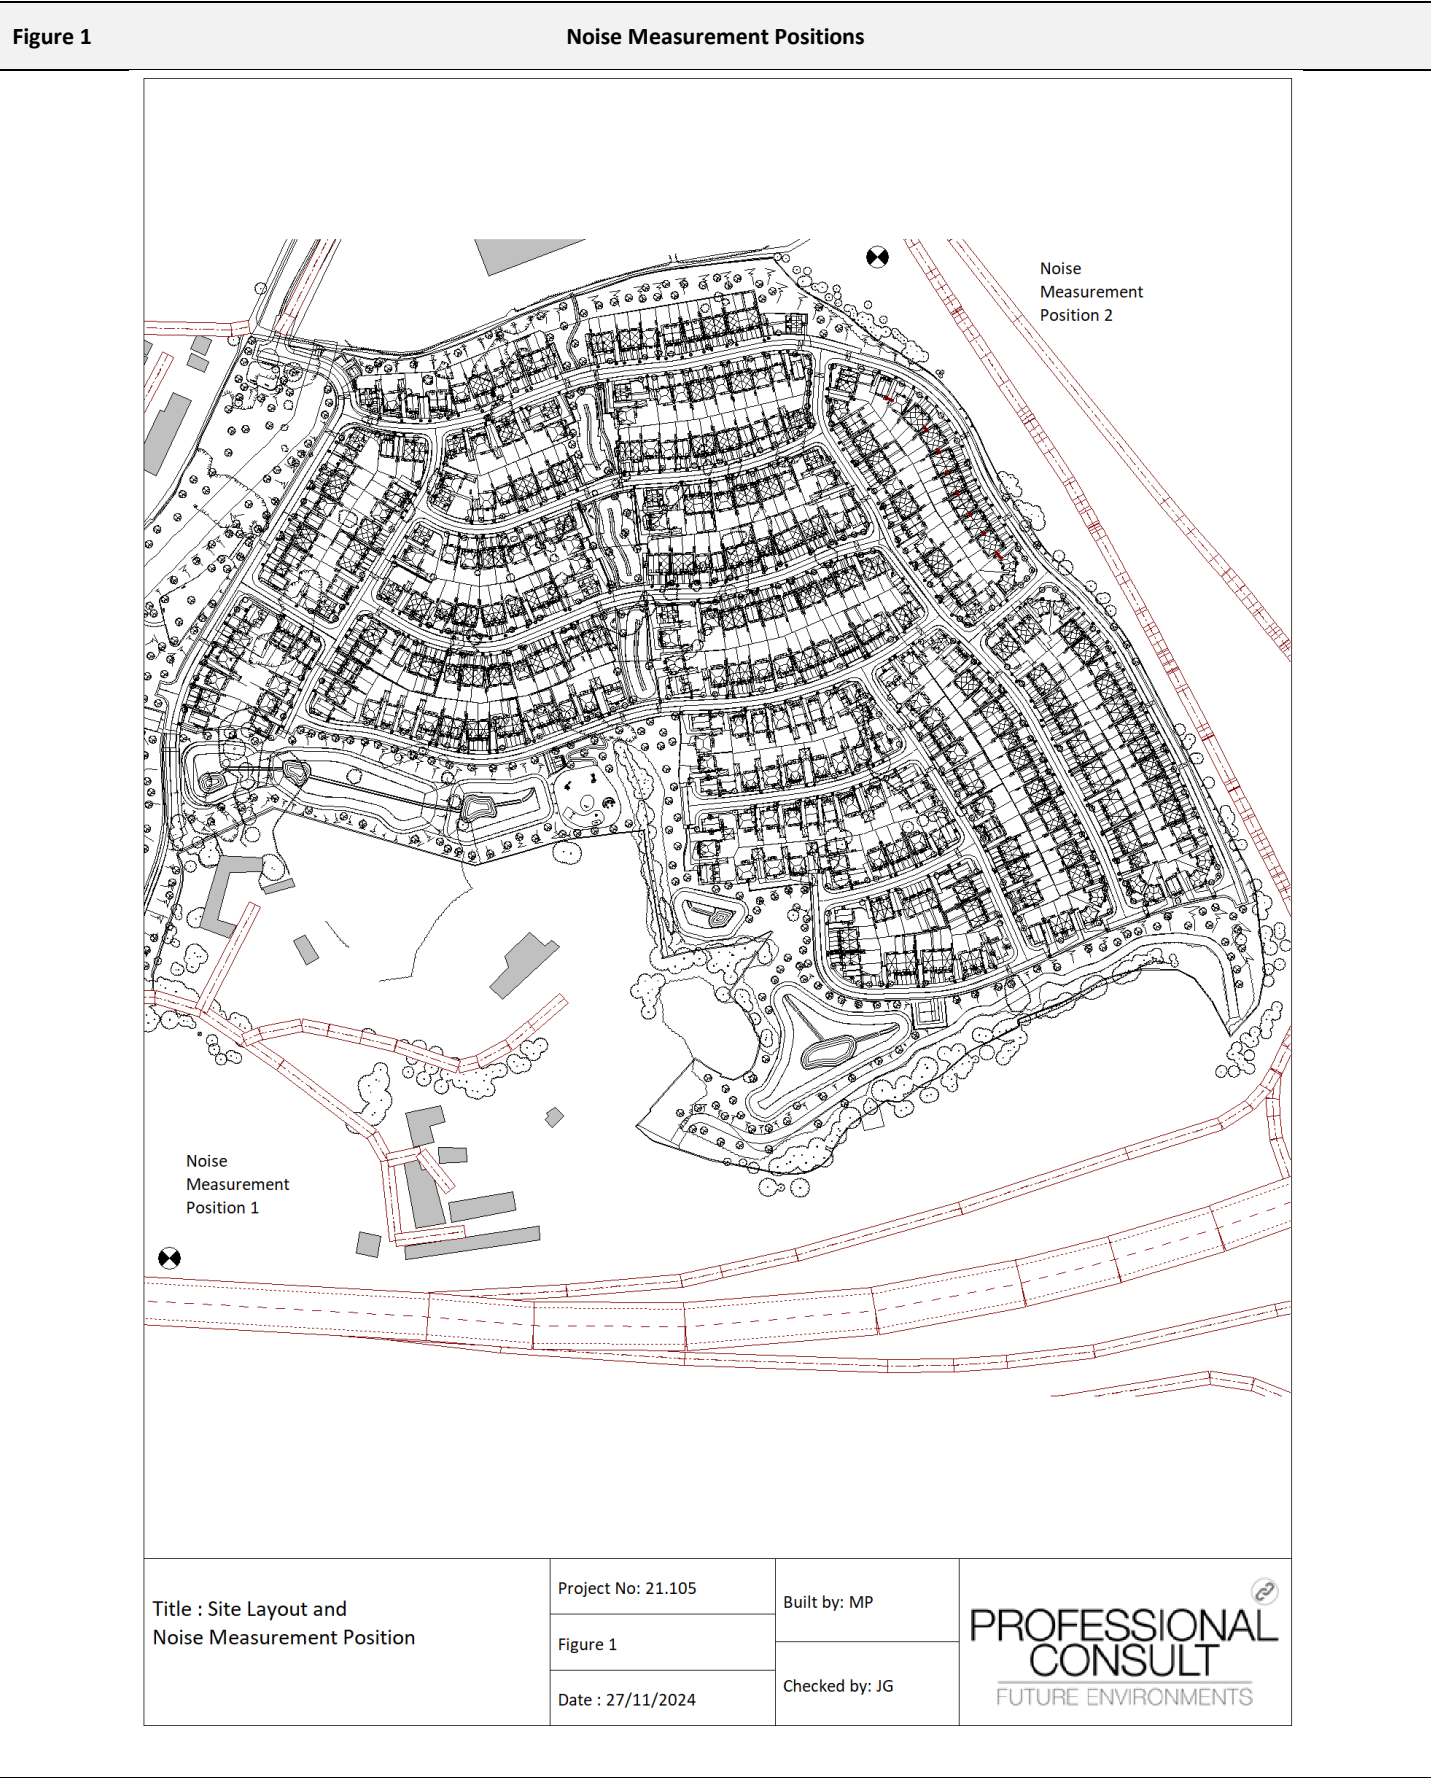


APPENDIX 4: DAYTIME GRID NOISE MAP

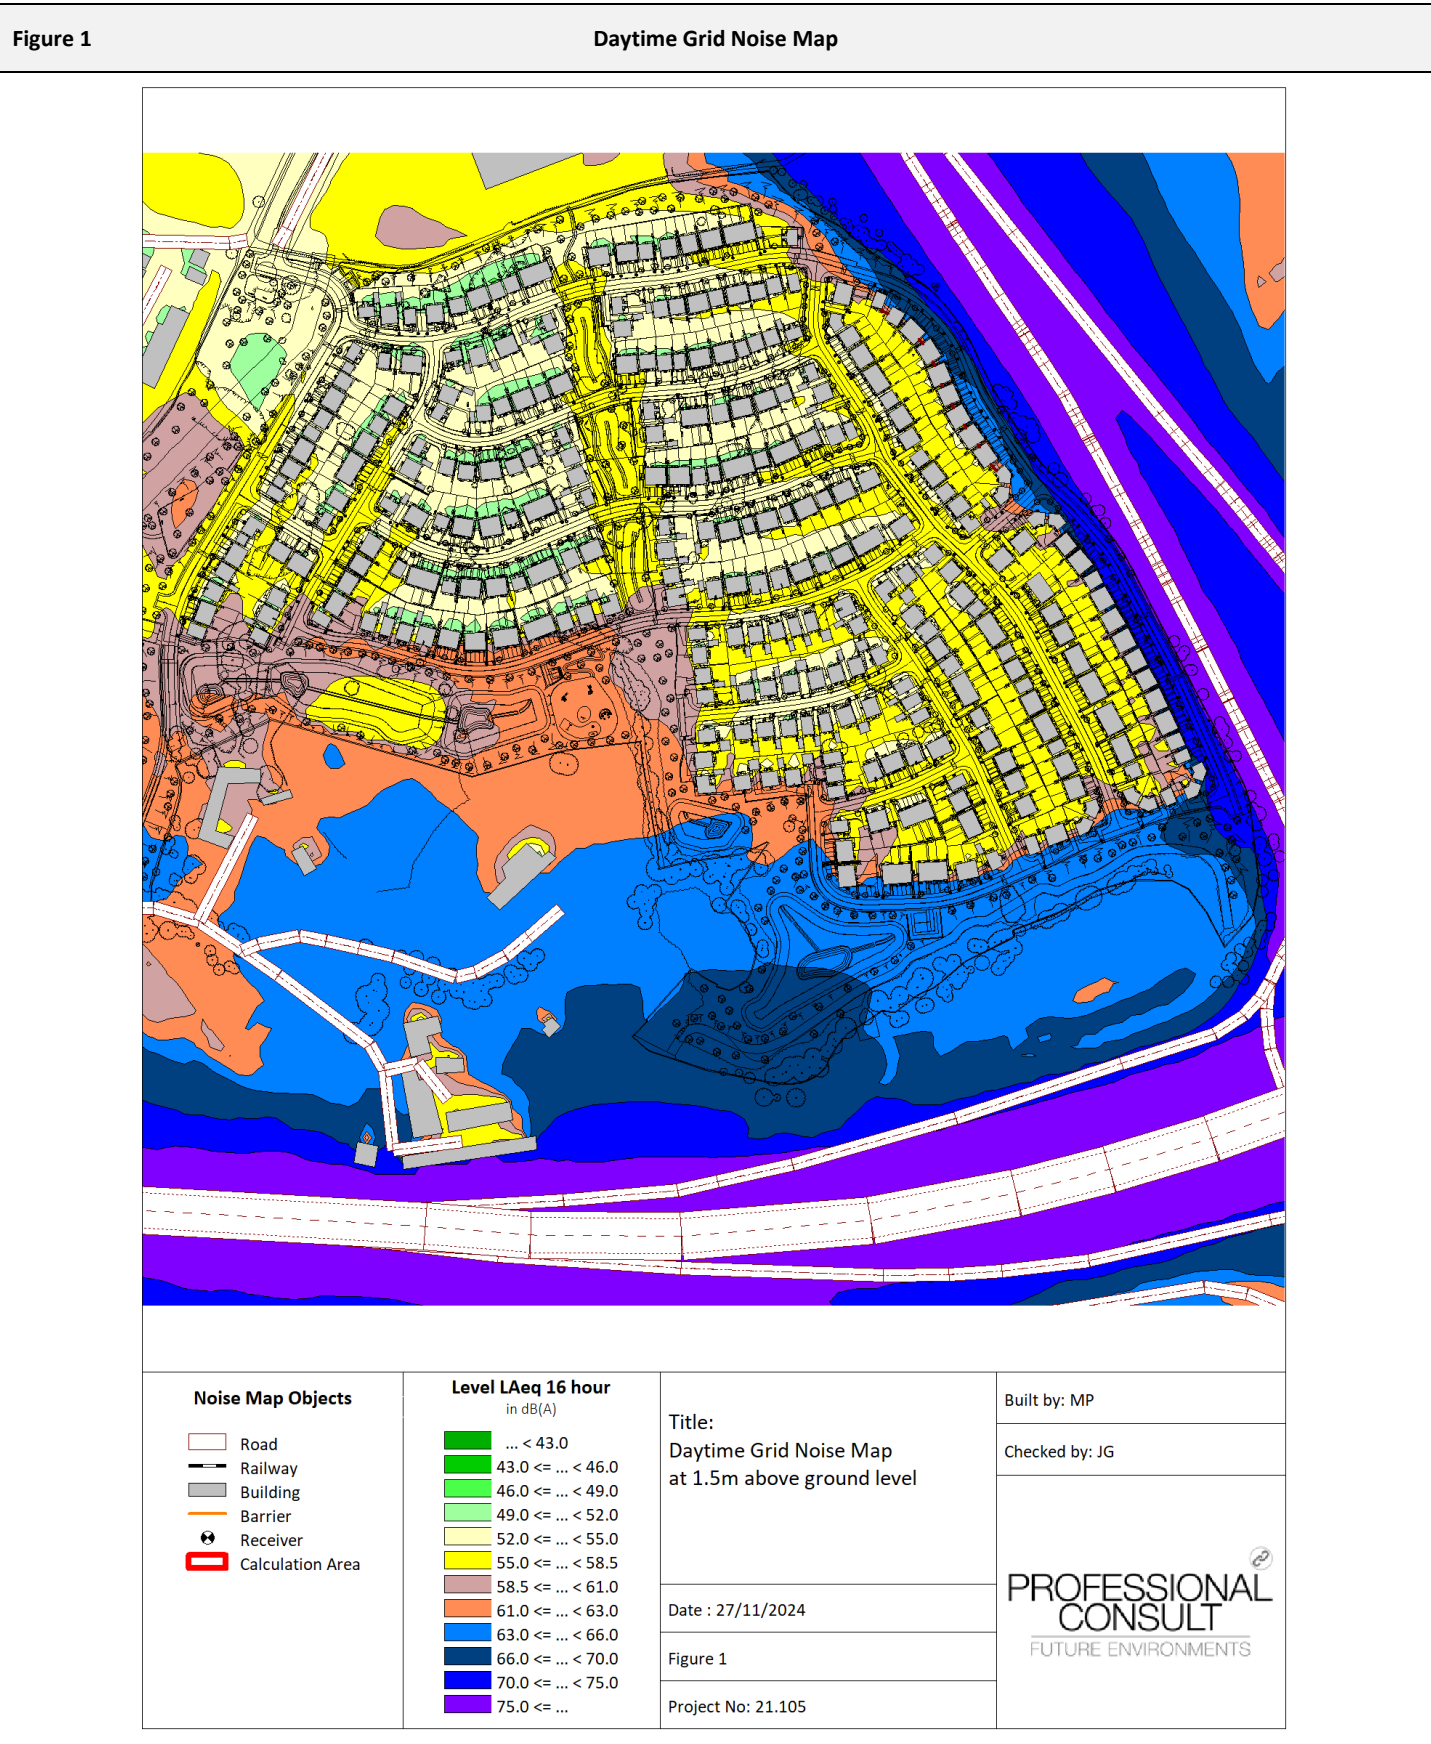

APPENDIX 5: NIGHT-TIME GRID NOISE MAP

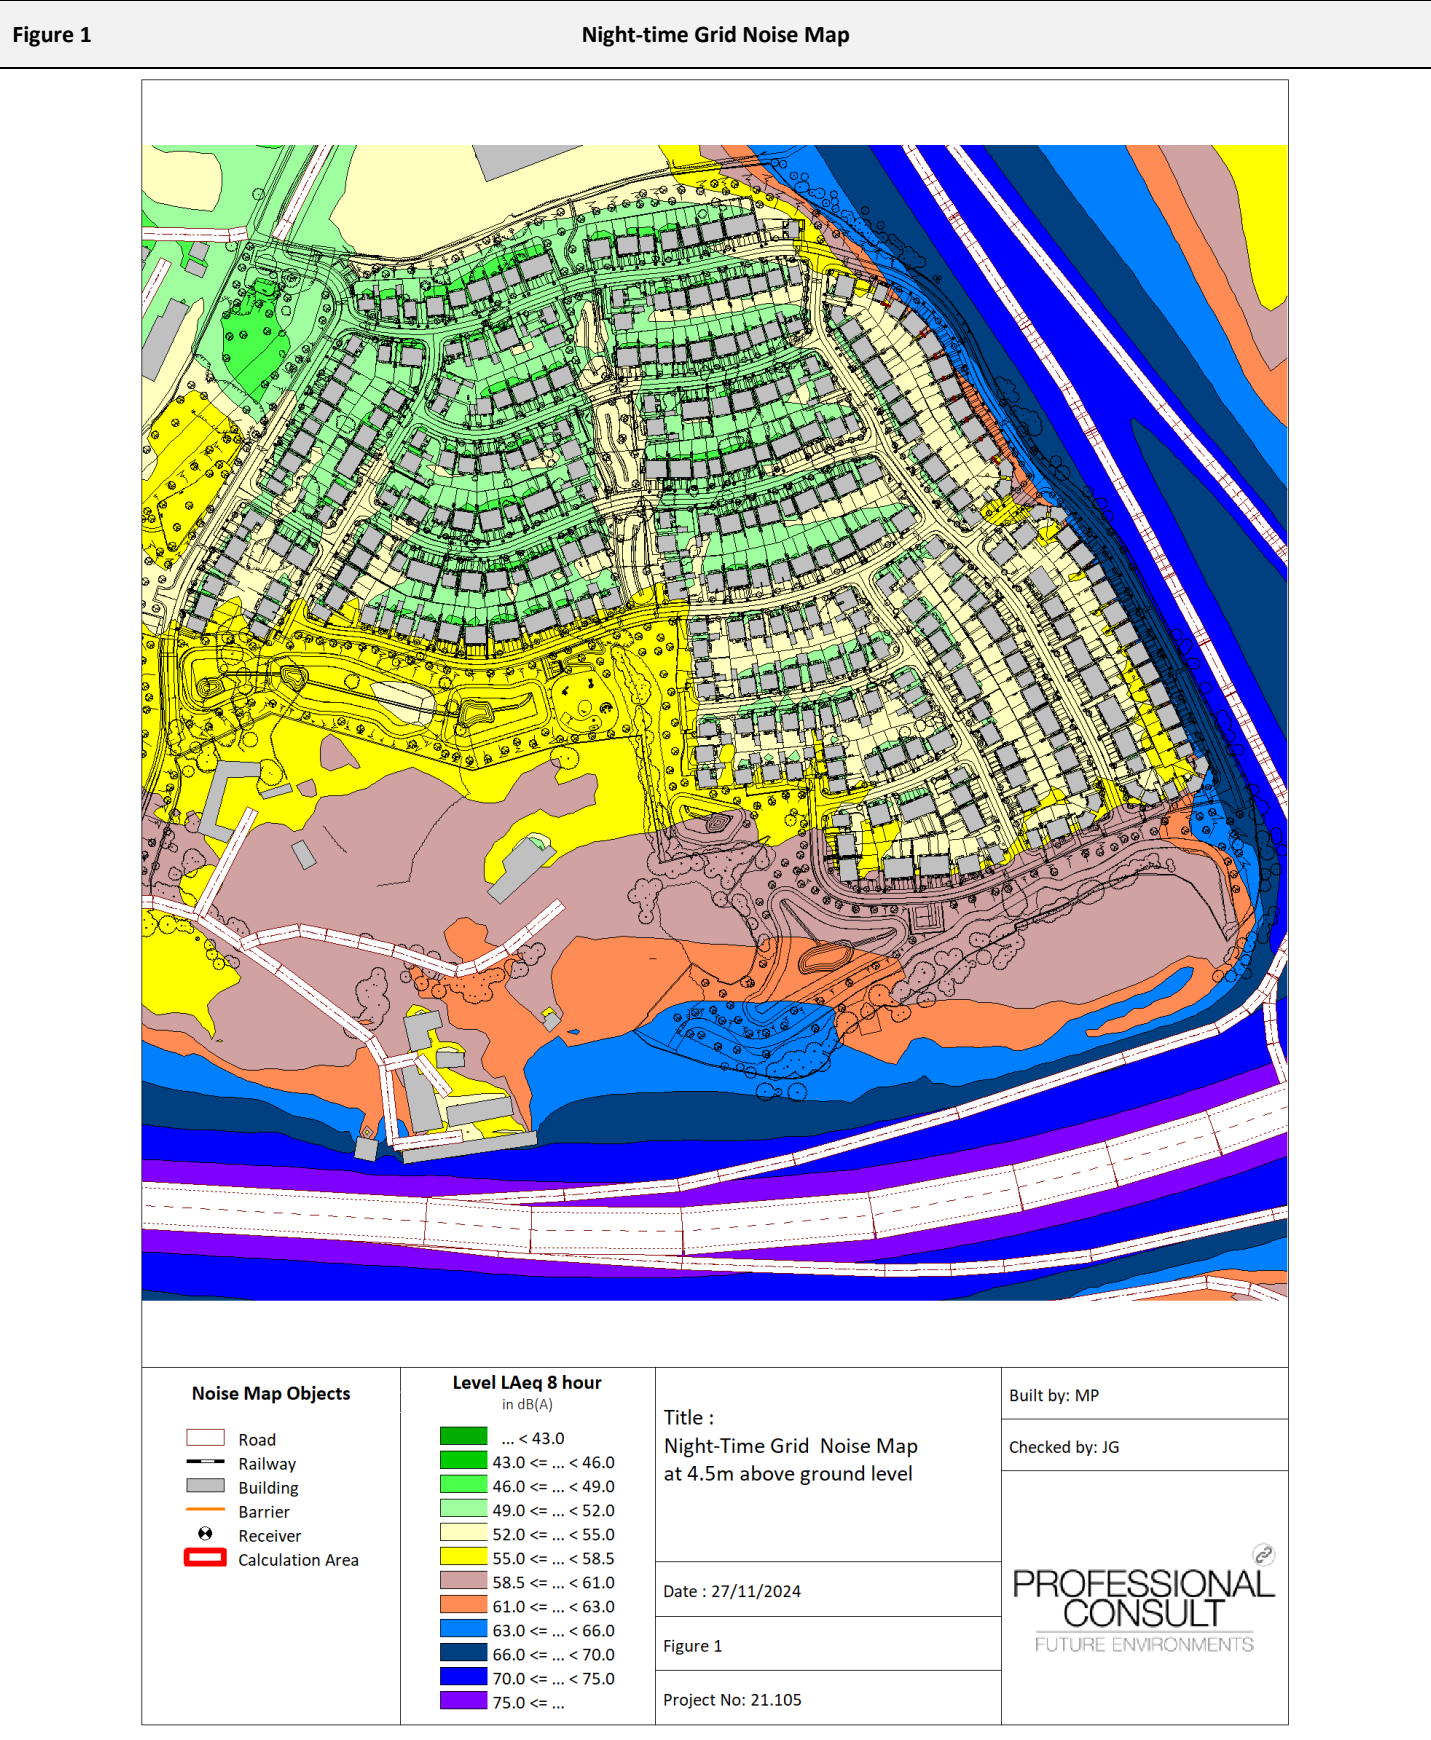

APPENDIX 6: DAYTIME GRID NOISE MAP – WITH NOISE MITIGATION

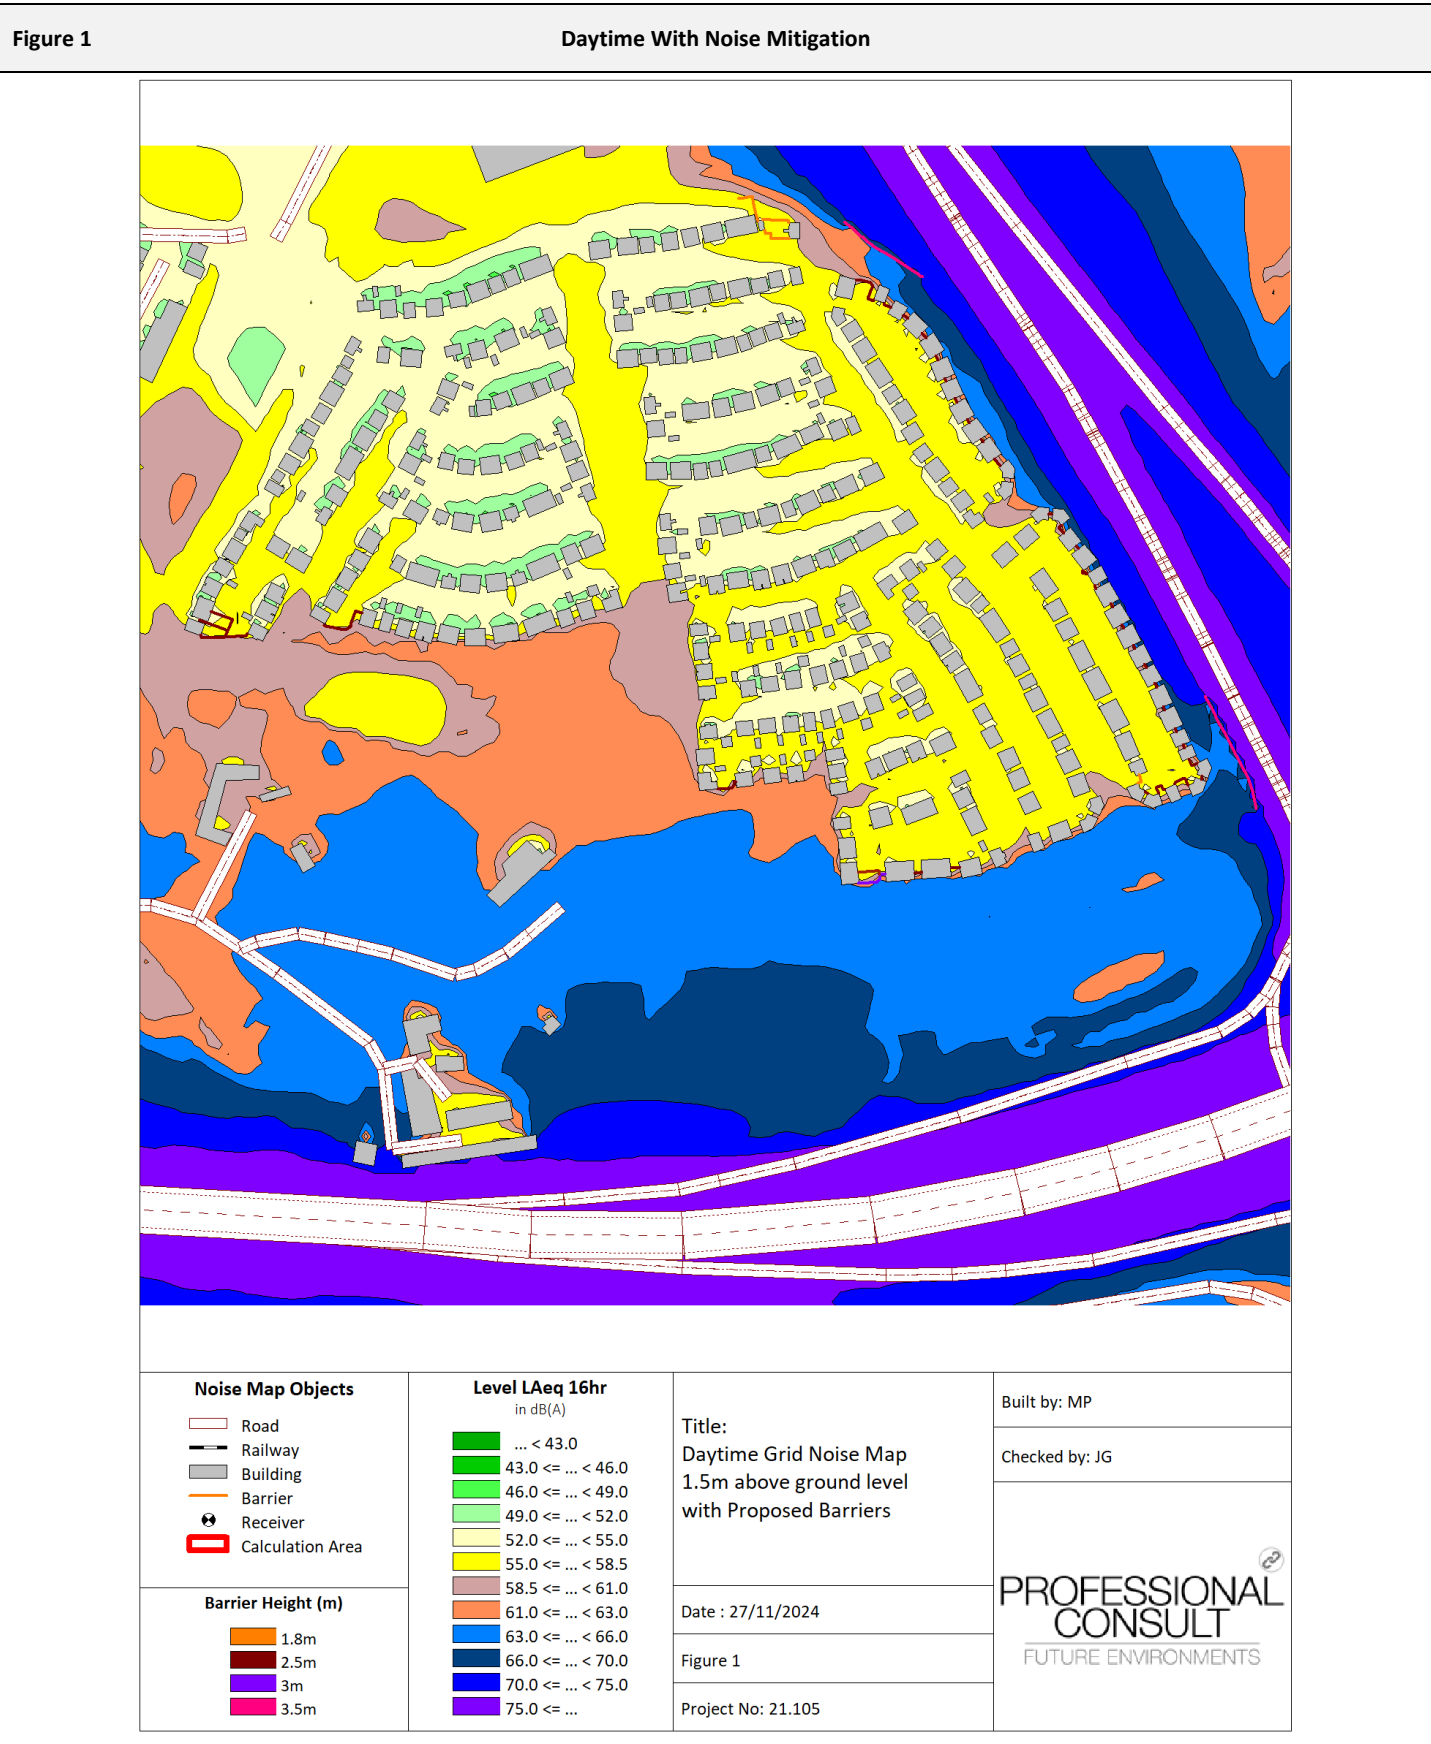

Page 27 of 97

APPENDIX 7: MEASURED ROAD TRAFFIC LEVELS – NMP1

Start Date & Time	Measured Sound pressure Level, $L_{Aeq,T}$ (dB)
14/07/2021 12:00	74.5
14/07/2021 13:00	79.1
14/07/2021 14:00	79.1
14/07/2021 15:00	79.1
14/07/2021 16:00	79.4
14/07/2021 17:00	79.1
14/07/2021 18:00	78.4
14/07/2021 19:00	77.6
14/07/2021 20:00	76.4
14/07/2021 21:00	74.9
14/07/2021 22:00	73.9
14/07/2021 23:00	72.6
15/07/2021 00:00	71.4
15/07/2021 01:00	70.4
15/07/2021 02:00	70.2
15/07/2021 03:00	70.4
15/07/2021 04:00	72.5
15/07/2021 05:00	75.9
15/07/2021 06:00	79.2
15/07/2021 07:00	79.7
15/07/2021 08:00	79.7
15/07/2021 09:00	79.5
15/07/2021 10:00	79.3
15/07/2021 11:00	79.2
15/07/2021 12:00	78.9

APPENDIX 8: MEASURED ROAD TRAFFIC LEVELS – NMP2

Start Date & Time	Measured Sound pressure Level, $L_{Aeq,T}$ (dB)
14/07/2021 12:00	74.5
14/07/2021 13:00	74.5
14/07/2021 14:00	74.9
14/07/2021 15:00	75.2
14/07/2021 16:00	75.4
14/07/2021 17:00	75.7
14/07/2021 18:00	75.1
14/07/2021 19:00	74.2
14/07/2021 20:00	73.3
14/07/2021 21:00	72.4
14/07/2021 22:00	71.5
14/07/2021 23:00	70
15/07/2021 00:00	68.5
15/07/2021 01:00	65.9
15/07/2021 02:00	63.7
15/07/2021 03:00	63.9
15/07/2021 04:00	64.9
15/07/2021 05:00	69.8
15/07/2021 06:00	73
15/07/2021 07:00	75.9
15/07/2021 08:00	76.1
15/07/2021 09:00	75.1
15/07/2021 10:00	74.7
15/07/2021 11:00	74.6

APPENDIX 9: DAYTIME FAÇADE NOISE LEVELS

Plot	Floor	Façade Direction	Calculated LAeq,16hr at Façade (dB)	Glazing Sound Reduction Index (Rw) (Standard Thermal)	Calculated Noise Level Inside Room (dB)	Criteria (dB)	Difference +/- (dB)	Required Sound Insulation Performance for Glazing (Rw +Ctr) (dB)	Commentary on Required Glazing	Calculated Internal Noise Level with a Partially Open Window (dB)	Alternative Ventilation Required?	Acoustics Ventilation & Overheating Assessment - Appropriate AD-F System	Eg. Alt' Ventilation Scheme
Plot B1	Ground	NE	49.2	30	19.2	35	-15.8	14.0	Standard thermal glazing	36.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B1	Ground	SE	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B1	Ground	SW	51.3	30	21.3	35	-13.7	16	Standard thermal glazing	38.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B1	Ground	NW	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B2	Ground	NE	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B2	Ground	SE	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B2	Ground	SW	48.7	30	18.7	35	-16.3	14	Standard thermal glazing	35.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B2	Ground	NW	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B3-4	Ground	SW	48	30	18	35	-17	13	Standard thermal glazing	35	No	N/A	Alt. Vent. not Required
Plot B3-4	Ground	SE	54.3	30	24.3	35	-10.7	19	Standard thermal glazing	41.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B3-4	Ground	NE	48.5	30	18.5	35	-16.5	14	Standard thermal glazing	35.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B3-4	Ground	NW	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B5	Ground	SW	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B5	Ground	SE	54.6	30	24.6	35	-10.4	20	Standard thermal glazing	41.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B5	Ground	NE	48.1	30	18.1	35	-16.9	13	Standard thermal glazing	35.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B5	Ground	NW	49.4	30	19.4	35	-15.6	14	Standard thermal glazing	36.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B6	Ground	SW	48.6	30	18.6	35	-16.4	14	Standard thermal glazing	35.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B6	Ground	SE	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B6	Ground	NE	48	30	18	35	-17	13	Standard thermal glazing	35	No	N/A	Alt. Vent. not Required
Plot B6	Ground	NW	52.1	30	22.1	35	-12.9	17	Standard thermal glazing	39.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B7-8	Ground	NE	48.1	30	18.1	35	-16.9	13	Standard thermal glazing	35.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B7-8	Ground	SE	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B7-8	Ground	SW	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B7-8	Ground	NW	50.1	30	20.1	35	-14.9	15	Standard thermal glazing	37.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B9	Ground	SW	48.9	30	18.9	35	-16.1	14	Standard thermal glazing	35.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B9	Ground	NW	48.1	30	18.1	35	-16.9	13	Standard thermal glazing	35.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B9	Ground	NE	49.1	30	19.1	35	-15.9	14	Standard thermal glazing	36.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B9	Ground	SE	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B10-11	Ground	SW	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B10-11	Ground	SE	54.6	30	24.6	35	-10.4	20	Standard thermal glazing	41.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B10-11	Ground	NE	49	30	19	35	-16	14	Standard thermal glazing	36	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B10-11	Ground	NW	49.1	30	19.1	35	-15.9	14	Standard thermal glazing	36.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B12	Ground	N	48.1	30	18.1	35	-16.9	13	Standard thermal glazing	35.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B12	Ground	E	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B12	Ground	S	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B12	Ground	W	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B13-14	Ground	E	52.2	30	22.2	35	-12.8	17	Standard thermal glazing	39.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B13-14	Ground	S	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B13-14	Ground	W	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B13-14	Ground	N	48	30	18	35	-17	13	Standard thermal glazing	35	No	N/A	Alt. Vent. not Required

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B15	Ground	W	52.9	30	22.9	35	-12.1	18	Standard thermal glazing	39.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B15	Ground	S	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B15	Ground	E	49	30	19	35	-16	14	Standard thermal glazing	36	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B15	Ground	N	47.5	30	17.5	35	-17.5	13	Standard thermal glazing	34.5	No	N/A	Alt. Vent. not Required
Plot B16	Ground	E	49.7	30	19.7	35	-15.3	15	Standard thermal glazing	36.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B16	Ground	S	53.9	30	23.9	35	-11.1	19	Standard thermal glazing	40.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B16	Ground	W	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B16	Ground	N	47.6	30	17.6	35	-17.4	13	Standard thermal glazing	34.6	No	N/A	Alt. Vent. not Required
Plot B17	Ground	N	47.8	30	17.8	35	-17.2	13	Standard thermal glazing	34.8	No	N/A	Alt. Vent. not Required
Plot B17	Ground	W	51.2	30	21.2	35	-13.8	16	Standard thermal glazing	38.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B17	Ground	S	53.9	30	23.9	35	-11.1	19	Standard thermal glazing	40.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B17	Ground	E	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B18-19	Ground	E	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B18-19	Ground	S	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B18-19	Ground	W	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B18-19	Ground	N	47.6	30	17.6	35	-17.4	13	Standard thermal glazing	34.6	No	N/A	Alt. Vent. not Required
Plot B20	Ground	E	49.3	30	19.3	35	-15.7	14	Standard thermal glazing	36.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B20	Ground	S	54.3	30	24.3	35	-10.7	19	Standard thermal glazing	41.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B20	Ground	W	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B20	Ground	N	47.2	30	17.2	35	-17.8	12	Standard thermal glazing	34.2	No	N/A	Alt. Vent. not Required
Plot B21-22	Ground	E	47.4	30	17.4	35	-17.6	12	Standard thermal glazing	34.4	No	N/A	Alt. Vent. not Required
Plot B21-22	Ground	S	53.9	30	23.9	35	-11.1	19	Standard thermal glazing	40.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B21-22	Ground	W	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B21-22	Ground	N	47.5	30	17.5	35	-17.5	13	Standard thermal glazing	34.5	No	N/A	Alt. Vent. not Required
Plot B23	Ground	E	48.5	30	18.5	35	-16.5	14	Standard thermal glazing	35.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B23	Ground	N	47.5	30	17.5	35	-17.5	13	Standard thermal glazing	34.5	No	N/A	Alt. Vent. not Required
Plot B23	Ground	W	47.7	30	17.7	35	-17.3	13	Standard thermal glazing	34.7	No	N/A	Alt. Vent. not Required
Plot B23	Ground	S	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B24	Ground	E	48.4	30	18.4	35	-16.6	13	Standard thermal glazing	35.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B24	Ground	S	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B24	Ground	W	48.2	30	18.2	35	-16.8	13	Standard thermal glazing	35.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B24	Ground	N	47.5	30	17.5	35	-17.5	13	Standard thermal glazing	34.5	No	N/A	Alt. Vent. not Required
Plot B25-27	Ground	E	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B25-27	Ground	S	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B25-27	Ground	W	49.8	30	19.8	35	-15.2	15	Standard thermal glazing	36.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B25-27	Ground	N	48.1	30	18.1	35	-16.9	13	Standard thermal glazing	35.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B28	Ground	E	53	30	23	35	-12	18	Standard thermal glazing	40	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B28	Ground	S	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B28	Ground	W	51.6	30	21.6	35	-13.4	17	Standard thermal glazing	38.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B28	Ground	N	48.2	30	18.2	35	-16.8	13	Standard thermal glazing	35.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B29	Ground	E	53.1	30	23.1	35	-11.9	18	Standard thermal glazing	40.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B29	Ground	S	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B29	Ground	W	52.1	30	22.1	35	-12.9	17	Standard thermal glazing	39.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B29	Ground	N	47.8	30	17.8	35	-17.2	13	Standard thermal glazing	34.8	No	N/A	Alt. Vent. not Required
Plot B30-31	Ground	E	51.6	30	21.6	35	-13.4	17	Standard thermal glazing	38.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B30-31	Ground	S	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B30-31	Ground	W	52.7	30	22.7	35	-12.3	18	Standard thermal glazing	39.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B30-31	Ground	N	47.8	30	17.8	35	-17.2	13	Standard thermal glazing	34.8	No	N/A	Alt. Vent. not Required
Plot B32	Ground	E	49.4	30	19.4	35	-15.6	14	Standard thermal glazing	36.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B32	Ground	S	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B32	Ground	W	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B32	Ground	N	47.6	30	17.6	35	-17.4	13	Standard thermal glazing	34.6	No	N/A	Alt. Vent. not Required
Plot B33	Ground	E	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B33	Ground	S	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B33	Ground	W	52.1	30	22.1	35	-12.9	17	Standard thermal glazing	39.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B33	Ground	N	47.7	30	17.7	35	-17.3	13	Standard thermal glazing	34.7	No	N/A	Alt. Vent. not Required
Plot B34	Ground	SW	52.9	30	22.9	35	-12.1	18	Standard thermal glazing	39.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B34	Ground	NW	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B34	Ground	NE	47.7	30	17.7	35	-17.3	13	Standard thermal glazing	34.7	No	N/A	Alt. Vent. not Required
Plot B34	Ground	SE	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B35	Ground	E	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B35	Ground	S	49.7	30	19.7	35	-15.3	15	Standard thermal glazing	36.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B35	Ground	W	52.3	30	22.3	35	-12.7	17	Standard thermal glazing	39.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B35	Ground	N	49.2	30	19.2	35	-15.8	14	Standard thermal glazing	36.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B36	Ground	E	50.6	30	20.6	35	-14.4	16	Standard thermal glazing	37.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B36	Ground	S	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B36	Ground	W	50.3	30	20.3	35	-14.7	15	Standard thermal glazing	37.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B36	Ground	N	47.8	30	17.8	35	-17.2	13	Standard thermal glazing	34.8	No	N/A	Alt. Vent. not Required
Plot B37	Ground	N	47.7	30	17.7	35	-17.3	13	Standard thermal glazing	34.7	No	N/A	Alt. Vent. not Required
Plot B37	Ground	W	50	30	20	35	-15	15	Standard thermal glazing	37	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B37	Ground	S	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B37	Ground	E	49.1	30	19.1	35	-15.9	14	Standard thermal glazing	36.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B38-39	Ground	E	48	30	18	35	-17	13	Standard thermal glazing	35	No	N/A	Alt. Vent. not Required
Plot B38-39	Ground	S	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B38-39	Ground	W	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B38-39	Ground	N	47.8	30	17.8	35	-17.2	13	Standard thermal glazing	34.8	No	N/A	Alt. Vent. not Required
Plot B40	Ground	N	47.7	30	17.7	35	-17.3	13	Standard thermal glazing	34.7	No	N/A	Alt. Vent. not Required
Plot B40	Ground	W	49.3	30	19.3	35	-15.7	14	Standard thermal glazing	36.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B40	Ground	S	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B40	Ground	E	49.4	30	19.4	35	-15.6	14	Standard thermal glazing	36.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B41-42	Ground	N	48.2	30	18.2	35	-16.8	13	Standard thermal glazing	35.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B41-42	Ground	W	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B41-42	Ground	S	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B41-42	Ground	E	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B43	Ground	SE	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B43	Ground	NE	50.1	30	20.1	35	-14.9	15	Standard thermal glazing	37.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B43	Ground	NW	52.7	30	22.7	35	-12.3	18	Standard thermal glazing	39.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B43	Ground	SW	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B44	Ground	NE	48.8	30	18.8	35	-16.2	14	Standard thermal glazing	35.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B44	Ground	SE	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B44	Ground	SW	53.9	30	23.9	35	-11.1	19	Standard thermal glazing	40.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B44	Ground	NW	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B45	Ground	N	49.3	30	19.3	35	-15.7	14	Standard thermal glazing	36.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B45	Ground	E	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B45	Ground	S	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B45	Ground	W	52.1	30	22.1	35	-12.9	17	Standard thermal glazing	39.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B46	Ground	S	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B46	Ground	E	51.2	30	21.2	35	-13.8	16	Standard thermal glazing	38.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B46	Ground	N	48.3	30	18.3	35	-16.7	13	Standard thermal glazing	35.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B46	Ground	W	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B47-48	Ground	E	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B47-48	Ground	S	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B47-48	Ground	W	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B47-48	Ground	N	48.1	30	18.1	35	-16.9	13	Standard thermal glazing	35.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B49	Ground	S	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B49	Ground	E	49	30	19	35	-16	14	Standard thermal glazing	36	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B49	Ground	N	47.7	30	17.7	35	-17.3	13	Standard thermal glazing	34.7	No	N/A	Alt. Vent. not Required
Plot B49	Ground	W	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B50	Ground	E	51.6	30	21.6	35	-13.4	17	Standard thermal glazing	38.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B50	Ground	N	48	30	18	35	-17	13	Standard thermal glazing	35	No	N/A	Alt. Vent. not Required
Plot B50	Ground	W	48.8	30	18.8	35	-16.2	14	Standard thermal glazing	35.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B50	Ground	S	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B51	Ground	S	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B51	Ground	E	53.7	30	23.7	35	-11.3	19	Standard thermal glazing	40.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B51	Ground	N	48.1	30	18.1	35	-16.9	13	Standard thermal glazing	35.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B51	Ground	W	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B52	Ground	S	52.1	30	22.1	35	-12.9	17	Standard thermal glazing	39.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B52	Ground	E	53	30	23	35	-12	18	Standard thermal glazing	40	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B52	Ground	N	48.3	30	18.3	35	-16.7	13	Standard thermal glazing	35.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B52	Ground	SW	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B53-54	Ground	E	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B53-54	Ground	S	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B53-54	Ground	W	52.7	30	22.7	35	-12.3	18	Standard thermal glazing	39.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B53-54	Ground	N	49.5	30	19.5	35	-15.5	15	Standard thermal glazing	36.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B55-56	Ground	S	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B55-56	Ground	E	49.2	30	19.2	35	-15.8	14	Standard thermal glazing	36.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B55-56	Ground	N	50	30	20	35	-15	15	Standard thermal glazing	37	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B55-56	Ground	W	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B57	Ground	E	51.1	30	21.1	35	-13.9	16	Standard thermal glazing	38.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B57	Ground	S	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B57	Ground	W	49.3	30	19.3	35	-15.7	14	Standard thermal glazing	36.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B57	Ground	N	50.1	30	20.1	35	-14.9	15	Standard thermal glazing	37.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B58-59	Ground	S	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B58-59	Ground	E	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B58-59	Ground	N	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B58-59	Ground	W	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B60-61	Ground	S	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B60-61	Ground	E	50.2	30	20.2	35	-14.8	15	Standard thermal glazing	37.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B60-61	Ground	N	51.1	30	21.1	35	-13.9	16	Standard thermal glazing	38.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B60-61	Ground	W	50	30	20	35	-15	15	Standard thermal glazing	37	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B62-63	Ground	S	55.4	30	25.4	35	-9.6	20	Standard thermal glazing	42.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B62-63	Ground	E	50.6	30	20.6	35	-14.4	16	Standard thermal glazing	37.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B62-63	Ground	N	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B62-63	Ground	W	49.7	30	19.7	35	-15.3	15	Standard thermal glazing	36.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B64-66	Ground	E	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B64-66	Ground	S	56	30	26	35	-9	21	Standard thermal glazing	43	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B64-66	Ground	W	50.1	30	20.1	35	-14.9	15	Standard thermal glazing	37.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B64-66	Ground	N	52.4	30	22.4	35	-12.6	17	Standard thermal glazing	39.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B67	Ground	S	57.9	30	27.9	35	-7.1	23	Standard thermal glazing	44.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B67	Ground	E	59.4	30	29.4	35	-5.6	24	Standard thermal glazing	46.4	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B67	Ground	N	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B67	Ground	W	52.1	30	22.1	35	-12.9	17	Standard thermal glazing	39.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B68	Ground	N	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B68	Ground	E	56.2	30	26.2	35	-8.8	21	Standard thermal glazing	43.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B68	Ground	S	55.4	30	25.4	35	-9.6	20	Standard thermal glazing	42.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B68	Ground	W	51.6	30	21.6	35	-13.4	17	Standard thermal glazing	38.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B69	Ground	E	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B69	Ground	S	55.2	30	25.2	35	-9.8	20	Standard thermal glazing	42.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B69	Ground	W	49.5	30	19.5	35	-15.5	15	Standard thermal glazing	36.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B69	Ground	N	52.5	30	22.5	35	-12.5	18	Standard thermal glazing	39.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B70	Ground	N	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B70	Ground	W	49.7	30	19.7	35	-15.3	15	Standard thermal glazing	36.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B70	Ground	S	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B70	Ground	E	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B71-72	Ground	N	51.7	30	21.7	35	-13.3	17	Standard thermal glazing	38.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B71-72	Ground	W	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B71-72	Ground	S	55.2	30	25.2	35	-9.8	20	Standard thermal glazing	42.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B71-72	Ground	E	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B73	Ground	E	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B73	Ground	S	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B73	Ground	W	49.3	30	19.3	35	-15.7	14	Standard thermal glazing	36.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B73	Ground	N	51.1	30	21.1	35	-13.9	16	Standard thermal glazing	38.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B74-75	Ground	N	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B74-75	Ground	W	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B74-75	Ground	S	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B74-75	Ground	E	49.7	30	19.7	35	-15.3	15	Standard thermal glazing	36.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B76	Ground	E	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B76	Ground	S	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B76	Ground	W	49.3	30	19.3	35	-15.7	14	Standard thermal glazing	36.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B76	Ground	N	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B77	Ground	E	49.2	30	19.2	35	-15.8	14	Standard thermal glazing	36.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B77	Ground	S	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B77	Ground	W	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B77	Ground	N	50.1	30	20.1	35	-14.9	15	Standard thermal glazing	37.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B78	Ground	S	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B78	Ground	W	52.5	30	22.5	35	-12.5	18	Standard thermal glazing	39.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B78	Ground	N	49.7	30	19.7	35	-15.3	15	Standard thermal glazing	36.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B78	Ground	E	52.9	30	22.9	35	-12.1	18	Standard thermal glazing	39.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B79	Ground	S	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B79	Ground	E	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B79	Ground	N	49.1	30	19.1	35	-15.9	14	Standard thermal glazing	36.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B79	Ground	W	52.4	30	22.4	35	-12.6	17	Standard thermal glazing	39.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B80-81	Ground	S	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B80-81	Ground	E	49.4	30	19.4	35	-15.6	14	Standard thermal glazing	36.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B80-81	Ground	N	49.3	30	19.3	35	-15.7	14	Standard thermal glazing	36.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B80-81	Ground	W	52.2	30	22.2	35	-12.8	17	Standard thermal glazing	39.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B82	Ground	S	54.3	30	24.3	35	-10.7	19	Standard thermal glazing	41.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B82	Ground	W	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B82	Ground	N	49.5	30	19.5	35	-15.5	15	Standard thermal glazing	36.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B82	Ground	E	49.2	30	19.2	35	-15.8	14	Standard thermal glazing	36.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B83	Ground	E	49.1	30	19.1	35	-15.9	14	Standard thermal glazing	36.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B83	Ground	S	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B83	Ground	W	48.9	30	18.9	35	-16.1	14	Standard thermal glazing	35.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B83	Ground	N	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B84	Ground	E	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B84	Ground	S	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B84	Ground	W	49.3	30	19.3	35	-15.7	14	Standard thermal glazing	36.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B84	Ground	N	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B85-86	Ground	S	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B85-86	Ground	E	50.3	30	20.3	35	-14.7	15	Standard thermal glazing	37.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B85-86	Ground	N	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B85-86	Ground	W	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B87-88	Ground	S	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B87-88	Ground	E	49.7	30	19.7	35	-15.3	15	Standard thermal glazing	36.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B87-88	Ground	N	50.1	30	20.1	35	-14.9	15	Standard thermal glazing	37.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B87-88	Ground	W	50.2	30	20.2	35	-14.8	15	Standard thermal glazing	37.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B89	Ground	S	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B89	Ground	E	49.3	30	19.3	35	-15.7	14	Standard thermal glazing	36.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B89	Ground	N	50.1	30	20.1	35	-14.9	15	Standard thermal glazing	37.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B89	Ground	W	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B90	Ground	S	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B90	Ground	E	48.9	30	18.9	35	-16.1	14	Standard thermal glazing	35.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B90	Ground	N	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B90	Ground	W	49.2	30	19.2	35	-15.8	14	Standard thermal glazing	36.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B91	Ground	E	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B91	Ground	N	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B91	Ground	W	49.8	30	19.8	35	-15.2	15	Standard thermal glazing	36.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B91	Ground	S	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B92	Ground	E	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B92	Ground	S	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B92	Ground	W	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B92	Ground	N	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B93	Ground	S	52.7	30	22.7	35	-12.3	18	Standard thermal glazing	39.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B93	Ground	W	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B93	Ground	N	49.7	30	19.7	35	-15.3	15	Standard thermal glazing	36.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B93	Ground	E	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B94	Ground	E	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B94	Ground	S	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B94	Ground	W	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B94	Ground	N	49	30	19	35	-16	14	Standard thermal glazing	36	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B95- 97	Ground	E	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B95- 97	Ground	S	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B95- 97	Ground	W	51.7	30	21.7	35	-13.3	17	Standard thermal glazing	38.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B95- 97	Ground	N	50	30	20	35	-15	15	Standard thermal glazing	37	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B98	Ground	S	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B98	Ground	W	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B98	Ground	N	50.1	30	20.1	35	-14.9	15	Standard thermal glazing	37.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B99-100	Ground	E	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B99-100	Ground	S	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B99-100	Ground	W	50.1	30	20.1	35	-14.9	15	Standard thermal glazing	37.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B99-100	Ground	N	50.2	30	20.2	35	-14.8	15	Standard thermal glazing	37.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B101-102	Ground	E	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B101-102	Ground	S	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B101-102	Ground	W	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B101-102	Ground	N	50.3	30	20.3	35	-14.7	15	Standard thermal glazing	37.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B103	Ground	N	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B103	Ground	W	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B103	Ground	S	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B103	Ground	E	52.9	30	22.9	35	-12.1	18	Standard thermal glazing	39.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B104	Ground	S	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B104	Ground	E	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B104	Ground	N	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B104	Ground	W	51.7	30	21.7	35	-13.3	17	Standard thermal glazing	38.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B105	Ground	E	55.2	30	25.2	35	-9.8	20	Standard thermal glazing	42.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B105	Ground	S	55.7	30	25.7	35	-9.3	21	Standard thermal glazing	42.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B105	Ground	W	53.1	30	23.1	35	-11.9	18	Standard thermal glazing	40.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B105	Ground	N	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B106	Ground	NE	57.7	30	27.7	35	-7.3	23	Standard thermal glazing	44.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B106	Ground	SE	57.6	30	27.6	35	-7.4	23	Standard thermal glazing	44.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B106	Ground	SW	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B106	Ground	NW	52.4	30	22.4	35	-12.6	17	Standard thermal glazing	39.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B107-108	Ground	SW	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B107-108	Ground	SE	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B107-108	Ground	NE	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B107-108	Ground	NW	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B109	Ground	SW	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B109	Ground	SE	53.7	30	23.7	35	-11.3	19	Standard thermal glazing	40.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B109	Ground	NE	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B109	Ground	NW	51.7	30	21.7	35	-13.3	17	Standard thermal glazing	38.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B110-111	Ground	NE	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B110-111	Ground	SE	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B110-111	Ground	SW	53.9	30	23.9	35	-11.1	19	Standard thermal glazing	40.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B110-111	Ground	NW	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B112	Ground	NE	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B112	Ground	SE	53.1	30	23.1	35	-11.9	18	Standard thermal glazing	40.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B112	Ground	SW	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B112	Ground	NW	51.7	30	21.7	35	-13.3	17	Standard thermal glazing	38.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B113-114	Ground	NE	55.7	30	25.7	35	-9.3	21	Standard thermal glazing	42.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B113-114	Ground	SE	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B113-114	Ground	SW	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B113-114	Ground	NW	51.3	30	21.3	35	-13.7	16	Standard thermal glazing	38.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B115-116	Ground	NE	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B115-116	Ground	SE	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B115-116	Ground	SW	53.5	30	23.5	35	-11.5	19	Standard thermal glazing	40.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B115-116	Ground	NW	51.3	30	21.3	35	-13.7	16	Standard thermal glazing	38.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B117	Ground	SW	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B117	Ground	SE	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B117	Ground	NE	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B117	Ground	NW	51.7	30	21.7	35	-13.3	17	Standard thermal glazing	38.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B118-120	Ground	SE	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B118-120	Ground	SW	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B118-120	Ground	NW	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B118-120	Ground	NE	56.2	30	26.2	35	-8.8	21	Standard thermal glazing	43.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B121-122	Ground	NE	56.3	30	26.3	35	-8.7	21	Standard thermal glazing	43.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B121-122	Ground	SE	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B121-122	Ground	SW	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B121-122	Ground	NW	51.3	30	21.3	35	-13.7	16	Standard thermal glazing	38.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B123-124	Ground	NE	56.5	30	26.5	35	-8.5	22	Standard thermal glazing	43.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B123-124	Ground	SE	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B123-124	Ground	SW	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B123-124	Ground	NW	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B125	Ground	N	53	30	23	35	-12	18	Standard thermal glazing	40	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B125	Ground	W	53.1	30	23.1	35	-11.9	18	Standard thermal glazing	40.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B125	Ground	SE	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B125	Ground	E	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B126-127	Ground	E	57.1	30	27.1	35	-7.9	22	Standard thermal glazing	44.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B126-127	Ground	N	58.5	30	28.5	35	-6.5	24	Standard thermal glazing	45.5	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B126-127	Ground	W	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B126-127	Ground	S	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B128	Ground	W	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B128	Ground	S	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B128	Ground	E	63.4	30	33.4	35	-1.6	28	Standard thermal glazing	50.4	Yes	ADF System 4	MVHR without T.V.
Plot B128	Ground	N	62.4	30	32.4	35	-2.6	27	Standard thermal glazing	49.4	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B129	Ground	SW	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B129	Ground	SE	60.9	30	30.9	35	-4.1	26	Standard thermal glazing	47.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B129	Ground	NE	64.9	30	34.9	35	-0.1	30	Standard thermal glazing	51.9	Yes	ADF System 4	MVHR without T.V.
Plot B129	Ground	NW	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B130-131	Ground	NE	65.8	30	35.8	35	0.8	31	Upgraded glazing	52.8	Yes	ADF System 4	MVHR without T.V.
Plot B130-131	Ground	SE	61.6	30	31.6	35	-3.4	27	Standard thermal glazing	48.6	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B130-131	Ground	SW	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B130-131	Ground	NW	57	30	27	35	-8	22	Standard thermal glazing	44	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B132-133	Ground	NE	66	30	36	35	1	31	Upgraded glazing	53	Yes	ADF System 4	MVHR without T.V.
Plot B132-133	Ground	SE	60.8	30	30.8	35	-4.2	26	Standard thermal glazing	47.8	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B132-133	Ground	SW	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B132-133	Ground	NW	59.9	30	29.9	35	-5.1	25	Standard thermal glazing	46.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B134-135	Ground	NE	65.5	30	35.5	35	0.5	31	Upgraded glazing	52.5	Yes	ADF System 4	MVHR without T.V.
Plot B134-135	Ground	SE	57.2	30	27.2	35	-7.8	22	Standard thermal glazing	44.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B134-135	Ground	SW	53.5	30	23.5	35	-11.5	19	Standard thermal glazing	40.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B134-135	Ground	NW	59.4	30	29.4	35	-5.6	24	Standard thermal glazing	46.4	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B136-137	Ground	NE	64.2	30	34.2	35	-0.8	29	Standard thermal glazing	51.2	Yes	ADF System 4	MVHR without T.V.
Plot B136-137	Ground	SE	56.9	30	26.9	35	-8.1	22	Standard thermal glazing	43.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B136-137	Ground	SW	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B136-137	Ground	NW	56.4	30	26.4	35	-8.6	21	Standard thermal glazing	43.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B138-139	Ground	NE	63.5	30	33.5	35	-1.5	29	Standard thermal glazing	50.5	Yes	ADF System 4	MVHR without T.V.
Plot B138-139	Ground	SE	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B138-139	Ground	SW	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B138-139	Ground	NW	52.7	30	22.7	35	-12.3	18	Standard thermal glazing	39.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B140-141	Ground	NE	63.6	30	33.6	35	-1.4	29	Standard thermal glazing	50.6	Yes	ADF System 4	MVHR without T.V.
Plot B140-141	Ground	SE	54.6	30	24.6	35	-10.4	20	Standard thermal glazing	41.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B140-141	Ground	SW	53.9	30	23.9	35	-11.1	19	Standard thermal glazing	40.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B140-141	Ground	NW	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B142-143	Ground	NE	63.8	30	33.8	35	-1.2	29	Standard thermal glazing	50.8	Yes	ADF System 4	MVHR without T.V.
Plot B142-143	Ground	SE	58.8	30	28.8	35	-6.2	24	Standard thermal glazing	45.8	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B142-143	Ground	SW	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B142-143	Ground	NW	56.2	30	26.2	35	-8.8	21	Standard thermal glazing	43.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B144	Ground	S	59.8	30	29.8	35	-5.2	25	Standard thermal glazing	46.8	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B144	Ground	E	63.6	30	33.6	35	-1.4	29	Standard thermal glazing	50.6	Yes	ADF System 4	MVHR without T.V.
Plot B144	Ground	NE	63.9	30	33.9	35	-1.1	29	Standard thermal glazing	50.9	Yes	ADF System 4	MVHR without T.V.
Plot B144	Ground	NW	59	30	29	35	-6	24	Standard thermal glazing	46	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B144	Ground	SW	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B145	Ground	SW	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B145	Ground	SE	60.8	30	30.8	35	-4.2	26	Standard thermal glazing	47.8	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B145	Ground	E	62.3	30	32.3	35	-2.7	27	Standard thermal glazing	49.3	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B145	Ground	N	57.3	30	27.3	35	-7.7	22	Standard thermal glazing	44.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B145	Ground	W	52.2	30	22.2	35	-12.8	17	Standard thermal glazing	39.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B146	Ground	E	58.4	30	28.4	35	-6.6	23	Standard thermal glazing	45.4	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B146	Ground	N	64.3	30	34.3	35	-0.7	29	Standard thermal glazing	51.3	Yes	ADF System 4	MVHR without T.V.
Plot B146	Ground	NW	60.2	30	30.2	35	-4.8	25	Standard thermal glazing	47.2	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B146	Ground	SW	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B146	Ground	S	55.7	30	25.7	35	-9.3	21	Standard thermal glazing	42.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B147	Ground	NE	69.2	30	39.2	35	4.2	34	Upgraded glazing	56.2	Yes	ADF System 4	MVHR without T.V.
Plot B147	Ground	SE	67.8	30	37.8	35	2.8	33	Upgraded glazing	54.8	Yes	ADF System 4	MVHR without T.V.
Plot B147	Ground	S	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B147	Ground	W	57.4	30	27.4	35	-7.6	22	Standard thermal glazing	44.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B147	Ground	N	65.8	30	35.8	35	0.8	31	Upgraded glazing	52.8	Yes	ADF System 4	MVHR without T.V.
Plot B148-149	Ground	NE	68.9	30	38.9	35	3.9	34	Upgraded glazing	55.9	Yes	ADF System 4	MVHR without T.V.
Plot B148-149	Ground	SE	56.8	30	26.8	35	-8.2	22	Standard thermal glazing	43.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B148-149	Ground	SW	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B148-149	Ground	NW	59.9	30	29.9	35	-5.1	25	Standard thermal glazing	46.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B150-151	Ground	NE	69.9	30	39.9	35	4.9	35	Upgraded glazing	56.9	Yes	ADF System 4	MVHR without T.V.
Plot B150-151	Ground	SE	64.9	30	34.9	35	-0.1	30	Standard thermal glazing	51.9	Yes	ADF System 4	MVHR without T.V.
Plot B150-151	Ground	SW	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B150-151	Ground	NW	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B152	Ground	NE	70.5	30	40.5	35	5.5	36	Upgraded glazing	57.5	Yes	ADF System 4	MVHR without T.V.
Plot B152	Ground	SE	62.9	30	32.9	35	-2.1	28	Standard thermal glazing	49.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B152	Ground	SW	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B152	Ground	NW	64.3	30	34.3	35	-0.7	29	Standard thermal glazing	51.3	Yes	ADF System 4	MVHR without T.V.
Plot B153-154	Ground	NE	70.2	30	40.2	35	5.2	35	Upgraded glazing	57.2	Yes	ADF System 4	MVHR without T.V.
Plot B153-154	Ground	SE	62.8	30	32.8	35	-2.2	28	Standard thermal glazing	49.8	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B153-154	Ground	SW	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B153-154	Ground	NW	61.7	30	31.7	35	-3.3	27	Standard thermal glazing	48.7	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B155-156	Ground	SW	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B155-156	Ground	SE	62.1	30	32.1	35	-2.9	27	Standard thermal glazing	49.1	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B155-156	Ground	NE	70	30	40	35	5	35	Upgraded glazing	57	Yes	ADF System 4	MVHR without T.V.
Plot B155-156	Ground	NW	54.3	30	24.3	35	-10.7	19	Standard thermal glazing	41.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B157-158	Ground	NE	70.5	30	40.5	35	5.5	36	Upgraded glazing	57.5	Yes	ADF System 4	MVHR without T.V.
Plot B157-158	Ground	SE	56.4	30	26.4	35	-8.6	21	Standard thermal glazing	43.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B157-158	Ground	SW	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B157-158	Ground	NW	62.2	30	32.2	35	-2.8	27	Standard thermal glazing	49.2	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B159-160	Ground	SW	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B159-160	Ground	SE	62.3	30	32.3	35	-2.7	27	Standard thermal glazing	49.3	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B159-160	Ground	NE	69.6	30	39.6	35	4.6	35	Upgraded glazing	56.6	Yes	ADF System 4	MVHR without T.V.
Plot B159-160	Ground	NW	61.5	30	31.5	35	-3.5	27	Standard thermal glazing	48.5	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B161-162	Ground	SE	63.9	30	33.9	35	-1.1	29	Standard thermal glazing	50.9	Yes	ADF System 4	MVHR without T.V.
Plot B161-162	Ground	NE	70.1	30	40.1	35	5.1	35	Upgraded glazing	57.1	Yes	ADF System 4	MVHR without T.V.
Plot B161-162	Ground	NW	62.4	30	32.4	35	-2.6	27	Standard thermal glazing	49.4	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B161-162	Ground	SW	56.4	30	26.4	35	-8.6	21	Standard thermal glazing	43.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B163-164	Ground	SE	60.7	30	30.7	35	-4.3	26	Standard thermal glazing	47.7	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B163-164	Ground	NE	69.5	30	39.5	35	4.5	35	Upgraded glazing	56.5	Yes	ADF System 4	MVHR without T.V.
Plot B163-164	Ground	NW	55.4	30	25.4	35	-9.6	20	Standard thermal glazing	42.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B163-164	Ground	SW	56.4	30	26.4	35	-8.6	21	Standard thermal glazing	43.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B165-166	Ground	NE	68	30	38	35	3	33	Upgraded glazing	55	Yes	ADF System 4	MVHR without T.V.
Plot B165-166	Ground	SE	57.4	30	27.4	35	-7.6	22	Standard thermal glazing	44.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B165-166	Ground	SW	56.7	30	26.7	35	-8.3	22	Standard thermal glazing	43.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B165-166	Ground	NW	61.8	30	31.8	35	-3.2	27	Standard thermal glazing	48.8	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B167	Ground	NE	66.4	30	36.4	35	1.4	31	Upgraded glazing	53.4	Yes	ADF System 4	MVHR without T.V.
Plot B167	Ground	SE	57.3	30	27.3	35	-7.7	22	Standard thermal glazing	44.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B167	Ground	SW	56.6	30	26.6	35	-8.4	22	Standard thermal glazing	43.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B167	Ground	NW	56.3	30	26.3	35	-8.7	21	Standard thermal glazing	43.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B168	Ground	NE	65	30	35	35	0	30	Standard thermal glazing	52	Yes	ADF System 4	MVHR without T.V.
Plot B168	Ground	SE	57.6	30	27.6	35	-7.4	23	Standard thermal glazing	44.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B168	Ground	SW	56.2	30	26.2	35	-8.8	21	Standard thermal glazing	43.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B168	Ground	NW	56.2	30	26.2	35	-8.8	21	Standard thermal glazing	43.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B169	Ground	NE	65.7	30	35.7	35	0.7	31	Upgraded glazing	52.7	Yes	ADF System 4	MVHR without T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B169	Ground	E	64.8	30	34.8	35	-0.2	30	Standard thermal glazing	51.8	Yes	ADF System 4	MVHR without T.V.
Plot B169	Ground	S	61.3	30	31.3	35	-3.7	26	Standard thermal glazing	48.3	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B169	Ground	SW	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B169	Ground	NW	63.2	30	33.2	35	-1.8	28	Standard thermal glazing	50.2	Yes	ADF System 4	MVHR without T.V.
Plot B170	Ground	N	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B170	Ground	E	65.1	30	35.1	35	0.1	30	Standard thermal glazing	52.1	Yes	ADF System 4	MVHR without T.V.
Plot B170	Ground	SE	65.9	30	35.9	35	0.9	31	Upgraded glazing	52.9	Yes	ADF System 4	MVHR without T.V.
Plot B170	Ground	SW	59.2	30	29.2	35	-5.8	24	Standard thermal glazing	46.2	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B170	Ground	W	52.9	30	22.9	35	-12.1	18	Standard thermal glazing	39.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B171	Ground	NE	62.3	30	32.3	35	-2.7	27	Standard thermal glazing	49.3	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B171	Ground	NW	54.3	30	24.3	35	-10.7	19	Standard thermal glazing	41.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B171	Ground	SW	56.3	30	26.3	35	-8.7	21	Standard thermal glazing	43.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B171	Ground	SE	65.3	30	35.3	35	0.3	30	Standard thermal glazing	52.3	Yes	ADF System 4	MVHR without T.V.
Plot C1-2	Ground	SW	48.9	30	18.9	35	-16.1	14	Standard thermal glazing	35.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C1-2	Ground	SE	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C1-2	Ground	NE	48.2	30	18.2	35	-16.8	13	Standard thermal glazing	35.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C1-2	Ground	NW	52.1	30	22.1	35	-12.9	17	Standard thermal glazing	39.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C3-4	Ground	NE	48.4	30	18.4	35	-16.6	13	Standard thermal glazing	35.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C3-4	Ground	SE	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C3-4	Ground	SW	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C3-4	Ground	NW	52.2	30	22.2	35	-12.8	17	Standard thermal glazing	39.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C5	Ground	NE	49.5	30	19.5	35	-15.5	15	Standard thermal glazing	36.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C5	Ground	SE	56.2	30	26.2	35	-8.8	21	Standard thermal glazing	43.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C5	Ground	SW	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C5	Ground	NW	52.1	30	22.1	35	-12.9	17	Standard thermal glazing	39.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C6	Ground	NE	49.5	30	19.5	35	-15.5	15	Standard thermal glazing	36.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C6	Ground	SE	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C6	Ground	SW	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C6	Ground	NW	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C7-8	Ground	SE	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C7-8	Ground	NE	49.8	30	19.8	35	-15.2	15	Standard thermal glazing	36.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C7-8	Ground	NW	48.9	30	18.9	35	-16.1	14	Standard thermal glazing	35.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C7-8	Ground	SW	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C9-11	Ground	SE	53.7	30	23.7	35	-11.3	19	Standard thermal glazing	40.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C9-11	Ground	SW	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C9-11	Ground	NW	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C9-11	Ground	NE	47.7	30	17.7	35	-17.3	13	Standard thermal glazing	34.7	No	N/A	Alt. Vent. not Required
Plot C12	Ground	SE	53.5	30	23.5	35	-11.5	19	Standard thermal glazing	40.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C12	Ground	SW	55.2	30	25.2	35	-9.8	20	Standard thermal glazing	42.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C12	Ground	NW	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C12	Ground	NE	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C13-14	Ground	SW	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C13-14	Ground	SE	52.7	30	22.7	35	-12.3	18	Standard thermal glazing	39.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C13-14	Ground	NE	49.5	30	19.5	35	-15.5	15	Standard thermal glazing	36.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C13-14	Ground	NW	51.1	30	21.1	35	-13.9	16	Standard thermal glazing	38.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C15	Ground	S	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C15	Ground	E	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C15	Ground	N	49	30	19	35	-16	14	Standard thermal glazing	36	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C15	Ground	W	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C16-17	Ground	S	53.7	30	23.7	35	-11.3	19	Standard thermal glazing	40.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C16-17	Ground	E	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C16-17	Ground	N	48.6	30	18.6	35	-16.4	14	Standard thermal glazing	35.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C16-17	Ground	W	51.2	30	21.2	35	-13.8	16	Standard thermal glazing	38.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C18-19	Ground	E	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C18-19	Ground	N	47.9	30	17.9	35	-17.1	13	Standard thermal glazing	34.9	No	N/A	Alt. Vent. not Required
Plot C18-19	Ground	W	51.7	30	21.7	35	-13.3	17	Standard thermal glazing	38.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C20	Ground	E	50.2	30	20.2	35	-14.8	15	Standard thermal glazing	37.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C20	Ground	N	47.7	30	17.7	35	-17.3	13	Standard thermal glazing	34.7	No	N/A	Alt. Vent. not Required
Plot C20	Ground	W	50.1	30	20.1	35	-14.9	15	Standard thermal glazing	37.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C20	Ground	S	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C21-23	Ground	E	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C21-23	Ground	S	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C21-23	Ground	SW	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C21-23	Ground	NW	47.7	30	17.7	35	-17.3	13	Standard thermal glazing	34.7	No	N/A	Alt. Vent. not Required
Plot C24	Ground	NE	53.7	30	23.7	35	-11.3	19	Standard thermal glazing	40.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C24	Ground	N	47.9	30	17.9	35	-17.1	13	Standard thermal glazing	34.9	No	N/A	Alt. Vent. not Required
Plot C24	Ground	W	52.9	30	22.9	35	-12.1	18	Standard thermal glazing	39.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C24	Ground	SE	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C25	Ground	E	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C25	Ground	S	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C25	Ground	W	52.7	30	22.7	35	-12.3	18	Standard thermal glazing	39.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C25	Ground	N	48.2	30	18.2	35	-16.8	13	Standard thermal glazing	35.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C26-27	Ground	SE	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C26-27	Ground	SW	49.4	30	19.4	35	-15.6	14	Standard thermal glazing	36.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C26-27	Ground	NW	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C26-27	Ground	NE	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C28-29	Ground	SE	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C28-29	Ground	SW	50	30	20	35	-15	15	Standard thermal glazing	37	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C28-29	Ground	NW	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C28-29	Ground	NE	47.6	30	17.6	35	-17.4	13	Standard thermal glazing	34.6	No	N/A	Alt. Vent. not Required
Plot C30	Ground	SE	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C30	Ground	SW	56.3	30	26.3	35	-8.7	21	Standard thermal glazing	43.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C30	Ground	NW	54.3	30	24.3	35	-10.7	19	Standard thermal glazing	41.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C30	Ground	NE	50	30	20	35	-15	15	Standard thermal glazing	37	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C31-33	Ground	E	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C31-33	Ground	S	54.3	30	24.3	35	-10.7	19	Standard thermal glazing	41.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C31-33	Ground	W	53.9	30	23.9	35	-11.1	19	Standard thermal glazing	40.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C31-33	Ground	N	49.7	30	19.7	35	-15.3	15	Standard thermal glazing	36.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C34	Ground	E	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C34	Ground	S	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C34	Ground	W	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C34	Ground	N	49	30	19	35	-16	14	Standard thermal glazing	36	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C35-36	Ground	E	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C35-36	Ground	S	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C35-36	Ground	W	50	30	20	35	-15	15	Standard thermal glazing	37	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C35-36	Ground	N	48.8	30	18.8	35	-16.2	14	Standard thermal glazing	35.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C37-38	Ground	N	48.7	30	18.7	35	-16.3	14	Standard thermal glazing	35.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C37-38	Ground	E	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C37-38	Ground	S	55.2	30	25.2	35	-9.8	20	Standard thermal glazing	42.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C37-38	Ground	W	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C39	Ground	S	54.3	30	24.3	35	-10.7	19	Standard thermal glazing	41.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C39	Ground	W	52.7	30	22.7	35	-12.3	18	Standard thermal glazing	39.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C39	Ground	N	47.9	30	17.9	35	-17.1	13	Standard thermal glazing	34.9	No	N/A	Alt. Vent. not Required
Plot C39	Ground	E	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C40-42	Ground	E	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C40-42	Ground	SE	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C40-42	Ground	W	50.2	30	20.2	35	-14.8	15	Standard thermal glazing	37.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C40-42	Ground	NW	48.2	30	18.2	35	-16.8	13	Standard thermal glazing	35.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C43	Ground	SE	55.4	30	25.4	35	-9.6	20	Standard thermal glazing	42.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C43	Ground	NE	49.5	30	19.5	35	-15.5	15	Standard thermal glazing	36.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C43	Ground	NW	48.5	30	18.5	35	-16.5	14	Standard thermal glazing	35.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C43	Ground	W	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C44-45	Ground	NW	48.7	30	18.7	35	-16.3	14	Standard thermal glazing	35.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C44-45	Ground	NE	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C44-45	Ground	SE	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C44-45	Ground	SW	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C46-47	Ground	W	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C46-47	Ground	S	56	30	26	35	-9	21	Standard thermal glazing	43	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C46-47	Ground	E	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C46-47	Ground	N	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C48-49	Ground	W	49.7	30	19.7	35	-15.3	15	Standard thermal glazing	36.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C48-49	Ground	S	54.6	30	24.6	35	-10.4	20	Standard thermal glazing	41.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C48-49	Ground	E	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C48-49	Ground	N	50	30	20	35	-15	15	Standard thermal glazing	37	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C50	Ground	N	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C50	Ground	W	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C50	Ground	S	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C51	Ground	E	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C51	Ground	S	54.6	30	24.6	35	-10.4	20	Standard thermal glazing	41.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C51	Ground	W	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C51	Ground	N	49.7	30	19.7	35	-15.3	15	Standard thermal glazing	36.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C52-54	Ground	E	49.2	30	19.2	35	-15.8	14	Standard thermal glazing	36.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C52-54	Ground	S	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C52-54	Ground	W	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C52-54	Ground	N	50.1	30	20.1	35	-14.9	15	Standard thermal glazing	37.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C55	Ground	E	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C55	Ground	N	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C55	Ground	W	49.3	30	19.3	35	-15.7	14	Standard thermal glazing	36.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C55	Ground	S	55.2	30	25.2	35	-9.8	20	Standard thermal glazing	42.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C56-58	Ground	NE	50.6	30	20.6	35	-14.4	16	Standard thermal glazing	37.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C56-58	Ground	SE	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C56-58	Ground	SW	51.6	30	21.6	35	-13.4	17	Standard thermal glazing	38.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C56-58	Ground	NW	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C59-60	Ground	NE	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C59-60	Ground	SE	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C59-60	Ground	SW	50.3	30	20.3	35	-14.7	15	Standard thermal glazing	37.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C59-60	Ground	NW	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C61	Ground	NW	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C61	Ground	SW	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C61	Ground	SE	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C62	Ground	NE	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C62	Ground	SE	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C62	Ground	SW	50.2	30	20.2	35	-14.8	15	Standard thermal glazing	37.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C62	Ground	NW	51.6	30	21.6	35	-13.4	17	Standard thermal glazing	38.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C63	Ground	S	52.5	30	22.5	35	-12.5	18	Standard thermal glazing	39.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C63	Ground	W	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C63	Ground	N	50.2	30	20.2	35	-14.8	15	Standard thermal glazing	37.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C63	Ground	E	53.1	30	23.1	35	-11.9	18	Standard thermal glazing	40.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C64	Ground	W	56.3	30	26.3	35	-8.7	21	Standard thermal glazing	43.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C64	Ground	S	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C64	Ground	E	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C64	Ground	N	49.4	30	19.4	35	-15.6	14	Standard thermal glazing	36.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C65	Ground	S	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C65	Ground	W	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C65	Ground	N	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C66-67	Ground	E	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C66-67	Ground	S	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C66-67	Ground	W	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C66-67	Ground	N	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C68	Ground	E	50.3	30	20.3	35	-14.7	15	Standard thermal glazing	37.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C68	Ground	S	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C68	Ground	W	50.2	30	20.2	35	-14.8	15	Standard thermal glazing	37.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C68	Ground	N	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C69-70	Ground	E	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C69-70	Ground	S	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C69-70	Ground	W	50.6	30	20.6	35	-14.4	16	Standard thermal glazing	37.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C69-70	Ground	N	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C71	Ground	E	50.6	30	20.6	35	-14.4	16	Standard thermal glazing	37.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C71	Ground	S	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C71	Ground	W	50.6	30	20.6	35	-14.4	16	Standard thermal glazing	37.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C71	Ground	N	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C72-73	Ground	NE	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C72-73	Ground	SE	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C72-73	Ground	SW	51.2	30	21.2	35	-13.8	16	Standard thermal glazing	38.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C72-73	Ground	NW	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C74	Ground	NW	51.1	30	21.1	35	-13.9	16	Standard thermal glazing	38.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C74	Ground	SW	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C74	Ground	SE	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C74	Ground	NE	50.6	30	20.6	35	-14.4	16	Standard thermal glazing	37.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C75-76	Ground	NE	52.5	30	22.5	35	-12.5	18	Standard thermal glazing	39.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C75-76	Ground	SE	55.7	30	25.7	35	-9.3	21	Standard thermal glazing	42.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C75-76	Ground	SW	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C75-76	Ground	NW	51.2	30	21.2	35	-13.8	16	Standard thermal glazing	38.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C77-78	Ground	NE	55.2	30	25.2	35	-9.8	20	Standard thermal glazing	42.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C77-78	Ground	SE	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C77-78	Ground	SW	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C77-78	Ground	NW	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C79-80	Ground	SW	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C79-80	Ground	SE	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C79-80	Ground	NE	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C79-80	Ground	NW	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C81	Ground	NE	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C81	Ground	SE	55.7	30	25.7	35	-9.3	21	Standard thermal glazing	42.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C81	Ground	SW	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C81	Ground	NW	52.5	30	22.5	35	-12.5	18	Standard thermal glazing	39.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C82-83	Ground	NE	56.2	30	26.2	35	-8.8	21	Standard thermal glazing	43.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C82-83	Ground	SE	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C82-83	Ground	SW	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C82-83	Ground	NW	53	30	23	35	-12	18	Standard thermal glazing	40	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C84-85	Ground	NE	56	30	26	35	-9	21	Standard thermal glazing	43	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C84-85	Ground	SE	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C84-85	Ground	SW	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C84-85	Ground	NW	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C86	Ground	NE	56	30	26	35	-9	21	Standard thermal glazing	43	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C86	Ground	SE	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C86	Ground	SW	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C86	Ground	NW	52.1	30	22.1	35	-12.9	17	Standard thermal glazing	39.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C87-89	Ground	SW	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C87-89	Ground	SE	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C87-89	Ground	NE	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C87-89	Ground	NW	52.3	30	22.3	35	-12.7	17	Standard thermal glazing	39.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C90	Ground	NE	56.4	30	26.4	35	-8.6	21	Standard thermal glazing	43.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C90	Ground	SE	53.9	30	23.9	35	-11.1	19	Standard thermal glazing	40.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C90	Ground	SW	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C90	Ground	NW	52.3	30	22.3	35	-12.7	17	Standard thermal glazing	39.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C91-92	Ground	NE	56.5	30	26.5	35	-8.5	22	Standard thermal glazing	43.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C91-92	Ground	SE	54.6	30	24.6	35	-10.4	20	Standard thermal glazing	41.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C91-92	Ground	SW	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C91-92	Ground	NW	52.2	30	22.2	35	-12.8	17	Standard thermal glazing	39.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C93	Ground	NE	56.6	30	26.6	35	-8.4	22	Standard thermal glazing	43.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C93	Ground	SE	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C93	Ground	SW	56.2	30	26.2	35	-8.8	21	Standard thermal glazing	43.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C93	Ground	NW	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C94-95	Ground	NE	56.6	30	26.6	35	-8.4	22	Standard thermal glazing	43.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C94-95	Ground	SE	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C94-95	Ground	SW	56	30	26	35	-9	21	Standard thermal glazing	43	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C94-95	Ground	NW	52.3	30	22.3	35	-12.7	17	Standard thermal glazing	39.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C96-98	Ground	SW	55.4	30	25.4	35	-9.6	20	Standard thermal glazing	42.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C96-98	Ground	SE	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C96-98	Ground	NE	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C99	Ground	NW	52.4	30	22.4	35	-12.6	17	Standard thermal glazing	39.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C99	Ground	NE	56.7	30	26.7	35	-8.3	22	Standard thermal glazing	43.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C99	Ground	SE	53.9	30	23.9	35	-11.1	19	Standard thermal glazing	40.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C99	Ground	SW	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C100-101	Ground	SW	55.4	30	25.4	35	-9.6	20	Standard thermal glazing	42.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C100-101	Ground	SE	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C100-101	Ground	NE	57.4	30	27.4	35	-7.6	22	Standard thermal glazing	44.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C100-101	Ground	NW	52.2	30	22.2	35	-12.8	17	Standard thermal glazing	39.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C102-103	Ground	E	58.6	30	28.6	35	-6.4	24	Standard thermal glazing	45.6	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C102-103	Ground	S	56.6	30	26.6	35	-8.4	22	Standard thermal glazing	43.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C102-103	Ground	W	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C102-103	Ground	N	52.4	30	22.4	35	-12.6	17	Standard thermal glazing	39.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C104	Ground	E	60.3	30	30.3	35	-4.7	25	Standard thermal glazing	47.3	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C104	Ground	SE	61.6	30	31.6	35	-3.4	27	Standard thermal glazing	48.6	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C104	Ground	SW	57.8	30	27.8	35	-7.2	23	Standard thermal glazing	44.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C104	Ground	W	53.9	30	23.9	35	-11.1	19	Standard thermal glazing	40.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C104	Ground	N	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C105	Ground	SE	61.6	30	31.6	35	-3.4	27	Standard thermal glazing	48.6	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C105	Ground	S	63.7	30	33.7	35	-1.3	29	Standard thermal glazing	50.7	Yes	ADF System 4	MVHR without T.V.
Plot C105	Ground	W	58.9	30	28.9	35	-6.1	24	Standard thermal glazing	45.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C105	Ground	N	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C105	Ground	NE	58.2	30	28.2	35	-6.8	23	Standard thermal glazing	45.2	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C106	Ground	E	60.2	30	30.2	35	-4.8	25	Standard thermal glazing	47.2	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C106	Ground	S	64.4	30	34.4	35	-0.6	29	Standard thermal glazing	51.4	Yes	ADF System 4	MVHR without T.V.
Plot C106	Ground	SW	63	30	33	35	-2	28	Standard thermal glazing	50	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C106	Ground	NW	58.7	30	28.7	35	-6.3	24	Standard thermal glazing	45.7	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C106	Ground	N	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C107	Ground	SE	54.6	30	24.6	35	-10.4	20	Standard thermal glazing	41.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C107	Ground	SW	61.9	30	31.9	35	-3.1	27	Standard thermal glazing	48.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C107	Ground	W	58.5	30	28.5	35	-6.5	24	Standard thermal glazing	45.5	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C107	Ground	N	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C107	Ground	E	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C108	Ground	E	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C108	Ground	S	56.3	30	26.3	35	-8.7	21	Standard thermal glazing	43.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C108	Ground	W	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C108	Ground	N	52.3	30	22.3	35	-12.7	17	Standard thermal glazing	39.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C109-111	Ground	NE	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C109-111	Ground	SE	54.6	30	24.6	35	-10.4	20	Standard thermal glazing	41.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C109-111	Ground	SW	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C109-111	Ground	NW	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C112-114	Ground	NE	56	30	26	35	-9	21	Standard thermal glazing	43	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C112-114	Ground	SE	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C112-114	Ground	SW	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C112-114	Ground	NW	53.1	30	23.1	35	-11.9	18	Standard thermal glazing	40.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C115-117	Ground	NE	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C115-117	Ground	SE	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C115-117	Ground	SW	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C115-117	Ground	NW	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C118-120	Ground	SW	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C118-120	Ground	SE	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C118-120	Ground	NE	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C118-120	Ground	NW	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C121-122	Ground	SW	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C121-122	Ground	SE	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C121-122	Ground	NE	56.5	30	26.5	35	-8.5	22	Standard thermal glazing	43.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C121-122	Ground	NW	52.4	30	22.4	35	-12.6	17	Standard thermal glazing	39.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C123-124	Ground	SW	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C123-124	Ground	SE	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C123-124	Ground	NE	56.3	30	26.3	35	-8.7	21	Standard thermal glazing	43.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C123-124	Ground	NW	53.3	30	23.3	35	-11.7	18	Standard thermal glazing	40.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C125-127	Ground	SW	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C125-127	Ground	SE	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C125-127	Ground	NE	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C125-127	Ground	NW	53	30	23	35	-12	18	Standard thermal glazing	40	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C128-129	Ground	NE	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C128-129	Ground	SE	57.7	30	27.7	35	-7.3	23	Standard thermal glazing	44.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C128-129	Ground	SW	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C128-129	Ground	NW	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C130-131	Ground	NE	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C130-131	Ground	SE	57.3	30	27.3	35	-7.7	22	Standard thermal glazing	44.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C130-131	Ground	SW	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C130-131	Ground	NW	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D1	Ground	NE	50.2	30	20.2	35	-14.8	15	Standard thermal glazing	37.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D1	Ground	SE	56.5	30	26.5	35	-8.5	22	Standard thermal glazing	43.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D1	Ground	SW	52.3	30	22.3	35	-12.7	17	Standard thermal glazing	39.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D1	Ground	NW	52.5	30	22.5	35	-12.5	18	Standard thermal glazing	39.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D2-3	Ground	SW	48.1	30	18.1	35	-16.9	13	Standard thermal glazing	35.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D2-3	Ground	SE	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D2-3	Ground	NE	48.2	30	18.2	35	-16.8	13	Standard thermal glazing	35.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D2-3	Ground	NW	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D4	Ground	NE	47.3	30	17.3	35	-17.7	12	Standard thermal glazing	34.3	No	N/A	Alt. Vent. not Required
Plot D4	Ground	SE	56	30	26	35	-9	21	Standard thermal glazing	43	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D4	Ground	SW	52.5	30	22.5	35	-12.5	18	Standard thermal glazing	39.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D4	Ground	NW	52.1	30	22.1	35	-12.9	17	Standard thermal glazing	39.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D5	Ground	SW	50	30	20	35	-15	15	Standard thermal glazing	37	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D5	Ground	SE	56.6	30	26.6	35	-8.4	22	Standard thermal glazing	43.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D5	Ground	NE	48.4	30	18.4	35	-16.6	13	Standard thermal glazing	35.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D5	Ground	NW	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D6-7	Ground	S	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D6-7	Ground	E	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D6-7	Ground	N	47.8	30	17.8	35	-17.2	13	Standard thermal glazing	34.8	No	N/A	Alt. Vent. not Required
Plot D6-7	Ground	W	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D8	Ground	N	48.1	30	18.1	35	-16.9	13	Standard thermal glazing	35.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D8	Ground	E	57.7	30	27.7	35	-7.3	23	Standard thermal glazing	44.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D8	Ground	S	60	30	30	35	-5	25	Standard thermal glazing	47	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D8	Ground	W	54.3	30	24.3	35	-10.7	19	Standard thermal glazing	41.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D9	Ground	SE	58.5	30	28.5	35	-6.5	24	Standard thermal glazing	45.5	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D9	Ground	NE	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D9	Ground	NW	52.1	30	22.1	35	-12.9	17	Standard thermal glazing	39.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D9	Ground	SW	60.2	30	30.2	35	-4.8	25	Standard thermal glazing	47.2	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D10	Ground	SW	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D10	Ground	SE	57.8	30	27.8	35	-7.2	23	Standard thermal glazing	44.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D10	Ground	NE	48.1	30	18.1	35	-16.9	13	Standard thermal glazing	35.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D10	Ground	NW	51.7	30	21.7	35	-13.3	17	Standard thermal glazing	38.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D11	Ground	SW	51.3	30	21.3	35	-13.7	16	Standard thermal glazing	38.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D11	Ground	SE	58	30	28	35	-7	23	Standard thermal glazing	45	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D11	Ground	NE	49.1	30	19.1	35	-15.9	14	Standard thermal glazing	36.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D11	Ground	NW	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D12-13	Ground	SW	55.6	30	25.6	35	-9.4	21	Standard thermal glazing	42.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D12-13	Ground	SE	57.1	30	27.1	35	-7.9	22	Standard thermal glazing	44.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D12-13	Ground	NE	49.7	30	19.7	35	-15.3	15	Standard thermal glazing	36.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D12-13	Ground	NW	53.1	30	23.1	35	-11.9	18	Standard thermal glazing	40.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D14-15	Ground	NE	50.3	30	20.3	35	-14.7	15	Standard thermal glazing	37.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D14-15	Ground	SE	52.4	30	22.4	35	-12.6	17	Standard thermal glazing	39.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D14-15	Ground	SW	57.9	30	27.9	35	-7.1	23	Standard thermal glazing	44.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D14-15	Ground	NW	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D16-17	Ground	SW	48.6	30	18.6	35	-16.4	14	Standard thermal glazing	35.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D16-17	Ground	SE	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D16-17	Ground	NE	48.5	30	18.5	35	-16.5	14	Standard thermal glazing	35.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D16-17	Ground	NW	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot 18-19	Ground	NW	49.5	30	19.5	35	-15.5	15	Standard thermal glazing	36.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot 18-19	Ground	NE	49.2	30	19.2	35	-15.8	14	Standard thermal glazing	36.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot 18-19	Ground	SE	57.1	30	27.1	35	-7.9	22	Standard thermal glazing	44.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot 18-19	Ground	SW	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D20	Ground	NE	48.2	30	18.2	35	-16.8	13	Standard thermal glazing	35.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D20	Ground	SE	56.9	30	26.9	35	-8.1	22	Standard thermal glazing	43.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D20	Ground	SW	60.6	30	30.6	35	-4.4	26	Standard thermal glazing	47.6	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D20	Ground	NW	57.1	30	27.1	35	-7.9	22	Standard thermal glazing	44.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D21	Ground	E	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D21	Ground	S	60.9	30	30.9	35	-4.1	26	Standard thermal glazing	47.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D21	Ground	W	57.2	30	27.2	35	-7.8	22	Standard thermal glazing	44.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D21	Ground	N	49.1	30	19.1	35	-15.9	14	Standard thermal glazing	36.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D22	Ground	S	60.5	30	30.5	35	-4.5	26	Standard thermal glazing	47.5	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D22	Ground	E	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D22	Ground	N	49.2	30	19.2	35	-15.8	14	Standard thermal glazing	36.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D22	Ground	W	56.5	30	26.5	35	-8.5	22	Standard thermal glazing	43.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D23	Ground	N	49.2	30	19.2	35	-15.8	14	Standard thermal glazing	36.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D23	Ground	E	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D23	Ground	S	61	30	31	35	-4	26	Standard thermal glazing	48	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D23	Ground	W	56.8	30	26.8	35	-8.2	22	Standard thermal glazing	43.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D24	Ground	E	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D24	Ground	N	49.4	30	19.4	35	-15.6	14	Standard thermal glazing	36.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D24	Ground	W	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D24	Ground	S	60.9	30	30.9	35	-4.1	26	Standard thermal glazing	47.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D25-26	Ground	E	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D25-26	Ground	S	61.1	30	31.1	35	-3.9	26	Standard thermal glazing	48.1	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D25-26	Ground	W	52.4	30	22.4	35	-12.6	17	Standard thermal glazing	39.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D25-26	Ground	N	49.3	30	19.3	35	-15.7	14	Standard thermal glazing	36.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D27-28	Ground	E	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D27-28	Ground	S	61.2	30	31.2	35	-3.8	26	Standard thermal glazing	48.2	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D27-28	Ground	W	56.8	30	26.8	35	-8.2	22	Standard thermal glazing	43.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D27-28	Ground	N	48.8	30	18.8	35	-16.2	14	Standard thermal glazing	35.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D29-31	Ground	E	57	30	27	35	-8	22	Standard thermal glazing	44	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D29-31	Ground	N	48.7	30	18.7	35	-16.3	14	Standard thermal glazing	35.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D29-31	Ground	W	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D29-31	Ground	S	61.2	30	31.2	35	-3.8	26	Standard thermal glazing	48.2	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D32-34	Ground	S	61.4	30	31.4	35	-3.6	26	Standard thermal glazing	48.4	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D32-34	Ground	E	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D32-34	Ground	N	48.5	30	18.5	35	-16.5	14	Standard thermal glazing	35.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D32-34	Ground	W	56.6	30	26.6	35	-8.4	22	Standard thermal glazing	43.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D35	Ground	E	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D35	Ground	S	61	30	31	35	-4	26	Standard thermal glazing	48	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D35	Ground	W	55.2	30	25.2	35	-9.8	20	Standard thermal glazing	42.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D35	Ground	N	48.5	30	18.5	35	-16.5	14	Standard thermal glazing	35.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D36	Ground	E	55.2	30	25.2	35	-9.8	20	Standard thermal glazing	42.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D36	Ground	S	61	30	31	35	-4	26	Standard thermal glazing	48	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D36	Ground	W	56.2	30	26.2	35	-8.8	21	Standard thermal glazing	43.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D36	Ground	N	48.7	30	18.7	35	-16.3	14	Standard thermal glazing	35.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D37	Ground	E	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D37	Ground	S	60.7	30	30.7	35	-4.3	26	Standard thermal glazing	47.7	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D37	Ground	W	57.6	30	27.6	35	-7.4	23	Standard thermal glazing	44.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D37	Ground	N	49.1	30	19.1	35	-15.9	14	Standard thermal glazing	36.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D38	Ground	W	57.4	30	27.4	35	-7.6	22	Standard thermal glazing	44.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D38	Ground	S	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D38	Ground	E	52.7	30	22.7	35	-12.3	18	Standard thermal glazing	39.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D38	Ground	N	49.6	30	19.6	35	-15.4	15	Standard thermal glazing	36.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D39	Ground	E	53.5	30	23.5	35	-11.5	19	Standard thermal glazing	40.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D39	Ground	S	59.9	30	29.9	35	-5.1	25	Standard thermal glazing	46.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D39	Ground	W	59.3	30	29.3	35	-5.7	24	Standard thermal glazing	46.3	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D39	Ground	N	49.5	30	19.5	35	-15.5	15	Standard thermal glazing	36.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D40	Ground	E	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D40	Ground	N	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D40	Ground	W	55.2	30	25.2	35	-9.8	20	Standard thermal glazing	42.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D40	Ground	S	58.3	30	28.3	35	-6.7	23	Standard thermal glazing	45.3	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D41-42	Ground	E	51.1	30	21.1	35	-13.9	16	Standard thermal glazing	38.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D41-42	Ground	N	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D41-42	Ground	W	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D41-42	Ground	S	57.3	30	27.3	35	-7.7	22	Standard thermal glazing	44.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D43	Ground	E	51.1	30	21.1	35	-13.9	16	Standard thermal glazing	38.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D43	Ground	S	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D43	Ground	W	51.3	30	21.3	35	-13.7	16	Standard thermal glazing	38.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D43	Ground	N	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D44	Ground	E	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D44	Ground	N	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D44	Ground	W	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D44	Ground	S	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D45-46	Ground	S	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D45-46	Ground	E	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D45-46	Ground	N	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D45-46	Ground	W	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D47	Ground	S	56.3	30	26.3	35	-8.7	21	Standard thermal glazing	43.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D47	Ground	E	51.7	30	21.7	35	-13.3	17	Standard thermal glazing	38.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D47	Ground	N	51.1	30	21.1	35	-13.9	16	Standard thermal glazing	38.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D47	Ground	W	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D48-49	Ground	SW	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D48-49	Ground	NW	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D48-49	Ground	NE	51.2	30	21.2	35	-13.8	16	Standard thermal glazing	38.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D48-49	Ground	SE	56	30	26	35	-9	21	Standard thermal glazing	43	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D50-52	Ground	NE	53.5	30	23.5	35	-11.5	19	Standard thermal glazing	40.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D50-52	Ground	SE	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D50-52	Ground	SW	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D50-52	Ground	NW	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D53	Ground	NE	54.3	30	24.3	35	-10.7	19	Standard thermal glazing	41.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D53	Ground	SE	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D53	Ground	SW	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D53	Ground	NW	51.1	30	21.1	35	-13.9	16	Standard thermal glazing	38.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D54	Ground	SW	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D54	Ground	SE	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D54	Ground	NE	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D54	Ground	NW	50.2	30	20.2	35	-14.8	15	Standard thermal glazing	37.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D55	Ground	W	52.1	30	22.1	35	-12.9	17	Standard thermal glazing	39.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D55	Ground	S	56.3	30	26.3	35	-8.7	21	Standard thermal glazing	43.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D55	Ground	E	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D55	Ground	N	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D56	Ground	W	52.5	30	22.5	35	-12.5	18	Standard thermal glazing	39.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D56	Ground	S	56.4	30	26.4	35	-8.6	21	Standard thermal glazing	43.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D56	Ground	E	51.7	30	21.7	35	-13.3	17	Standard thermal glazing	38.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D56	Ground	N	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D57	Ground	W	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D57	Ground	S	56.8	30	26.8	35	-8.2	22	Standard thermal glazing	43.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D57	Ground	E	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D57	Ground	N	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D58	Ground	E	52.9	30	22.9	35	-12.1	18	Standard thermal glazing	39.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D58	Ground	S	56.8	30	26.8	35	-8.2	22	Standard thermal glazing	43.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D58	Ground	W	52.2	30	22.2	35	-12.8	17	Standard thermal glazing	39.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D58	Ground	N	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D59	Ground	W	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D59	Ground	S	57.7	30	27.7	35	-7.3	23	Standard thermal glazing	44.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D59	Ground	E	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D59	Ground	N	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D60	Ground	W	58.9	30	28.9	35	-6.1	24	Standard thermal glazing	45.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D60	Ground	S	56.4	30	26.4	35	-8.6	21	Standard thermal glazing	43.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D60	Ground	E	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D60	Ground	N	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D61	Ground	E	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D61	Ground	S	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D61	Ground	W	58.6	30	28.6	35	-6.4	24	Standard thermal glazing	45.6	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D61	Ground	N	49.1	30	19.1	35	-15.9	14	Standard thermal glazing	36.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D62	Ground	N	50	30	20	35	-15	15	Standard thermal glazing	37	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D62	Ground	E	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D62	Ground	S	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D62	Ground	W	58.9	30	28.9	35	-6.1	24	Standard thermal glazing	45.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D63	Ground	W	58.4	30	28.4	35	-6.6	23	Standard thermal glazing	45.4	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D63	Ground	N	50	30	20	35	-15	15	Standard thermal glazing	37	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D63	Ground	E	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D63	Ground	S	58.2	30	28.2	35	-6.8	23	Standard thermal glazing	45.2	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D64	Ground	E	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D64	Ground	N	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D64	Ground	W	54.9	30	24.9	35	-10.1	20	Standard thermal glazing	41.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D64	Ground	S	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D65	Ground	E	52.9	30	22.9	35	-12.1	18	Standard thermal glazing	39.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D65	Ground	N	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D65	Ground	W	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D65	Ground	S	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D66	Ground	S	55.2	30	25.2	35	-9.8	20	Standard thermal glazing	42.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D66	Ground	E	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D66	Ground	N	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D66	Ground	W	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D67	Ground	E	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D67	Ground	S	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D67	Ground	W	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D67	Ground	N	50.6	30	20.6	35	-14.4	16	Standard thermal glazing	37.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D68	Ground	E	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D68	Ground	S	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D68	Ground	W	52.3	30	22.3	35	-12.7	17	Standard thermal glazing	39.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D68	Ground	N	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D69	Ground	E	53.1	30	23.1	35	-11.9	18	Standard thermal glazing	40.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D69	Ground	S	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D69	Ground	W	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D69	Ground	N	50.5	30	20.5	35	-14.5	16	Standard thermal glazing	37.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D70	Ground	SE	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D70	Ground	SW	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D70	Ground	NW	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D70	Ground	NE	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D71	Ground	N	51.3	30	21.3	35	-13.7	16	Standard thermal glazing	38.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D71	Ground	E	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D71	Ground	S	57.6	30	27.6	35	-7.4	23	Standard thermal glazing	44.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D71	Ground	W	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D72	Ground	E	52.7	30	22.7	35	-12.3	18	Standard thermal glazing	39.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D72	Ground	S	56.8	30	26.8	35	-8.2	22	Standard thermal glazing	43.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D72	Ground	W	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D72	Ground	N	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D73	Ground	E	52.7	30	22.7	35	-12.3	18	Standard thermal glazing	39.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D73	Ground	S	57.2	30	27.2	35	-7.8	22	Standard thermal glazing	44.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D73	Ground	W	53.1	30	23.1	35	-11.9	18	Standard thermal glazing	40.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D73	Ground	N	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D74	Ground	E	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D74	Ground	S	57.1	30	27.1	35	-7.9	22	Standard thermal glazing	44.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D74	Ground	W	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D74	Ground	N	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D75	Ground	E	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D75	Ground	S	56.1	30	26.1	35	-8.9	21	Standard thermal glazing	43.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D75	Ground	W	52.4	30	22.4	35	-12.6	17	Standard thermal glazing	39.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D75	Ground	N	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D76	Ground	N	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D76	Ground	W	52.5	30	22.5	35	-12.5	18	Standard thermal glazing	39.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D76	Ground	S	56.6	30	26.6	35	-8.4	22	Standard thermal glazing	43.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D76	Ground	E	53.4	30	23.4	35	-11.6	18	Standard thermal glazing	40.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D77	Ground	E	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D77	Ground	S	57.3	30	27.3	35	-7.7	22	Standard thermal glazing	44.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D77	Ground	W	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D77	Ground	N	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D78	Ground	E	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D78	Ground	N	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D78	Ground	W	57.6	30	27.6	35	-7.4	23	Standard thermal glazing	44.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D78	Ground	S	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D79	Ground	W	59.9	30	29.9	35	-5.1	25	Standard thermal glazing	46.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D79	Ground	N	50.1	30	20.1	35	-14.9	15	Standard thermal glazing	37.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D79	Ground	E	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D79	Ground	S	56.5	30	26.5	35	-8.5	22	Standard thermal glazing	43.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D80	Ground	E	55.4	30	25.4	35	-9.6	20	Standard thermal glazing	42.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D80	Ground	S	62.4	30	32.4	35	-2.6	27	Standard thermal glazing	49.4	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D80	Ground	W	60	30	30	35	-5	25	Standard thermal glazing	47	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D80	Ground	N	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D81	Ground	E	57.4	30	27.4	35	-7.6	22	Standard thermal glazing	44.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D81	Ground	S	62.5	30	32.5	35	-2.5	28	Standard thermal glazing	49.5	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D81	Ground	W	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D81	Ground	N	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D82	Ground	W	60.1	30	30.1	35	-4.9	25	Standard thermal glazing	47.1	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D82	Ground	N	50.9	30	20.9	35	-14.1	16	Standard thermal glazing	37.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D82	Ground	E	56.5	30	26.5	35	-8.5	22	Standard thermal glazing	43.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D82	Ground	S	62.5	30	32.5	35	-2.5	28	Standard thermal glazing	49.5	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D83	Ground	W	60	30	30	35	-5	25	Standard thermal glazing	47	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D83	Ground	N	50.7	30	20.7	35	-14.3	16	Standard thermal glazing	37.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D83	Ground	E	56	30	26	35	-9	21	Standard thermal glazing	43	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D83	Ground	S	62.3	30	32.3	35	-2.7	27	Standard thermal glazing	49.3	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D84	Ground	N	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D84	Ground	W	59.6	30	29.6	35	-5.4	25	Standard thermal glazing	46.6	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D84	Ground	S	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D84	Ground	E	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D85	Ground	W	60.5	30	30.5	35	-4.5	26	Standard thermal glazing	47.5	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D85	Ground	S	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D85	Ground	E	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D85	Ground	N	49.9	30	19.9	35	-15.1	15	Standard thermal glazing	36.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D86	Ground	N	49.8	30	19.8	35	-15.2	15	Standard thermal glazing	36.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D86	Ground	W	61.4	30	31.4	35	-3.6	26	Standard thermal glazing	48.4	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D86	Ground	S	60.8	30	30.8	35	-4.2	26	Standard thermal glazing	47.8	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D86	Ground	E	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D87	Ground	S	56.9	30	26.9	35	-8.1	22	Standard thermal glazing	43.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D87	Ground	W	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D87	Ground	N	51	30	21	35	-14	16	Standard thermal glazing	38	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D87	Ground	E	50.8	30	20.8	35	-14.2	16	Standard thermal glazing	37.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D88-89	Ground	E	51.3	30	21.3	35	-13.7	16	Standard thermal glazing	38.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D88-89	Ground	S	57.1	30	27.1	35	-7.9	22	Standard thermal glazing	44.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D88-89	Ground	W	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D88-89	Ground	N	51.3	30	21.3	35	-13.7	16	Standard thermal glazing	38.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D90	Ground	N	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D90	Ground	SW	52.3	30	22.3	35	-12.7	17	Standard thermal glazing	39.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D90	Ground	SE	58	30	28	35	-7	23	Standard thermal glazing	45	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D90	Ground	E	53.7	30	23.7	35	-11.3	19	Standard thermal glazing	40.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D91-92	Ground	SW	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D91-92	Ground	SE	56.8	30	26.8	35	-8.2	22	Standard thermal glazing	43.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D91-92	Ground	NE	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D91-92	Ground	NW	51.2	30	21.2	35	-13.8	16	Standard thermal glazing	38.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D93	Ground	NE	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D93	Ground	SE	56.4	30	26.4	35	-8.6	21	Standard thermal glazing	43.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D93	Ground	SW	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D93	Ground	NW	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D94	Ground	SW	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D94	Ground	SE	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D94	Ground	NE	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D94	Ground	NW	50.4	30	20.4	35	-14.6	15	Standard thermal glazing	37.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D95	Ground	NE	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D95	Ground	SE	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D95	Ground	SW	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D95	Ground	NW	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D96-99	Ground	E	54.6	30	24.6	35	-10.4	20	Standard thermal glazing	41.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D96-99	Ground	S	58.2	30	28.2	35	-6.8	23	Standard thermal glazing	45.2	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D96-99	Ground	W	57	30	27	35	-8	22	Standard thermal glazing	44	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D96-99	Ground	N	51.7	30	21.7	35	-13.3	17	Standard thermal glazing	38.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D100-101	Ground	E	53.9	30	23.9	35	-11.1	19	Standard thermal glazing	40.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D100-101	Ground	S	58.4	30	28.4	35	-6.6	23	Standard thermal glazing	45.4	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D100-101	Ground	W	57	30	27	35	-8	22	Standard thermal glazing	44	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D100-101	Ground	N	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D102	Ground	W	61.9	30	31.9	35	-3.1	27	Standard thermal glazing	48.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D102	Ground	N	51.6	30	21.6	35	-13.4	17	Standard thermal glazing	38.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D102	Ground	E	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D102	Ground	S	60.2	30	30.2	35	-4.8	25	Standard thermal glazing	47.2	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D103-104	Ground	S	56.6	30	26.6	35	-8.4	22	Standard thermal glazing	43.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D103-104	Ground	W	62.2	30	32.2	35	-2.8	27	Standard thermal glazing	49.2	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D103-104	Ground	N	51.1	30	21.1	35	-13.9	16	Standard thermal glazing	38.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D103-104	Ground	E	56.5	30	26.5	35	-8.5	22	Standard thermal glazing	43.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D105-106	Ground	E	56.2	30	26.2	35	-8.8	21	Standard thermal glazing	43.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D105-106	Ground	S	64.2	30	34.2	35	-0.8	29	Standard thermal glazing	51.2	Yes	ADF System 4	MVHR without T.V.
Plot D105-106	Ground	W	62.7	30	32.7	35	-2.3	28	Standard thermal glazing	49.7	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D105-106	Ground	N	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D107-109	Ground	E	55.4	30	25.4	35	-9.6	20	Standard thermal glazing	42.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D107-109	Ground	N	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D107-109	Ground	W	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D107-109	Ground	S	64.2	30	34.2	35	-0.8	29	Standard thermal glazing	51.2	Yes	ADF System 4	MVHR without T.V.
Plot D110-112	Ground	W	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D110-112	Ground	S	63.6	30	33.6	35	-1.4	29	Standard thermal glazing	50.6	Yes	ADF System 4	MVHR without T.V.
Plot D110-112	Ground	E	54.5	30	24.5	35	-10.5	20	Standard thermal glazing	41.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D110-112	Ground	N	52.4	30	22.4	35	-12.6	17	Standard thermal glazing	39.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D113-114	Ground	W	61.5	30	31.5	35	-3.5	27	Standard thermal glazing	48.5	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D113-114	Ground	S	63.9	30	33.9	35	-1.1	29	Standard thermal glazing	50.9	Yes	ADF System 4	MVHR without T.V.
Plot D113-114	Ground	E	56.8	30	26.8	35	-8.2	22	Standard thermal glazing	43.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D113-114	Ground	N	51.8	30	21.8	35	-13.2	17	Standard thermal glazing	38.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D115	Ground	SE	63.6	30	33.6	35	-1.4	29	Standard thermal glazing	50.6	Yes	ADF System 4	MVHR without T.V.
Plot D115	Ground	SW	59.3	30	29.3	35	-5.7	24	Standard thermal glazing	46.3	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D115	Ground	NW	52.2	30	22.2	35	-12.8	17	Standard thermal glazing	39.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D115	Ground	NE	58.9	30	28.9	35	-6.1	24	Standard thermal glazing	45.9	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D116-118	Ground	SE	57	30	27	35	-8	22	Standard thermal glazing	44	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D116-118	Ground	SW	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D116-118	Ground	NW	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D116-118	Ground	NE	55.3	30	25.3	35	-9.7	20	Standard thermal glazing	42.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D119-120	Ground	NE	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D119-120	Ground	SE	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D119-120	Ground	SW	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D119-120	Ground	NW	50.6	30	20.6	35	-14.4	16	Standard thermal glazing	37.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D121	Ground	NE	54.8	30	24.8	35	-10.2	20	Standard thermal glazing	41.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D121	Ground	SE	53.8	30	23.8	35	-11.2	19	Standard thermal glazing	40.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D121	Ground	SW	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D121	Ground	NW	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D122-123	Ground	E	57.6	30	27.6	35	-7.4	23	Standard thermal glazing	44.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D122-123	Ground	S	63.6	30	33.6	35	-1.4	29	Standard thermal glazing	50.6	Yes	ADF System 4	MVHR without T.V.
Plot D122-123	Ground	W	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D122-123	Ground	N	52.6	30	22.6	35	-12.4	18	Standard thermal glazing	39.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D124	Ground	S	63.7	30	33.7	35	-1.3	29	Standard thermal glazing	50.7	Yes	ADF System 4	MVHR without T.V.
Plot D124	Ground	W	60.8	30	30.8	35	-4.2	26	Standard thermal glazing	47.8	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D124	Ground	N	52.5	30	22.5	35	-12.5	18	Standard thermal glazing	39.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D124	Ground	E	57.7	30	27.7	35	-7.3	23	Standard thermal glazing	44.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D125-126	Ground	NE	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D125-126	Ground	SE	58.8	30	28.8	35	-6.2	24	Standard thermal glazing	45.8	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D125-126	Ground	SW	56.9	30	26.9	35	-8.1	22	Standard thermal glazing	43.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D125-126	Ground	NW	52.3	30	22.3	35	-12.7	17	Standard thermal glazing	39.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D127-128	Ground	SW	55.9	30	25.9	35	-9.1	21	Standard thermal glazing	42.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D127-128	Ground	SE	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D127-128	Ground	NE	55.4	30	25.4	35	-9.6	20	Standard thermal glazing	42.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D127-128	Ground	NW	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D129-130	Ground	NE	55.2	30	25.2	35	-9.8	20	Standard thermal glazing	42.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D129-130	Ground	SE	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D129-130	Ground	SW	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D129-130	Ground	NW	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D131-132	Ground	NE	54.4	30	24.4	35	-10.6	19	Standard thermal glazing	41.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D131-132	Ground	SE	55.8	30	25.8	35	-9.2	21	Standard thermal glazing	42.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D131-132	Ground	SW	56.8	30	26.8	35	-8.2	22	Standard thermal glazing	43.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D131-132	Ground	NW	51.2	30	21.2	35	-13.8	16	Standard thermal glazing	38.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D133	Ground	SW	54.6	30	24.6	35	-10.4	20	Standard thermal glazing	41.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D133	Ground	SE	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D133	Ground	NE	54.3	30	24.3	35	-10.7	19	Standard thermal glazing	41.3	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D133	Ground	NW	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D134-136	Ground	SW	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D134-136	Ground	SE	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D134-136	Ground	NE	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D134-136	Ground	NW	50.6	30	20.6	35	-14.4	16	Standard thermal glazing	37.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D137	Ground	NE	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D137	Ground	SE	54.1	30	24.1	35	-10.9	19	Standard thermal glazing	41.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D137	Ground	SW	55.4	30	25.4	35	-9.6	20	Standard thermal glazing	42.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D137	Ground	NW	51.4	30	21.4	35	-13.6	16	Standard thermal glazing	38.4	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D138-139	Ground	NE	54.7	30	24.7	35	-10.3	20	Standard thermal glazing	41.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D138-139	Ground	NW	51.7	30	21.7	35	-13.3	17	Standard thermal glazing	38.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D138-139	Ground	SW	55.5	30	25.5	35	-9.5	21	Standard thermal glazing	42.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D138-139	Ground	SE	52.8	30	22.8	35	-12.2	18	Standard thermal glazing	39.8	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D140	Ground	SW	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D140	Ground	SE	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D140	Ground	NE	54	30	24	35	-11	19	Standard thermal glazing	41	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D140	Ground	NW	51.6	30	21.6	35	-13.4	17	Standard thermal glazing	38.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D141	Ground	NE	54.2	30	24.2	35	-10.8	19	Standard thermal glazing	41.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D141	Ground	SE	53.1	30	23.1	35	-11.9	18	Standard thermal glazing	40.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D141	Ground	SW	55.1	30	25.1	35	-9.9	20	Standard thermal glazing	42.1	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D141	Ground	NW	52	30	22	35	-13	17	Standard thermal glazing	39	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D142	Ground	NE	53.2	30	23.2	35	-11.8	18	Standard thermal glazing	40.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D142	Ground	SE	56.7	30	26.7	35	-8.3	22	Standard thermal glazing	43.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D142	Ground	SW	55	30	25	35	-10	20	Standard thermal glazing	42	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D142	Ground	NW	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	Ground	NE	53.5	30	23.5	35	-11.5	19	Standard thermal glazing	40.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	Ground	SE	56.2	30	26.2	35	-8.8	21	Standard thermal glazing	43.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	Ground	SW	53.6	30	23.6	35	-11.4	19	Standard thermal glazing	40.6	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	Ground	NW	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D142	Ground	NW	51.5	30	21.5	35	-13.5	17	Standard thermal glazing	38.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D143	Ground	NE	53.5	30	23.5	35	-11.5	19	Standard thermal glazing	40.5	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	Ground	SE	56.2	30	26.2	35	-8.8	21	Standard thermal glazing	43.2	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	Ground	SW	53.7	30	23.7	35	-11.3	19	Standard thermal glazing	40.7	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	Ground	NW	51.9	30	21.9	35	-13.1	17	Standard thermal glazing	38.9	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6
Date: 27th November 2024
Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

APPENDIX 10: NIGHT-TIME FAÇADE NOISE LEVELS

Plot	Floor	Façade Direction	Calculated LAeq,8hr at Façade (dB)	Glazing Sound Reduction Index (Rw) (Standard Thermal)	Calculated Noise Level Inside Room (dB)	Criteria (dB)	Difference +/- (dB)	Required Sound Insulation Performance for Glazing (Rw +Ctr) (dB)	Commentary on Required Glazing	Calculated Internal Noise Level with a Partially Open Window (dB)	Alternative Ventilation Required?	Do Average Night-time Internal Noise Levels Achieve Compliance with AD-O?	Acoustics Ventilation & Overheating Assessment - Appropriate AD-F System	Eg. Alt' Ventilation Scheme
Plot B1	1st	NE	45.7	30	15.7	30	-14.3	16	Standard thermal glazing	32.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B1	1st	SE	50.3	30	20.3	30	-9.7	20	Standard thermal glazing	37.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B1	1st	SW	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B1	1st	NW	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B2	1st	NE	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B2	1st	SE	50.6	30	20.6	30	-9.4	21	Standard thermal glazing	37.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B2	1st	SW	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B2	1st	NW	48.7	30	18.7	30	-11.3	19	Standard thermal glazing	35.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B3-4	1st	SW	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B3-4	1st	SE	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B3-4	1st	NE	45.4	30	15.4	30	-14.6	15	Standard thermal glazing	32.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B3-4	1st	NW	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B5	1st	SW	47.7	30	17.7	30	-12.3	18	Standard thermal glazing	34.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B5	1st	SE	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B5	1st	NE	45.3	30	15.3	30	-14.7	15	Standard thermal glazing	32.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B5	1st	NW	46.5	30	16.5	30	-13.5	17	Standard thermal glazing	33.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B6	1st	SW	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B6	1st	SE	50.7	30	20.7	30	-9.3	21	Standard thermal glazing	37.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B6	1st	NE	45.3	30	15.3	30	-14.7	15	Standard thermal glazing	32.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B6	1st	NW	48.9	30	18.9	30	-11.1	19	Standard thermal glazing	35.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B7-8	1st	NE	45.4	30	15.4	30	-14.6	15	Standard thermal glazing	32.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B7-8	1st	SE	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B7-8	1st	SW	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B7-8	1st	NW	47.4	30	17.4	30	-12.6	17	Standard thermal glazing	34.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B9	1st	SW	46.9	30	16.9	30	-13.1	17	Standard thermal glazing	33.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B9	1st	NW	45.7	30	15.7	30	-14.3	16	Standard thermal glazing	32.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B9	1st	NE	45.7	30	15.7	30	-14.3	16	Standard thermal glazing	32.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B9	1st	SE	51	30	21	30	-9	21	Standard thermal glazing	38	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B10-11	1st	SW	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B10-11	1st	SE	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B10-11	1st	NE	45.7	30	15.7	30	-14.3	16	Standard thermal glazing	32.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B10-11	1st	NW	46.6	30	16.6	30	-13.4	17	Standard thermal glazing	33.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B12	1st	N	44.7	30	14.7	30	-15.3	15	Standard thermal glazing	31.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B12	1st	E	48.9	30	18.9	30	-11.1	19	Standard thermal glazing	35.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B12	1st	S	51.8	30	21.8	30	-8.2	22	Standard thermal glazing	38.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B12	1st	W	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B13-14	1st	E	48.9	30	18.9	30	-11.1	19	Standard thermal glazing	35.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B13-14	1st	S	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B13-14	1st	W	49.4	30	19.4	30	-10.6	19	Standard thermal glazing	36.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B13-14	1st	N	44.6	30	14.6	30	-15.4	15	Standard thermal glazing	31.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B15	1st	W	49.8	30	19.8	30	-10.2	20	Standard thermal glazing	36.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B15	1st	S	51	30	21	30	-9	21	Standard thermal glazing	38	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B15	1st	E	46.3	30	16.3	30	-13.7	16	Standard thermal glazing	33.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B15	1st	N	44.2	30	14.2	30	-15.8	14	Standard thermal glazing	31.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B16	1st	E	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B16	1st	S	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B16	1st	W	49.2	30	19.2	30	-10.8	19	Standard thermal glazing	36.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B16	1st	N	44.2	30	14.2	30	-15.8	14	Standard thermal glazing	31.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B17	1st	N	44.3	30	14.3	30	-15.7	14	Standard thermal glazing	31.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B17	1st	W	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B17	1st	S	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B17	1st	E	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B18-19	1st	E	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B18-19	1st	S	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B18-19	1st	W	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B18-19	1st	N	44.2	30	14.2	30	-15.8	14	Standard thermal glazing	31.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B20	1st	E	46.6	30	16.6	30	-13.4	17	Standard thermal glazing	33.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B20	1st	S	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B20	1st	W	48.2	30	18.2	30	-11.8	18	Standard thermal glazing	35.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B20	1st	N	44	30	14	30	-16	14	Standard thermal glazing	31	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B21-22	1st	E	44.9	30	14.9	30	-15.1	15	Standard thermal glazing	31.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B21-22	1st	S	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B21-22	1st	W	47.4	30	17.4	30	-12.6	17	Standard thermal glazing	34.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B21-22	1st	N	44.1	30	14.1	30	-15.9	14	Standard thermal glazing	31.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B23	1st	E	45.8	30	15.8	30	-14.2	16	Standard thermal glazing	32.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B23	1st	N	44.2	30	14.2	30	-15.8	14	Standard thermal glazing	31.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B23	1st	W	45.7	30	15.7	30	-14.3	16	Standard thermal glazing	32.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B23	1st	S	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B24	1st	E	45.8	30	15.8	30	-14.2	16	Standard thermal glazing	32.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B24	1st	S	51	30	21	30	-9	21	Standard thermal glazing	38	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B24	1st	W	45.9	30	15.9	30	-14.1	16	Standard thermal glazing	32.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B24	1st	N	44.2	30	14.2	30	-15.8	14	Standard thermal glazing	31.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B25-27	1st	E	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B25-27	1st	S	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B25-27	1st	W	47.4	30	17.4	30	-12.6	17	Standard thermal glazing	34.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B25-27	1st	N	44.5	30	14.5	30	-15.5	15	Standard thermal glazing	31.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B28	1st	E	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B28	1st	S	49.6	30	19.6	30	-10.4	20	Standard thermal glazing	36.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B28	1st	W	49.8	30	19.8	30	-10.2	20	Standard thermal glazing	36.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B28	1st	N	44.7	30	14.7	30	-15.3	15	Standard thermal glazing	31.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B29	1st	E	49	30	19	30	-11	19	Standard thermal glazing	36	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B29	1st	S	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B29	1st	W	50.2	30	20.2	30	-9.8	20	Standard thermal glazing	37.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B29	1st	N	44.6	30	14.6	30	-15.4	15	Standard thermal glazing	31.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B30-31	1st	E	48.3	30	18.3	30	-11.7	18	Standard thermal glazing	35.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B30-31	1st	S	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B30-31	1st	W	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B30-31	1st	N	44.5	30	14.5	30	-15.5	15	Standard thermal glazing	31.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B32	1st	E	46.9	30	16.9	30	-13.1	17	Standard thermal glazing	33.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B32	1st	S	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B32	1st	W	50.4	30	20.4	30	-9.6	20	Standard thermal glazing	37.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B32	1st	N	44.2	30	14.2	30	-15.8	14	Standard thermal glazing	31.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B33	1st	E	48.1	30	18.1	30	-11.9	18	Standard thermal glazing	35.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B33	1st	S	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B33	1st	W	50.2	30	20.2	30	-9.8	20	Standard thermal glazing	37.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B33	1st	N	44.3	30	14.3	30	-15.7	14	Standard thermal glazing	31.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B34	1st	SW	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B34	1st	NW	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B34	1st	NE	45.1	30	15.1	30	-14.9	15	Standard thermal glazing	32.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B34	1st	SE	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B35	1st	E	49.6	30	19.6	30	-10.4	20	Standard thermal glazing	36.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B35	1st	S	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B35	1st	W	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B35	1st	N	45.8	30	15.8	30	-14.2	16	Standard thermal glazing	32.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B36	1st	E	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B36	1st	S	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B36	1st	W	49.3	30	19.3	30	-10.7	19	Standard thermal glazing	36.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B36	1st	N	44.6	30	14.6	30	-15.4	15	Standard thermal glazing	31.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B37	1st	N	44.4	30	14.4	30	-15.6	14	Standard thermal glazing	31.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B37	1st	W	47.8	30	17.8	30	-12.2	18	Standard thermal glazing	34.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B37	1st	S	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B37	1st	E	46.4	30	16.4	30	-13.6	16	Standard thermal glazing	33.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B38-39	1st	E	45.5	30	15.5	30	-14.5	16	Standard thermal glazing	32.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B38-39	1st	S	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B38-39	1st	W	47.4	30	17.4	30	-12.6	17	Standard thermal glazing	34.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B38-39	1st	N	44.5	30	14.5	30	-15.5	15	Standard thermal glazing	31.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B40	1st	N	44.5	30	14.5	30	-15.5	15	Standard thermal glazing	31.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B40	1st	W	46.9	30	16.9	30	-13.1	17	Standard thermal glazing	33.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B40	1st	S	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B40	1st	E	46.3	30	16.3	30	-13.7	16	Standard thermal glazing	33.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B41-42	1st	N	44.8	30	14.8	30	-15.2	15	Standard thermal glazing	31.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B41-42	1st	W	48.2	30	18.2	30	-11.8	18	Standard thermal glazing	35.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B41-42	1st	S	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B41-42	1st	E	49.2	30	19.2	30	-10.8	19	Standard thermal glazing	36.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B43	1st	SE	50.2	30	20.2	30	-9.8	20	Standard thermal glazing	37.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B43	1st	NE	46.4	30	16.4	30	-13.6	16	Standard thermal glazing	33.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B43	1st	NW	49.6	30	19.6	30	-10.4	20	Standard thermal glazing	36.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B43	1st	SW	48	30	18	30	-12	18	Standard thermal glazing	35	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B44	1st	NE	45.7	30	15.7	30	-14.3	16	Standard thermal glazing	32.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B44	1st	SE	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B44	1st	SW	51.9	30	21.9	30	-8.1	22	Standard thermal glazing	38.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B44	1st	NW	49.9	30	19.9	30	-10.1	20	Standard thermal glazing	36.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B45	1st	N	45.9	30	15.9	30	-14.1	16	Standard thermal glazing	32.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B45	1st	E	49.3	30	19.3	30	-10.7	19	Standard thermal glazing	36.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B45	1st	S	53.2	30	23.2	30	-6.8	23	Standard thermal glazing	40.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B45	1st	W	50.6	30	20.6	30	-9.4	21	Standard thermal glazing	37.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B46	1st	S	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B46	1st	E	48.7	30	18.7	30	-11.3	19	Standard thermal glazing	35.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B46	1st	N	45	30	15	30	-15	15	Standard thermal glazing	32	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B46	1st	W	49.9	30	19.9	30	-10.1	20	Standard thermal glazing	36.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B47-48	1st	E	48.3	30	18.3	30	-11.7	18	Standard thermal glazing	35.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B47-48	1st	S	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B47-48	1st	W	49.4	30	19.4	30	-10.6	19	Standard thermal glazing	36.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B47-48	1st	N	44.8	30	14.8	30	-15.2	15	Standard thermal glazing	31.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B49	1st	S	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B49	1st	E	46.8	30	16.8	30	-13.2	17	Standard thermal glazing	33.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B49	1st	N	44.6	30	14.6	30	-15.4	15	Standard thermal glazing	31.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B49	1st	W	49.9	30	19.9	30	-10.1	20	Standard thermal glazing	36.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B50	1st	E	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B50	1st	N	44.8	30	14.8	30	-15.2	15	Standard thermal glazing	31.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B50	1st	W	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B50	1st	S	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B51	1st	S	49.3	30	19.3	30	-10.7	19	Standard thermal glazing	36.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B51	1st	E	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B51	1st	N	44.9	30	14.9	30	-15.1	15	Standard thermal glazing	31.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B51	1st	W	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B52	1st	S	49.9	30	19.9	30	-10.1	20	Standard thermal glazing	36.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B52	1st	E	48.9	30	18.9	30	-11.1	19	Standard thermal glazing	35.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B52	1st	N	44.9	30	14.9	30	-15.1	15	Standard thermal glazing	31.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B52	1st	SW	50.1	30	20.1	30	-9.9	20	Standard thermal glazing	37.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B53-54	1st	E	47.8	30	17.8	30	-12.2	18	Standard thermal glazing	34.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B53-54	1st	S	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B53-54	1st	W	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B53-54	1st	N	45.5	30	15.5	30	-14.5	16	Standard thermal glazing	32.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B55-56	1st	S	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B55-56	1st	E	46.5	30	16.5	30	-13.5	17	Standard thermal glazing	33.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B55-56	1st	N	45.9	30	15.9	30	-14.1	16	Standard thermal glazing	32.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B55-56	1st	W	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B57	1st	E	48.1	30	18.1	30	-11.9	18	Standard thermal glazing	35.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B57	1st	S	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B57	1st	W	46.8	30	16.8	30	-13.2	17	Standard thermal glazing	33.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B57	1st	N	46.1	30	16.1	30	-13.9	16	Standard thermal glazing	33.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B58-59	1st	S	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B58-59	1st	E	47.6	30	17.6	30	-12.4	18	Standard thermal glazing	34.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B58-59	1st	N	46.5	30	16.5	30	-13.5	17	Standard thermal glazing	33.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B58-59	1st	W	48.1	30	18.1	30	-11.9	18	Standard thermal glazing	35.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B60-61	1st	S	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B60-61	1st	E	47.4	30	17.4	30	-12.6	17	Standard thermal glazing	34.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B60-61	1st	N	46.9	30	16.9	30	-13.1	17	Standard thermal glazing	33.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B60-61	1st	W	47.5	30	17.5	30	-12.5	18	Standard thermal glazing	34.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B62-63	1st	S	51.9	30	21.9	30	-8.1	22	Standard thermal glazing	38.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B62-63	1st	E	47.8	30	17.8	30	-12.2	18	Standard thermal glazing	34.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B62-63	1st	N	47.5	30	17.5	30	-12.5	18	Standard thermal glazing	34.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B62-63	1st	W	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B64-66	1st	E	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B64-66	1st	S	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B64-66	1st	W	47.7	30	17.7	30	-12.3	18	Standard thermal glazing	34.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B64-66	1st	N	48.5	30	18.5	30	-11.5	19	Standard thermal glazing	35.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B67	1st	S	53.9	30	23.9	30	-6.1	24	Standard thermal glazing	40.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B67	1st	E	55.2	30	25.2	30	-4.8	25	Standard thermal glazing	42.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B67	1st	N	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B67	1st	W	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B68	1st	N	49.3	30	19.3	30	-10.7	19	Standard thermal glazing	36.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B68	1st	E	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B68	1st	S	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B68	1st	W	49.2	30	19.2	30	-10.8	19	Standard thermal glazing	36.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B69	1st	E	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B69	1st	S	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B69	1st	W	47	30	17	30	-13	17	Standard thermal glazing	34	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B69	1st	N	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B70	1st	N	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B70	1st	W	47.4	30	17.4	30	-12.6	17	Standard thermal glazing	34.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B70	1st	S	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B70	1st	E	48	30	18	30	-12	18	Standard thermal glazing	35	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B71-72	1st	N	47.6	30	17.6	30	-12.4	18	Standard thermal glazing	34.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B71-72	1st	W	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B71-72	1st	S	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B71-72	1st	E	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B73	1st	E	47.7	30	17.7	30	-12.3	18	Standard thermal glazing	34.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B73	1st	S	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B73	1st	W	46.9	30	16.9	30	-13.1	17	Standard thermal glazing	33.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B73	1st	N	47	30	17	30	-13	17	Standard thermal glazing	34	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B74-75	1st	N	46.7	30	16.7	30	-13.3	17	Standard thermal glazing	33.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B74-75	1st	W	48.3	30	18.3	30	-11.7	18	Standard thermal glazing	35.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B74-75	1st	S	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B74-75	1st	E	47.1	30	17.1	30	-12.9	17	Standard thermal glazing	34.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B76	1st	E	47.8	30	17.8	30	-12.2	18	Standard thermal glazing	34.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B76	1st	S	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B76	1st	W	46.9	30	16.9	30	-13.1	17	Standard thermal glazing	33.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B76	1st	N	46.4	30	16.4	30	-13.6	16	Standard thermal glazing	33.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B77	1st	E	46.7	30	16.7	30	-13.3	17	Standard thermal glazing	33.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B77	1st	S	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B77	1st	W	49.6	30	19.6	30	-10.4	20	Standard thermal glazing	36.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B77	1st	N	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B78	1st	S	50.3	30	20.3	30	-9.7	20	Standard thermal glazing	37.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B78	1st	W	49.6	30	19.6	30	-10.4	20	Standard thermal glazing	36.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B78	1st	N	45.8	30	15.8	30	-14.2	16	Standard thermal glazing	32.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B78	1st	E	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B79	1st	S	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B79	1st	E	49.9	30	19.9	30	-10.1	20	Standard thermal glazing	36.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B79	1st	N	45.5	30	15.5	30	-14.5	16	Standard thermal glazing	32.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B79	1st	W	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B80-81	1st	S	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B80-81	1st	E	46.9	30	16.9	30	-13.1	17	Standard thermal glazing	33.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B80-81	1st	N	45.5	30	15.5	30	-14.5	16	Standard thermal glazing	32.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B80-81	1st	W	49.2	30	19.2	30	-10.8	19	Standard thermal glazing	36.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B82	1st	S	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B82	1st	W	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B82	1st	N	45.7	30	15.7	30	-14.3	16	Standard thermal glazing	32.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B82	1st	E	46.6	30	16.6	30	-13.4	17	Standard thermal glazing	33.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B83	1st	E	46.5	30	16.5	30	-13.5	17	Standard thermal glazing	33.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B83	1st	S	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B83	1st	W	46.5	30	16.5	30	-13.5	17	Standard thermal glazing	33.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B83	1st	N	45.8	30	15.8	30	-14.2	16	Standard thermal glazing	32.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B84	1st	E	47.7	30	17.7	30	-12.3	18	Standard thermal glazing	34.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B84	1st	S	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B84	1st	W	46.7	30	16.7	30	-13.3	17	Standard thermal glazing	33.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B84	1st	N	45.9	30	15.9	30	-14.1	16	Standard thermal glazing	32.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B85-86	1st	S	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B85-86	1st	E	47.5	30	17.5	30	-12.5	18	Standard thermal glazing	34.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B85-86	1st	N	46.1	30	16.1	30	-13.9	16	Standard thermal glazing	33.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B85-86	1st	W	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B87-88	1st	S	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B87-88	1st	E	46.9	30	16.9	30	-13.1	17	Standard thermal glazing	33.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B87-88	1st	N	46.3	30	16.3	30	-13.7	16	Standard thermal glazing	33.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B87-88	1st	W	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B89	1st	S	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B89	1st	E	46.6	30	16.6	30	-13.4	17	Standard thermal glazing	33.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B89	1st	N	46.4	30	16.4	30	-13.6	16	Standard thermal glazing	33.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B89	1st	W	47.5	30	17.5	30	-12.5	18	Standard thermal glazing	34.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B90	1st	S	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B90	1st	E	46	30	16	30	-14	16	Standard thermal glazing	33	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B90	1st	N	46.7	30	16.7	30	-13.3	17	Standard thermal glazing	33.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B90	1st	W	46.8	30	16.8	30	-13.2	17	Standard thermal glazing	33.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B91	1st	E	49.3	30	19.3	30	-10.7	19	Standard thermal glazing	36.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B91	1st	N	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B91	1st	W	47.7	30	17.7	30	-12.3	18	Standard thermal glazing	34.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B91	1st	S	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B92	1st	E	51	30	21	30	-9	21	Standard thermal glazing	38	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B92	1st	S	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B92	1st	W	50	30	20	30	-10	20	Standard thermal glazing	37	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B92	1st	N	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B93	1st	S	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B93	1st	W	50.4	30	20.4	30	-9.6	20	Standard thermal glazing	37.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B93	1st	N	45.9	30	15.9	30	-14.1	16	Standard thermal glazing	32.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B93	1st	E	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B94	1st	E	49.7	30	19.7	30	-10.3	20	Standard thermal glazing	36.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B94	1st	S	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B94	1st	W	50	30	20	30	-10	20	Standard thermal glazing	37	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B94	1st	N	45.6	30	15.6	30	-14.4	16	Standard thermal glazing	32.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B95- 97	1st	E	48.1	30	18.1	30	-11.9	18	Standard thermal glazing	35.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B95- 97	1st	S	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B95- 97	1st	W	49.6	30	19.6	30	-10.4	20	Standard thermal glazing	36.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B95- 97	1st	N	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B98	1st	S	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B98	1st	W	48.3	30	18.3	30	-11.7	18	Standard thermal glazing	35.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B98	1st	N	46.3	30	16.3	30	-13.7	16	Standard thermal glazing	33.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B99-100	1st	E	48.1	30	18.1	30	-11.9	18	Standard thermal glazing	35.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B99-100	1st	S	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B99-100	1st	W	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B99-100	1st	N	46.5	30	16.5	30	-13.5	17	Standard thermal glazing	33.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B101-102	1st	E	46.8	30	16.8	30	-13.2	17	Standard thermal glazing	33.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B101-102	1st	S	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B101-102	1st	W	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B101-102	1st	N	46.6	30	16.6	30	-13.4	17	Standard thermal glazing	33.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B103	1st	N	46.8	30	16.8	30	-13.2	17	Standard thermal glazing	33.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B103	1st	W	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B103	1st	S	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B103	1st	E	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B104	1st	S	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B104	1st	E	51	30	21	30	-9	21	Standard thermal glazing	38	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B104	1st	N	47.6	30	17.6	30	-12.4	18	Standard thermal glazing	34.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B104	1st	W	49.9	30	19.9	30	-10.1	20	Standard thermal glazing	36.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B105	1st	E	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B105	1st	S	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B105	1st	W	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B105	1st	N	47.7	30	17.7	30	-12.3	18	Standard thermal glazing	34.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B106	1st	NE	53.8	30	23.8	30	-6.2	24	Standard thermal glazing	40.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B106	1st	SE	54.2	30	24.2	30	-5.8	24	Standard thermal glazing	41.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B106	1st	SW	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B106	1st	NW	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B107-108	1st	SW	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B107-108	1st	SE	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B107-108	1st	NE	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B107-108	1st	NW	49.4	30	19.4	30	-10.6	19	Standard thermal glazing	36.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B109	1st	SW	50.7	30	20.7	30	-9.3	21	Standard thermal glazing	37.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B109	1st	SE	50.7	30	20.7	30	-9.3	21	Standard thermal glazing	37.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B109	1st	NE	51.8	30	21.8	30	-8.2	22	Standard thermal glazing	38.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B109	1st	NW	48.7	30	18.7	30	-11.3	19	Standard thermal glazing	35.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B110-111	1st	NE	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B110-111	1st	SE	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B110-111	1st	SW	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B110-111	1st	NW	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B112	1st	NE	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B112	1st	SE	50.4	30	20.4	30	-9.6	20	Standard thermal glazing	37.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B112	1st	SW	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B112	1st	NW	48.5	30	18.5	30	-11.5	19	Standard thermal glazing	35.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B113-114	1st	NE	51.8	30	21.8	30	-8.2	22	Standard thermal glazing	38.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B113-114	1st	SE	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B113-114	1st	SW	50.6	30	20.6	30	-9.4	21	Standard thermal glazing	37.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B113-114	1st	NW	48.3	30	18.3	30	-11.7	18	Standard thermal glazing	35.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B115-116	1st	NE	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B115-116	1st	SE	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B115-116	1st	SW	50.7	30	20.7	30	-9.3	21	Standard thermal glazing	37.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B115-116	1st	NW	48	30	18	30	-12	18	Standard thermal glazing	35	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B117	1st	SW	50.3	30	20.3	30	-9.7	20	Standard thermal glazing	37.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B117	1st	SE	50.7	30	20.7	30	-9.3	21	Standard thermal glazing	37.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B117	1st	NE	51.8	30	21.8	30	-8.2	22	Standard thermal glazing	38.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B117	1st	NW	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B118-120	1st	SE	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B118-120	1st	SW	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B118-120	1st	NW	48.1	30	18.1	30	-11.9	18	Standard thermal glazing	35.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B118-120	1st	NE	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B121-122	1st	NE	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B121-122	1st	SE	51	30	21	30	-9	21	Standard thermal glazing	38	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B121-122	1st	SW	50.4	30	20.4	30	-9.6	20	Standard thermal glazing	37.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B121-122	1st	NW	48	30	18	30	-12	18	Standard thermal glazing	35	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B123-124	1st	NE	52.7	30	22.7	30	-7.3	23	Standard thermal glazing	39.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B123-124	1st	SE	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B123-124	1st	SW	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B123-124	1st	NW	49	30	19	30	-11	19	Standard thermal glazing	36	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B125	1st	N	49.8	30	19.8	30	-10.2	20	Standard thermal glazing	36.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B125	1st	W	50.2	30	20.2	30	-9.8	20	Standard thermal glazing	37.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B125	1st	SE	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B125	1st	E	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B126-127	1st	E	53.7	30	23.7	30	-6.3	24	Standard thermal glazing	40.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B126-127	1st	N	54.6	30	24.6	30	-5.4	25	Standard thermal glazing	41.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B126-127	1st	W	50.3	30	20.3	30	-9.7	20	Standard thermal glazing	37.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B126-127	1st	S	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B128	1st	W	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B128	1st	S	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B128	1st	E	59.7	30	29.7	30	-0.3	30	Standard thermal glazing	46.7	Yes	Yes	ADF System 4	MVHR without T.V.
Plot B128	1st	N	59	30	29	30	-1	29	Standard thermal glazing	46	Yes	Yes	ADF System 4	MVHR without T.V.
Plot B129	1st	SW	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B129	1st	SE	58.1	30	28.1	30	-1.9	28	Standard thermal glazing	45.1	Yes	Yes	ADF System 4	MVHR without T.V.
Plot B129	1st	NE	61.3	30	31.3	30	1.3	31	Upgraded glazing	48.3	Yes	Yes	ADF System 4	MVHR without T.V.
Plot B129	1st	NW	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B130-131	1st	NE	62.9	30	32.9	30	2.9	33	Upgraded glazing	49.9	Yes	Yes	ADF System 4	MVHR without T.V.
Plot B130-131	1st	SE	58.1	30	28.1	30	-1.9	28	Standard thermal glazing	45.1	Yes	Yes	ADF System 4	MVHR without T.V.
Plot B130-131	1st	SW	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B130-131	1st	NW	54.2	30	24.2	30	-5.8	24	Standard thermal glazing	41.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B132-133	1st	NE	63.3	30	33.3	30	3.3	33	Upgraded glazing	50.3	Yes	Yes	ADF System 4	MVHR without T.V.
Plot B132-133	1st	SE	57.6	30	27.6	30	-2.4	28	Standard thermal glazing	44.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B132-133	1st	SW	50.6	30	20.6	30	-9.4	21	Standard thermal glazing	37.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B132-133	1st	NW	57.1	30	27.1	30	-2.9	27	Standard thermal glazing	44.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B134-135	1st	NE	62.6	30	32.6	30	2.6	33	Upgraded glazing	49.6	Yes	Yes	ADF System 4	MVHR without T.V.
Plot B134-135	1st	SE	54.9	30	24.9	30	-5.1	25	Standard thermal glazing	41.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B134-135	1st	SW	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B134-135	1st	NW	56.2	30	26.2	30	-3.8	26	Standard thermal glazing	43.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B136-137	1st	NE	61.5	30	31.5	30	1.5	32	Upgraded glazing	48.5	Yes	Yes	ADF System 4	MVHR without T.V.
Plot B136-137	1st	SE	54.3	30	24.3	30	-5.7	24	Standard thermal glazing	41.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B136-137	1st	SW	50.6	30	20.6	30	-9.4	21	Standard thermal glazing	37.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B136-137	1st	NW	53.4	30	23.4	30	-6.6	23	Standard thermal glazing	40.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B138-139	1st	NE	60.5	30	30.5	30	0.5	31	Upgraded glazing	47.5	Yes	Yes	ADF System 4	MVHR without T.V
Plot B138-139	1st	SE	53.3	30	23.3	30	-6.7	23	Standard thermal glazing	40.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B138-139	1st	SW	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B138-139	1st	NW	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B140-141	1st	NE	60.6	30	30.6	30	0.6	31	Upgraded glazing	47.6	Yes	Yes	ADF System 4	MVHR without T.V
Plot B140-141	1st	SE	53.5	30	23.5	30	-6.5	24	Standard thermal glazing	40.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B140-141	1st	SW	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B140-141	1st	NW	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B142-143	1st	NE	60.9	30	30.9	30	0.9	31	Upgraded glazing	47.9	Yes	Yes	ADF System 4	MVHR without T.V
Plot B142-143	1st	SE	56.2	30	26.2	30	-3.8	26	Standard thermal glazing	43.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B142-143	1st	SW	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B142-143	1st	NW	53.2	30	23.2	30	-6.8	23	Standard thermal glazing	40.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B144	1st	S	56.3	30	26.3	30	-3.7	26	Standard thermal glazing	43.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B144	1st	E	60.6	30	30.6	30	0.6	31	Upgraded glazing	47.6	Yes	Yes	ADF System 4	MVHR without T.V
Plot B144	1st	NE	61.2	30	31.2	30	1.2	31	Upgraded glazing	48.2	Yes	Yes	ADF System 4	MVHR without T.V
Plot B144	1st	NW	56.1	30	26.1	30	-3.9	26	Standard thermal glazing	43.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B144	1st	SW	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B145	1st	SW	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B145	1st	SE	57.4	30	27.4	30	-2.6	27	Standard thermal glazing	44.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B145	1st	E	59.1	30	29.1	30	-0.9	29	Standard thermal glazing	46.1	Yes	Yes	ADF System 4	MVHR without T.V
Plot B145	1st	N	54.4	30	24.4	30	-5.6	24	Standard thermal glazing	41.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B145	1st	W	49.8	30	19.8	30	-10.2	20	Standard thermal glazing	36.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B146	1st	E	56	30	26	30	-4	26	Standard thermal glazing	43	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B146	1st	N	61.2	30	31.2	30	1.2	31	Upgraded glazing	48.2	Yes	Yes	ADF System 4	MVHR without T.V
Plot B146	1st	NW	57.1	30	27.1	30	-2.9	27	Standard thermal glazing	44.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B146	1st	SW	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B146	1st	S	53.3	30	23.3	30	-6.7	23	Standard thermal glazing	40.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B147	1st	NE	65.3	30	35.3	30	5.3	35	Upgraded glazing	52.3	Yes	Yes	ADF System 4	MVHR without T.V
Plot B147	1st	SE	63.2	30	33.2	30	3.2	33	Upgraded glazing	50.2	Yes	Yes	ADF System 4	MVHR without T.V
Plot B147	1st	S	53.2	30	23.2	30	-6.8	23	Standard thermal glazing	40.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6
Date: 27th November 2024
Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B147	1st	W	55.3	30	25.3	30	-4.7	25	Standard thermal glazing	42.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B147	1st	N	62.9	30	32.9	30	2.9	33	Upgraded glazing	49.9	Yes	Yes	ADF System 4	MVHR without T.V
Plot B148-149	1st	NE	64.8	30	34.8	30	4.8	35	Upgraded glazing	51.8	Yes	Yes	ADF System 4	MVHR without T.V
Plot B148-149	1st	SE	57.8	30	27.8	30	-2.2	28	Standard thermal glazing	44.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B148-149	1st	SW	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B148-149	1st	NW	57.3	30	27.3	30	-2.7	27	Standard thermal glazing	44.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B150-151	1st	NE	65.6	30	35.6	30	5.6	36	Upgraded glazing	52.6	Yes	Yes	ADF System 4	MVHR without T.V
Plot B150-151	1st	SE	60.2	30	30.2	30	0.2	30	Standard thermal glazing	47.2	Yes	Yes	ADF System 4	MVHR without T.V
Plot B150-151	1st	SW	53.1	30	23.1	30	-6.9	23	Standard thermal glazing	40.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B150-151	1st	NW	57.6	30	27.6	30	-2.4	28	Standard thermal glazing	44.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B152	1st	NE	66	30	36	30	6	36	Upgraded glazing	53	Yes	Yes	ADF System 4	MVHR without T.V
Plot B152	1st	SE	58.5	30	28.5	30	-1.5	29	Standard thermal glazing	45.5	Yes	Yes	ADF System 4	MVHR without T.V
Plot B152	1st	SW	52.9	30	22.9	30	-7.1	23	Standard thermal glazing	39.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B152	1st	NW	59.8	30	29.8	30	-0.2	30	Standard thermal glazing	46.8	Yes	Yes	ADF System 4	MVHR without T.V
Plot B153-154	1st	NE	65.8	30	35.8	30	5.8	36	Upgraded glazing	52.8	Yes	Yes	ADF System 4	MVHR without T.V
Plot B153-154	1st	SE	58.6	30	28.6	30	-1.4	29	Standard thermal glazing	45.6	Yes	Yes	ADF System 4	MVHR without T.V
Plot B153-154	1st	SW	53.1	30	23.1	30	-6.9	23	Standard thermal glazing	40.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B153-154	1st	NW	57.2	30	27.2	30	-2.8	27	Standard thermal glazing	44.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B155-156	1st	SW	53.1	30	23.1	30	-6.9	23	Standard thermal glazing	40.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B155-156	1st	SE	58.1	30	28.1	30	-1.9	28	Standard thermal glazing	45.1	Yes	Yes	ADF System 4	MVHR without T.V
Plot B155-156	1st	NE	65.6	30	35.6	30	5.6	36	Upgraded glazing	52.6	Yes	Yes	ADF System 4	MVHR without T.V
Plot B155-156	1st	NW	57	30	27	30	-3	27	Standard thermal glazing	44	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B157-158	1st	NE	65.9	30	35.9	30	5.9	36	Upgraded glazing	52.9	Yes	Yes	ADF System 4	MVHR without T.V
Plot B157-158	1st	SE	58.2	30	28.2	30	-1.8	28	Standard thermal glazing	45.2	Yes	Yes	ADF System 4	MVHR without T.V
Plot B157-158	1st	SW	53.9	30	23.9	30	-6.1	24	Standard thermal glazing	40.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B157-158	1st	NW	58	30	28	30	-2	28	Standard thermal glazing	45	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B159-160	1st	SW	53.6	30	23.6	30	-6.4	24	Standard thermal glazing	40.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B159-160	1st	SE	58.5	30	28.5	30	-1.5	29	Standard thermal glazing	45.5	Yes	Yes	ADF System 4	MVHR without T.V
Plot B159-160	1st	NE	65.4	30	35.4	30	5.4	35	Upgraded glazing	52.4	Yes	Yes	ADF System 4	MVHR without T.V
Plot B159-160	1st	NW	57.3	30	27.3	30	-2.7	27	Standard thermal glazing	44.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B161-162	1st	SE	59.5	30	29.5	30	-0.5	30	Standard thermal glazing	46.5	Yes	Yes	ADF System 4	MVHR without T.V
Plot B161-162	1st	NE	65.5	30	35.5	30	5.5	36	Upgraded glazing	52.5	Yes	Yes	ADF System 4	MVHR without T.V

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B161-162	1st	NW	58.2	30	28.2	30	-1.8	28	Standard thermal glazing	45.2	Yes	Yes	ADF System 4	MVHR without T.V
Plot B161-162	1st	SW	54.2	30	24.2	30	-5.8	24	Standard thermal glazing	41.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B163-164	1st	SE	57.3	30	27.3	30	-2.7	27	Standard thermal glazing	44.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B163-164	1st	NE	64.9	30	34.9	30	4.9	35	Upgraded glazing	51.9	Yes	Yes	ADF System 4	MVHR without T.V
Plot B163-164	1st	NW	58.6	30	28.6	30	-1.4	29	Standard thermal glazing	45.6	Yes	Yes	ADF System 4	MVHR without T.V
Plot B163-164	1st	SW	54.4	30	24.4	30	-5.6	24	Standard thermal glazing	41.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B165-166	1st	NE	63.6	30	33.6	30	3.6	34	Upgraded glazing	50.6	Yes	Yes	ADF System 4	MVHR without T.V
Plot B165-166	1st	SE	55.5	30	25.5	30	-4.5	26	Standard thermal glazing	42.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B165-166	1st	SW	54.9	30	24.9	30	-5.1	25	Standard thermal glazing	41.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B165-166	1st	NW	57.3	30	27.3	30	-2.7	27	Standard thermal glazing	44.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B167	1st	NE	62.2	30	32.2	30	2.2	32	Upgraded glazing	49.2	Yes	Yes	ADF System 4	MVHR without T.V
Plot B167	1st	SE	55.3	30	25.3	30	-4.7	25	Standard thermal glazing	42.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B167	1st	SW	54.7	30	24.7	30	-5.3	25	Standard thermal glazing	41.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B167	1st	NW	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B168	1st	NE	61	30	31	30	1	31	Upgraded glazing	48	Yes	Yes	ADF System 4	MVHR without T.V
Plot B168	1st	SE	55.6	30	25.6	30	-4.4	26	Standard thermal glazing	42.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B168	1st	SW	54.5	30	24.5	30	-5.5	25	Standard thermal glazing	41.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B168	1st	NW	52.9	30	22.9	30	-7.1	23	Standard thermal glazing	39.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B169	1st	NE	61.9	30	31.9	30	1.9	32	Upgraded glazing	48.9	Yes	Yes	ADF System 4	MVHR without T.V
Plot B169	1st	E	60.6	30	30.6	30	0.6	31	Upgraded glazing	47.6	Yes	Yes	ADF System 4	MVHR without T.V
Plot B169	1st	S	56.6	30	26.6	30	-3.4	27	Standard thermal glazing	43.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B169	1st	SW	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B169	1st	NW	59.3	30	29.3	30	-0.7	29	Standard thermal glazing	46.3	Yes	Yes	ADF System 4	MVHR without T.V
Plot B170	1st	N	53.5	30	23.5	30	-6.5	24	Standard thermal glazing	40.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B170	1st	E	60.4	30	30.4	30	0.4	30	Standard thermal glazing	47.4	Yes	Yes	ADF System 4	MVHR without T.V
Plot B170	1st	SE	60.9	30	30.9	30	0.9	31	Upgraded glazing	47.9	Yes	Yes	ADF System 4	MVHR without T.V
Plot B170	1st	SW	54.7	30	24.7	30	-5.3	25	Standard thermal glazing	41.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B170	1st	W	51	30	21	30	-9	21	Standard thermal glazing	38	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B171	1st	NE	57.2	30	27.2	30	-2.8	27	Standard thermal glazing	44.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot B171	1st	NW	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot B171	1st	SW	53.7	30	23.7	30	-6.3	24	Standard thermal glazing	40.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot B171	1st	SE	60.3	30	30.3	30	0.3	30	Standard thermal glazing	47.3	Yes	Yes	ADF System 4	MVHR without T.V
Plot C1-2	1st	SW	47	30	17	30	-13	17	Standard thermal glazing	34	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C1-2	1st	SE	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C1-2	1st	NE	45.4	30	15.4	30	-14.6	15	Standard thermal glazing	32.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C1-2	1st	NW	48.9	30	18.9	30	-11.1	19	Standard thermal glazing	35.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C3-4	1st	NE	45.6	30	15.6	30	-14.4	16	Standard thermal glazing	32.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C3-4	1st	SE	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C3-4	1st	SW	50.6	30	20.6	30	-9.4	21	Standard thermal glazing	37.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C3-4	1st	NW	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C5	1st	NE	46.3	30	16.3	30	-13.7	16	Standard thermal glazing	33.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C5	1st	SE	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C5	1st	SW	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C5	1st	NW	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C6	1st	NE	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C6	1st	SE	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C6	1st	SW	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C6	1st	NW	47.8	30	17.8	30	-12.2	18	Standard thermal glazing	34.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C7-8	1st	SE	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C7-8	1st	NE	46.3	30	16.3	30	-13.7	16	Standard thermal glazing	33.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C7-8	1st	NW	46.8	30	16.8	30	-13.2	17	Standard thermal glazing	33.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C7-8	1st	SW	49.4	30	19.4	30	-10.6	19	Standard thermal glazing	36.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C9-11	1st	SE	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C9-11	1st	SW	49.2	30	19.2	30	-10.8	19	Standard thermal glazing	36.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C9-11	1st	NW	47	30	17	30	-13	17	Standard thermal glazing	34	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C9-11	1st	NE	44.9	30	14.9	30	-15.1	15	Standard thermal glazing	31.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C12	1st	SE	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C12	1st	SW	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C12	1st	NW	49.9	30	19.9	30	-10.1	20	Standard thermal glazing	36.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C12	1st	NE	46.5	30	16.5	30	-13.5	17	Standard thermal glazing	33.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C13-14	1st	SW	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C13-14	1st	SE	50.1	30	20.1	30	-9.9	20	Standard thermal glazing	37.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C13-14	1st	NE	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C13-14	1st	NW	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C15	1st	S	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C15	1st	E	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C15	1st	N	45.7	30	15.7	30	-14.3	16	Standard thermal glazing	32.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C15	1st	W	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C16-17	1st	S	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C16-17	1st	E	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C16-17	1st	N	45.4	30	15.4	30	-14.6	15	Standard thermal glazing	32.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C16-17	1st	W	49.2	30	19.2	30	-10.8	19	Standard thermal glazing	36.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C18-19	1st	E	48.3	30	18.3	30	-11.7	18	Standard thermal glazing	35.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C18-19	1st	N	44.8	30	14.8	30	-15.2	15	Standard thermal glazing	31.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C18-19	1st	W	49.3	30	19.3	30	-10.7	19	Standard thermal glazing	36.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C20	1st	E	47.6	30	17.6	30	-12.4	18	Standard thermal glazing	34.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C20	1st	N	44.7	30	14.7	30	-15.3	15	Standard thermal glazing	31.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C20	1st	W	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C20	1st	S	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C21-23	1st	E	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C21-23	1st	S	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C21-23	1st	SW	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C21-23	1st	NW	44.8	30	14.8	30	-15.2	15	Standard thermal glazing	31.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C24	1st	NE	49.6	30	19.6	30	-10.4	20	Standard thermal glazing	36.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C24	1st	N	44.9	30	14.9	30	-15.1	15	Standard thermal glazing	31.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C24	1st	W	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C24	1st	SE	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C25	1st	E	49.2	30	19.2	30	-10.8	19	Standard thermal glazing	36.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C25	1st	S	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C25	1st	W	50.3	30	20.3	30	-9.7	20	Standard thermal glazing	37.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C25	1st	N	45	30	15	30	-15	15	Standard thermal glazing	32	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C26-27	1st	SE	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C26-27	1st	SW	47.7	30	17.7	30	-12.3	18	Standard thermal glazing	34.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C26-27	1st	NW	50.1	30	20.1	30	-9.9	20	Standard thermal glazing	37.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C26-27	1st	NE	46.4	30	16.4	30	-13.6	16	Standard thermal glazing	33.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C28-29	1st	SE	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C28-29	1st	SW	48.2	30	18.2	30	-11.8	18	Standard thermal glazing	35.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C28-29	1st	NW	50.3	30	20.3	30	-9.7	20	Standard thermal glazing	37.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C28-29	1st	NE	45.3	30	15.3	30	-14.7	15	Standard thermal glazing	32.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C30	1st	SE	49.7	30	19.7	30	-10.3	20	Standard thermal glazing	36.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C30	1st	SW	53.3	30	23.3	30	-6.7	23	Standard thermal glazing	40.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C30	1st	NW	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C30	1st	NE	46.4	30	16.4	30	-13.6	16	Standard thermal glazing	33.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C31-33	1st	E	48.7	30	18.7	30	-11.3	19	Standard thermal glazing	35.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C31-33	1st	S	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C31-33	1st	W	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C31-33	1st	N	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C34	1st	E	48	30	18	30	-12	18	Standard thermal glazing	35	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C34	1st	S	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C34	1st	W	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C34	1st	N	45.7	30	15.7	30	-14.3	16	Standard thermal glazing	32.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C35-36	1st	E	48.2	30	18.2	30	-11.8	18	Standard thermal glazing	35.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C35-36	1st	S	51.8	30	21.8	30	-8.2	22	Standard thermal glazing	38.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C35-36	1st	W	48	30	18	30	-12	18	Standard thermal glazing	35	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C35-36	1st	N	45.4	30	15.4	30	-14.6	15	Standard thermal glazing	32.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C37-38	1st	N	45.4	30	15.4	30	-14.6	15	Standard thermal glazing	32.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C37-38	1st	E	50	30	20	30	-10	20	Standard thermal glazing	37	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C37-38	1st	S	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C37-38	1st	W	49.7	30	19.7	30	-10.3	20	Standard thermal glazing	36.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C39	1st	S	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C39	1st	W	49.6	30	19.6	30	-10.4	20	Standard thermal glazing	36.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C39	1st	N	44.9	30	14.9	30	-15.1	15	Standard thermal glazing	31.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C39	1st	E	47.6	30	17.6	30	-12.4	18	Standard thermal glazing	34.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C40-42	1st	E	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C40-42	1st	SE	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C40-42	1st	W	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C40-42	1st	NW	45.1	30	15.1	30	-14.9	15	Standard thermal glazing	32.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C43	1st	SE	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C43	1st	NE	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C43	1st	NW	45.2	30	15.2	30	-14.8	15	Standard thermal glazing	32.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C43	1st	W	49.7	30	19.7	30	-10.3	20	Standard thermal glazing	36.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C44-45	1st	NW	45.3	30	15.3	30	-14.7	15	Standard thermal glazing	32.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C44-45	1st	NE	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C44-45	1st	SE	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C44-45	1st	SW	49.8	30	19.8	30	-10.2	20	Standard thermal glazing	36.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C46-47	1st	W	50.6	30	20.6	30	-9.4	21	Standard thermal glazing	37.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C46-47	1st	S	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C46-47	1st	E	47.8	30	17.8	30	-12.2	18	Standard thermal glazing	34.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C46-47	1st	N	46.1	30	16.1	30	-13.9	16	Standard thermal glazing	33.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C48-49	1st	W	47.1	30	17.1	30	-12.9	17	Standard thermal glazing	34.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C48-49	1st	S	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C48-49	1st	E	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C48-49	1st	N	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C50	1st	N	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C50	1st	W	48.3	30	18.3	30	-11.7	18	Standard thermal glazing	35.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C50	1st	S	51.9	30	21.9	30	-8.1	22	Standard thermal glazing	38.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C51	1st	E	47.6	30	17.6	30	-12.4	18	Standard thermal glazing	34.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C51	1st	S	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C51	1st	W	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C51	1st	N	46.1	30	16.1	30	-13.9	16	Standard thermal glazing	33.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C52-54	1st	E	46.5	30	16.5	30	-13.5	17	Standard thermal glazing	33.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C52-54	1st	S	51.9	30	21.9	30	-8.1	22	Standard thermal glazing	38.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C52-54	1st	W	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C52-54	1st	N	46.4	30	16.4	30	-13.6	16	Standard thermal glazing	33.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C55	1st	E	48.1	30	18.1	30	-11.9	18	Standard thermal glazing	35.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C55	1st	N	46.7	30	16.7	30	-13.3	17	Standard thermal glazing	33.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C55	1st	W	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C55	1st	S	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C56-58	1st	NE	47.7	30	17.7	30	-12.3	18	Standard thermal glazing	34.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C56-58	1st	SE	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C56-58	1st	SW	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C56-58	1st	NW	46.7	30	16.7	30	-13.3	17	Standard thermal glazing	33.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C59-60	1st	NE	48.7	30	18.7	30	-11.3	19	Standard thermal glazing	35.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C59-60	1st	SE	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C59-60	1st	SW	48.1	30	18.1	30	-11.9	18	Standard thermal glazing	35.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C59-60	1st	NW	47.1	30	17.1	30	-12.9	17	Standard thermal glazing	34.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C61	1st	NW	47.7	30	17.7	30	-12.3	18	Standard thermal glazing	34.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C61	1st	SW	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C61	1st	SE	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C62	1st	NE	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C62	1st	SE	52.9	30	22.9	30	-7.1	23	Standard thermal glazing	39.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C62	1st	SW	47.6	30	17.6	30	-12.4	18	Standard thermal glazing	34.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C62	1st	NW	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C63	1st	S	50.1	30	20.1	30	-9.9	20	Standard thermal glazing	37.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C63	1st	W	50.4	30	20.4	30	-9.6	20	Standard thermal glazing	37.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C63	1st	N	46.4	30	16.4	30	-13.6	16	Standard thermal glazing	33.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C63	1st	E	50	30	20	30	-10	20	Standard thermal glazing	37	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C64	1st	W	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C64	1st	S	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C64	1st	E	50.2	30	20.2	30	-9.8	20	Standard thermal glazing	37.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C64	1st	N	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C65	1st	S	51.9	30	21.9	30	-8.1	22	Standard thermal glazing	38.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C65	1st	W	50.1	30	20.1	30	-9.9	20	Standard thermal glazing	37.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C65	1st	N	46.6	30	16.6	30	-13.4	17	Standard thermal glazing	33.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C66-67	1st	E	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C66-67	1st	S	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C66-67	1st	W	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C66-67	1st	N	46.6	30	16.6	30	-13.4	17	Standard thermal glazing	33.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C68	1st	E	47.7	30	17.7	30	-12.3	18	Standard thermal glazing	34.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C68	1st	S	51.8	30	21.8	30	-8.2	22	Standard thermal glazing	38.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C68	1st	W	48	30	18	30	-12	18	Standard thermal glazing	35	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C68	1st	N	46.7	30	16.7	30	-13.3	17	Standard thermal glazing	33.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C69-70	1st	E	48.2	30	18.2	30	-11.8	18	Standard thermal glazing	35.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C69-70	1st	S	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C69-70	1st	W	48.3	30	18.3	30	-11.7	18	Standard thermal glazing	35.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C69-70	1st	N	46.8	30	16.8	30	-13.2	17	Standard thermal glazing	33.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C71	1st	E	47.9	30	17.9	30	-12.1	18	Standard thermal glazing	34.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C71	1st	S	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C71	1st	W	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C71	1st	N	46.9	30	16.9	30	-13.1	17	Standard thermal glazing	33.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C72-73	1st	NE	47.8	30	17.8	30	-12.2	18	Standard thermal glazing	34.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C72-73	1st	SE	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C72-73	1st	SW	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C72-73	1st	NW	47.1	30	17.1	30	-12.9	17	Standard thermal glazing	34.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C74	1st	NW	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C74	1st	SW	48.3	30	18.3	30	-11.7	18	Standard thermal glazing	35.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C74	1st	SE	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C74	1st	NE	48	30	18	30	-12	18	Standard thermal glazing	35	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C75-76	1st	NE	49.2	30	19.2	30	-10.8	19	Standard thermal glazing	36.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C75-76	1st	SE	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C75-76	1st	SW	48.5	30	18.5	30	-11.5	19	Standard thermal glazing	35.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C75-76	1st	NW	47.5	30	17.5	30	-12.5	18	Standard thermal glazing	34.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C77-78	1st	NE	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C77-78	1st	SE	52.7	30	22.7	30	-7.3	23	Standard thermal glazing	39.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C77-78	1st	SW	49.2	30	19.2	30	-10.8	19	Standard thermal glazing	36.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C77-78	1st	NW	48	30	18	30	-12	18	Standard thermal glazing	35	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C79-80	1st	SW	50.7	30	20.7	30	-9.3	21	Standard thermal glazing	37.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C79-80	1st	SE	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C79-80	1st	NE	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C79-80	1st	NW	48.1	30	18.1	30	-11.9	18	Standard thermal glazing	35.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C81	1st	NE	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C81	1st	SE	52.7	30	22.7	30	-7.3	23	Standard thermal glazing	39.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C81	1st	SW	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C81	1st	NW	49.2	30	19.2	30	-10.8	19	Standard thermal glazing	36.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C82-83	1st	NE	51.9	30	21.9	30	-8.1	22	Standard thermal glazing	38.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C82-83	1st	SE	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C82-83	1st	SW	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C82-83	1st	NW	49.7	30	19.7	30	-10.3	20	Standard thermal glazing	36.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C84-85	1st	NE	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C84-85	1st	SE	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C84-85	1st	SW	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C84-85	1st	NW	50	30	20	30	-10	20	Standard thermal glazing	37	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C86	1st	NE	51.8	30	21.8	30	-8.2	22	Standard thermal glazing	38.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C86	1st	SE	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C86	1st	SW	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C86	1st	NW	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C87-89	1st	SW	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C87-89	1st	SE	51.8	30	21.8	30	-8.2	22	Standard thermal glazing	38.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C87-89	1st	NE	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C87-89	1st	NW	49	30	19	30	-11	19	Standard thermal glazing	36	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C90	1st	NE	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C90	1st	SE	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C90	1st	SW	53.6	30	23.6	30	-6.4	24	Standard thermal glazing	40.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C90	1st	NW	49.2	30	19.2	30	-10.8	19	Standard thermal glazing	36.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C91-92	1st	NE	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C91-92	1st	SE	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C91-92	1st	SW	54	30	24	30	-6	24	Standard thermal glazing	41	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C91-92	1st	NW	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C93	1st	NE	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C93	1st	SE	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C93	1st	SW	54.2	30	24.2	30	-5.8	24	Standard thermal glazing	41.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C93	1st	NW	50	30	20	30	-10	20	Standard thermal glazing	37	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C94-95	1st	NE	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C94-95	1st	SE	54	30	24	30	-6	24	Standard thermal glazing	41	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C94-95	1st	SW	53.8	30	23.8	30	-6.2	24	Standard thermal glazing	40.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C94-95	1st	NW	49.7	30	19.7	30	-10.3	20	Standard thermal glazing	36.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C96-98	1st	SW	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C96-98	1st	SE	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C96-98	1st	NE	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C96-98	1st	NW	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C99	1st	NW	49.7	30	19.7	30	-10.3	20	Standard thermal glazing	36.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C99	1st	NE	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C99	1st	SE	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C99	1st	SW	53.1	30	23.1	30	-6.9	23	Standard thermal glazing	40.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C100-101	1st	SW	52.9	30	22.9	30	-7.1	23	Standard thermal glazing	39.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C100-101	1st	SE	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C100-101	1st	NE	52.9	30	22.9	30	-7.1	23	Standard thermal glazing	39.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C100-101	1st	NW	49.4	30	19.4	30	-10.6	19	Standard thermal glazing	36.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C102-103	1st	E	53.9	30	23.9	30	-6.1	24	Standard thermal glazing	40.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C102-103	1st	S	54.4	30	24.4	30	-5.6	24	Standard thermal glazing	41.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C102-103	1st	W	53.3	30	23.3	30	-6.7	23	Standard thermal glazing	40.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C102-103	1st	N	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C104	1st	E	55.3	30	25.3	30	-4.7	25	Standard thermal glazing	42.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C104	1st	SE	56.6	30	26.6	30	-3.4	27	Standard thermal glazing	43.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C104	1st	SW	53.8	30	23.8	30	-6.2	24	Standard thermal glazing	40.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C104	1st	W	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C104	1st	N	50.2	30	20.2	30	-9.8	20	Standard thermal glazing	37.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C105	1st	SE	56.7	30	26.7	30	-3.3	27	Standard thermal glazing	43.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C105	1st	S	58.8	30	28.8	30	-1.2	29	Standard thermal glazing	45.8	Yes	Yes	ADF System 4	MVHR without T.V
Plot C105	1st	W	54.7	30	24.7	30	-5.3	25	Standard thermal glazing	41.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C105	1st	N	48.9	30	18.9	30	-11.1	19	Standard thermal glazing	35.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C105	1st	NE	53.6	30	23.6	30	-6.4	24	Standard thermal glazing	40.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C106	1st	E	55.4	30	25.4	30	-4.6	25	Standard thermal glazing	42.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C106	1st	S	59.5	30	29.5	30	-0.5	30	Standard thermal glazing	46.5	Yes	Yes	ADF System 4	MVHR without T.V
Plot C106	1st	SW	58.1	30	28.1	30	-1.9	28	Standard thermal glazing	45.1	Yes	Yes	ADF System 4	MVHR without T.V
Plot C106	1st	NW	54.4	30	24.4	30	-5.6	24	Standard thermal glazing	41.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C106	1st	N	49.7	30	19.7	30	-10.3	20	Standard thermal glazing	36.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C107	1st	SE	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C107	1st	SW	57.2	30	27.2	30	-2.8	27	Standard thermal glazing	44.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C107	1st	W	54.4	30	24.4	30	-5.6	24	Standard thermal glazing	41.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C107	1st	N	49.7	30	19.7	30	-10.3	20	Standard thermal glazing	36.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C107	1st	E	50.6	30	20.6	30	-9.4	21	Standard thermal glazing	37.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C108	1st	E	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C108	1st	S	53.7	30	23.7	30	-6.3	24	Standard thermal glazing	40.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C108	1st	W	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C108	1st	N	49.3	30	19.3	30	-10.7	19	Standard thermal glazing	36.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C109-111	1st	NE	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C109-111	1st	SE	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot C109-111	1st	SW	52.9	30	22.9	30	-7.1	23	Standard thermal glazing	39.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C109-111	1st	NW	49.8	30	19.8	30	-10.2	20	Standard thermal glazing	36.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C112-114	1st	NE	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C112-114	1st	SE	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C112-114	1st	SW	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C112-114	1st	NW	50	30	20	30	-10	20	Standard thermal glazing	37	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C115-117	1st	NE	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C115-117	1st	SE	52.7	30	22.7	30	-7.3	23	Standard thermal glazing	39.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C115-117	1st	SW	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C115-117	1st	NW	49.6	30	19.6	30	-10.4	20	Standard thermal glazing	36.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C118-120	1st	SW	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C118-120	1st	SE	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C118-120	1st	NE	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C118-120	1st	NW	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C121-122	1st	SW	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C121-122	1st	SE	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C121-122	1st	NE	52.7	30	22.7	30	-7.3	23	Standard thermal glazing	39.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C121-122	1st	NW	49.3	30	19.3	30	-10.7	19	Standard thermal glazing	36.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C123-124	1st	SW	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C123-124	1st	SE	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C123-124	1st	NE	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C123-124	1st	NW	50.4	30	20.4	30	-9.6	20	Standard thermal glazing	37.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C125-127	1st	SW	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C125-127	1st	SE	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C125-127	1st	NE	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C125-127	1st	NW	49.6	30	19.6	30	-10.4	20	Standard thermal glazing	36.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C128-129	1st	NE	53.4	30	23.4	30	-6.6	23	Standard thermal glazing	40.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C128-129	1st	SE	54.8	30	24.8	30	-5.2	25	Standard thermal glazing	41.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C128-129	1st	SW	50.4	30	20.4	30	-9.6	20	Standard thermal glazing	37.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C128-129	1st	NW	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C130-131	1st	NE	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C130-131	1st	SE	54.1	30	24.1	30	-5.9	24	Standard thermal glazing	41.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot C130-131	1st	SW	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot C130-131	1st	NW	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D1	1st	NE	46.6	30	16.6	30	-13.4	17	Standard thermal glazing	33.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D1	1st	SE	52.9	30	22.9	30	-7.1	23	Standard thermal glazing	39.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D1	1st	SW	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D1	1st	NW	49.8	30	19.8	30	-10.2	20	Standard thermal glazing	36.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D2-3	1st	SW	46.3	30	16.3	30	-13.7	16	Standard thermal glazing	33.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D2-3	1st	SE	53.2	30	23.2	30	-6.8	23	Standard thermal glazing	40.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D2-3	1st	NE	45.6	30	15.6	30	-14.4	16	Standard thermal glazing	32.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D2-3	1st	NW	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D4	1st	NE	45	30	15	30	-15	15	Standard thermal glazing	32	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D4	1st	SE	54.2	30	24.2	30	-5.8	24	Standard thermal glazing	41.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D4	1st	SW	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D4	1st	NW	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D5	1st	SW	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D5	1st	SE	53.6	30	23.6	30	-6.4	24	Standard thermal glazing	40.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D5	1st	NE	45.8	30	15.8	30	-14.2	16	Standard thermal glazing	32.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D5	1st	NW	50.1	30	20.1	30	-9.9	20	Standard thermal glazing	37.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D6-7	1st	S	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D6-7	1st	E	53.6	30	23.6	30	-6.4	24	Standard thermal glazing	40.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D6-7	1st	N	45.3	30	15.3	30	-14.7	15	Standard thermal glazing	32.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D6-7	1st	W	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D8	1st	N	45.5	30	15.5	30	-14.5	16	Standard thermal glazing	32.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D8	1st	E	54.2	30	24.2	30	-5.8	24	Standard thermal glazing	41.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D8	1st	S	55.7	30	25.7	30	-4.3	26	Standard thermal glazing	42.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D8	1st	W	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D9	1st	SE	53.9	30	23.9	30	-6.1	24	Standard thermal glazing	40.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D9	1st	NE	46.1	30	16.1	30	-13.9	16	Standard thermal glazing	33.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D9	1st	NW	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D9	1st	SW	55.9	30	25.9	30	-4.1	26	Standard thermal glazing	42.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D10	1st	SW	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D10	1st	SE	53.4	30	23.4	30	-6.6	23	Standard thermal glazing	40.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D10	1st	NE	45.5	30	15.5	30	-14.5	16	Standard thermal glazing	32.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D10	1st	NW	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D11	1st	SW	48.7	30	18.7	30	-11.3	19	Standard thermal glazing	35.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D11	1st	SE	53.6	30	23.6	30	-6.4	24	Standard thermal glazing	40.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D11	1st	NE	46	30	16	30	-14	16	Standard thermal glazing	33	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D11	1st	NW	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D12-13	1st	SW	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D12-13	1st	SE	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D12-13	1st	NE	46.4	30	16.4	30	-13.6	16	Standard thermal glazing	33.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D12-13	1st	NW	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D14-15	1st	NE	46.7	30	16.7	30	-13.3	17	Standard thermal glazing	33.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D14-15	1st	SE	50.4	30	20.4	30	-9.6	20	Standard thermal glazing	37.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D14-15	1st	SW	54.8	30	24.8	30	-5.2	25	Standard thermal glazing	41.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D14-15	1st	NW	49.9	30	19.9	30	-10.1	20	Standard thermal glazing	36.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D16-17	1st	SW	46.9	30	16.9	30	-13.1	17	Standard thermal glazing	33.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D16-17	1st	SE	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D16-17	1st	NE	45.6	30	15.6	30	-14.4	16	Standard thermal glazing	32.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D16-17	1st	NW	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot 18-19	1st	NW	47.8	30	17.8	30	-12.2	18	Standard thermal glazing	34.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot 18-19	1st	NE	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot 18-19	1st	SE	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot 18-19	1st	SW	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D20	1st	NE	45.6	30	15.6	30	-14.4	16	Standard thermal glazing	32.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D20	1st	SE	54.2	30	24.2	30	-5.8	24	Standard thermal glazing	41.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D20	1st	SW	56.2	30	26.2	30	-3.8	26	Standard thermal glazing	43.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D20	1st	NW	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D21	1st	E	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D21	1st	S	56.3	30	26.3	30	-3.7	26	Standard thermal glazing	43.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D21	1st	W	54.2	30	24.2	30	-5.8	24	Standard thermal glazing	41.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D21	1st	N	46	30	16	30	-14	16	Standard thermal glazing	33	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D22	1st	S	56.1	30	26.1	30	-3.9	26	Standard thermal glazing	43.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D22	1st	E	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D22	1st	N	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D22	1st	W	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D23	1st	N	46.1	30	16.1	30	-13.9	16	Standard thermal glazing	33.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D23	1st	E	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D23	1st	S	56.6	30	26.6	30	-3.4	27	Standard thermal glazing	43.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D23	1st	W	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D24	1st	E	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D24	1st	N	46.1	30	16.1	30	-13.9	16	Standard thermal glazing	33.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D24	1st	W	49.9	30	19.9	30	-10.1	20	Standard thermal glazing	36.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D24	1st	S	56.4	30	26.4	30	-3.6	26	Standard thermal glazing	43.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D25-26	1st	E	51.8	30	21.8	30	-8.2	22	Standard thermal glazing	38.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D25-26	1st	S	56.8	30	26.8	30	-3.2	27	Standard thermal glazing	43.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D25-26	1st	W	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D25-26	1st	N	46.1	30	16.1	30	-13.9	16	Standard thermal glazing	33.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D27-28	1st	E	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D27-28	1st	S	56.9	30	26.9	30	-3.1	27	Standard thermal glazing	43.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D27-28	1st	W	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D27-28	1st	N	45.6	30	15.6	30	-14.4	16	Standard thermal glazing	32.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D29-31	1st	E	52.7	30	22.7	30	-7.3	23	Standard thermal glazing	39.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D29-31	1st	N	45.5	30	15.5	30	-14.5	16	Standard thermal glazing	32.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D29-31	1st	W	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D29-31	1st	S	56.9	30	26.9	30	-3.1	27	Standard thermal glazing	43.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D32-34	1st	S	57	30	27	30	-3	27	Standard thermal glazing	44	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D32-34	1st	E	49.8	30	19.8	30	-10.2	20	Standard thermal glazing	36.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D32-34	1st	N	45.4	30	15.4	30	-14.6	15	Standard thermal glazing	32.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D32-34	1st	W	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D35	1st	E	51	30	21	30	-9	21	Standard thermal glazing	38	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D35	1st	S	56.5	30	26.5	30	-3.5	27	Standard thermal glazing	43.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D35	1st	W	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D35	1st	N	45.4	30	15.4	30	-14.6	15	Standard thermal glazing	32.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D36	1st	E	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D36	1st	S	56.5	30	26.5	30	-3.5	27	Standard thermal glazing	43.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D36	1st	W	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D36	1st	N	45.5	30	15.5	30	-14.5	16	Standard thermal glazing	32.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D37	1st	E	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D37	1st	S	56.2	30	26.2	30	-3.8	26	Standard thermal glazing	43.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D37	1st	W	53.4	30	23.4	30	-6.6	23	Standard thermal glazing	40.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D37	1st	N	45.7	30	15.7	30	-14.3	16	Standard thermal glazing	32.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D38	1st	W	53.2	30	23.2	30	-6.8	23	Standard thermal glazing	40.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D38	1st	S	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D38	1st	E	49.5	30	19.5	30	-10.5	20	Standard thermal glazing	36.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D38	1st	N	46.2	30	16.2	30	-13.8	16	Standard thermal glazing	33.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D39	1st	E	50	30	20	30	-10	20	Standard thermal glazing	37	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D39	1st	S	55.6	30	25.6	30	-4.4	26	Standard thermal glazing	42.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D39	1st	W	54.8	30	24.8	30	-5.2	25	Standard thermal glazing	41.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D39	1st	N	46.3	30	16.3	30	-13.7	16	Standard thermal glazing	33.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D40	1st	E	48.1	30	18.1	30	-11.9	18	Standard thermal glazing	35.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D40	1st	N	46.7	30	16.7	30	-13.3	17	Standard thermal glazing	33.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D40	1st	W	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D40	1st	S	54.9	30	24.9	30	-5.1	25	Standard thermal glazing	41.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D41-42	1st	E	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D41-42	1st	N	47	30	17	30	-13	17	Standard thermal glazing	34	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D41-42	1st	W	49.3	30	19.3	30	-10.7	19	Standard thermal glazing	36.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D41-42	1st	S	54	30	24	30	-6	24	Standard thermal glazing	41	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D43	1st	E	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D43	1st	S	53.1	30	23.1	30	-6.9	23	Standard thermal glazing	40.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D43	1st	W	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D43	1st	N	47	30	17	30	-13	17	Standard thermal glazing	34	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D44	1st	E	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D44	1st	N	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D44	1st	W	49.4	30	19.4	30	-10.6	19	Standard thermal glazing	36.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D44	1st	S	53.2	30	23.2	30	-6.8	23	Standard thermal glazing	40.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D45-46	1st	S	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D45-46	1st	E	48.1	30	18.1	30	-11.9	18	Standard thermal glazing	35.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D45-46	1st	N	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D45-46	1st	W	49.3	30	19.3	30	-10.7	19	Standard thermal glazing	36.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D47	1st	S	53.3	30	23.3	30	-6.7	23	Standard thermal glazing	40.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D47	1st	E	48.7	30	18.7	30	-11.3	19	Standard thermal glazing	35.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D47	1st	N	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D47	1st	W	49.3	30	19.3	30	-10.7	19	Standard thermal glazing	36.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D48-49	1st	SW	48.9	30	18.9	30	-11.1	19	Standard thermal glazing	35.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D48-49	1st	NW	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D48-49	1st	NE	48.3	30	18.3	30	-11.7	18	Standard thermal glazing	35.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D48-49	1st	SE	52.9	30	22.9	30	-7.1	23	Standard thermal glazing	39.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D50-52	1st	NE	50	30	20	30	-10	20	Standard thermal glazing	37	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D50-52	1st	SE	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D50-52	1st	SW	49.4	30	19.4	30	-10.6	19	Standard thermal glazing	36.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D50-52	1st	NW	47.8	30	17.8	30	-12.2	18	Standard thermal glazing	34.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D53	1st	NE	50.4	30	20.4	30	-9.6	20	Standard thermal glazing	37.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D53	1st	SE	53.5	30	23.5	30	-6.5	24	Standard thermal glazing	40.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D53	1st	SW	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D53	1st	NW	47.5	30	17.5	30	-12.5	18	Standard thermal glazing	34.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D54	1st	SW	51.9	30	21.9	30	-8.1	22	Standard thermal glazing	38.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D54	1st	SE	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D54	1st	NE	50.1	30	20.1	30	-9.9	20	Standard thermal glazing	37.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D54	1st	NW	47.8	30	17.8	30	-12.2	18	Standard thermal glazing	34.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D55	1st	W	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D55	1st	S	54.5	30	24.5	30	-5.5	25	Standard thermal glazing	41.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D55	1st	E	50.7	30	20.7	30	-9.3	21	Standard thermal glazing	37.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D55	1st	N	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D56	1st	W	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D56	1st	S	54.5	30	24.5	30	-5.5	25	Standard thermal glazing	41.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D56	1st	E	49.2	30	19.2	30	-10.8	19	Standard thermal glazing	36.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D56	1st	N	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D57	1st	W	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D57	1st	S	54.7	30	24.7	30	-5.3	25	Standard thermal glazing	41.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D57	1st	E	49.4	30	19.4	30	-10.6	19	Standard thermal glazing	36.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D57	1st	N	47.1	30	17.1	30	-12.9	17	Standard thermal glazing	34.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D58	1st	E	50.7	30	20.7	30	-9.3	21	Standard thermal glazing	37.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D58	1st	S	54.7	30	24.7	30	-5.3	25	Standard thermal glazing	41.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D58	1st	W	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D58	1st	N	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D59	1st	W	52.5	30	22.5	30	-7.5	23	Standard thermal glazing	39.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D59	1st	S	54.9	30	24.9	30	-5.1	25	Standard thermal glazing	41.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D59	1st	E	50.6	30	20.6	30	-9.4	21	Standard thermal glazing	37.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D59	1st	N	47.1	30	17.1	30	-12.9	17	Standard thermal glazing	34.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D60	1st	W	54.9	30	24.9	30	-5.1	25	Standard thermal glazing	41.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D60	1st	S	53.9	30	23.9	30	-6.1	24	Standard thermal glazing	40.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D60	1st	E	51.8	30	21.8	30	-8.2	22	Standard thermal glazing	38.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D60	1st	N	47.1	30	17.1	30	-12.9	17	Standard thermal glazing	34.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D61	1st	E	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D61	1st	S	52.9	30	22.9	30	-7.1	23	Standard thermal glazing	39.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D61	1st	W	54.9	30	24.9	30	-5.1	25	Standard thermal glazing	41.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D61	1st	N	46.3	30	16.3	30	-13.7	16	Standard thermal glazing	33.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D62	1st	N	46.8	30	16.8	30	-13.2	17	Standard thermal glazing	33.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D62	1st	E	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D62	1st	S	54.1	30	24.1	30	-5.9	24	Standard thermal glazing	41.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D62	1st	W	54.9	30	24.9	30	-5.1	25	Standard thermal glazing	41.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D63	1st	W	54.5	30	24.5	30	-5.5	25	Standard thermal glazing	41.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D63	1st	N	46.9	30	16.9	30	-13.1	17	Standard thermal glazing	33.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D63	1st	E	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D63	1st	S	54.8	30	24.8	30	-5.2	25	Standard thermal glazing	41.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D64	1st	E	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D64	1st	N	46.9	30	16.9	30	-13.1	17	Standard thermal glazing	33.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D64	1st	W	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D64	1st	S	53.2	30	23.2	30	-6.8	23	Standard thermal glazing	40.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D65	1st	E	50.2	30	20.2	30	-9.8	20	Standard thermal glazing	37.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D65	1st	N	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D65	1st	W	49.9	30	19.9	30	-10.1	20	Standard thermal glazing	36.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D65	1st	S	53.2	30	23.2	30	-6.8	23	Standard thermal glazing	40.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D66	1st	S	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D66	1st	E	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D66	1st	N	47	30	17	30	-13	17	Standard thermal glazing	34	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D66	1st	W	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D67	1st	E	49	30	19	30	-11	19	Standard thermal glazing	36	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D67	1st	S	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D67	1st	W	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D67	1st	N	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D68	1st	E	49	30	19	30	-11	19	Standard thermal glazing	36	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D68	1st	S	52.8	30	22.8	30	-7.2	23	Standard thermal glazing	39.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D68	1st	W	50.3	30	20.3	30	-9.7	20	Standard thermal glazing	37.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D68	1st	N	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D69	1st	E	49.8	30	19.8	30	-10.2	20	Standard thermal glazing	36.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D69	1st	S	53.3	30	23.3	30	-6.7	23	Standard thermal glazing	40.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D69	1st	W	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D69	1st	N	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D70	1st	SE	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D70	1st	SW	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D70	1st	NW	47.7	30	17.7	30	-12.3	18	Standard thermal glazing	34.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D70	1st	NE	50.3	30	20.3	30	-9.7	20	Standard thermal glazing	37.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D71	1st	N	47.8	30	17.8	30	-12.2	18	Standard thermal glazing	34.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D71	1st	E	51	30	21	30	-9	21	Standard thermal glazing	38	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D71	1st	S	55.1	30	25.1	30	-4.9	25	Standard thermal glazing	42.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D71	1st	W	53.1	30	23.1	30	-6.9	23	Standard thermal glazing	40.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D72	1st	E	49.6	30	19.6	30	-10.4	20	Standard thermal glazing	36.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D72	1st	S	53.9	30	23.9	30	-6.1	24	Standard thermal glazing	40.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D72	1st	W	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D72	1st	N	47.4	30	17.4	30	-12.6	17	Standard thermal glazing	34.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D73	1st	E	49.9	30	19.9	30	-10.1	20	Standard thermal glazing	36.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D73	1st	S	54.3	30	24.3	30	-5.7	24	Standard thermal glazing	41.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D73	1st	W	52.9	30	22.9	30	-7.1	23	Standard thermal glazing	39.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D73	1st	N	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D74	1st	E	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D74	1st	S	54.9	30	24.9	30	-5.1	25	Standard thermal glazing	41.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D74	1st	W	51	30	21	30	-9	21	Standard thermal glazing	38	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D74	1st	N	47.5	30	17.5	30	-12.5	18	Standard thermal glazing	34.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D75	1st	E	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D75	1st	S	53.7	30	23.7	30	-6.3	24	Standard thermal glazing	40.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D75	1st	W	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D75	1st	N	47.4	30	17.4	30	-12.6	17	Standard thermal glazing	34.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D76	1st	N	47.4	30	17.4	30	-12.6	17	Standard thermal glazing	34.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D76	1st	W	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D76	1st	S	54.2	30	24.2	30	-5.8	24	Standard thermal glazing	41.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D76	1st	E	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D77	1st	E	50.6	30	20.6	30	-9.4	21	Standard thermal glazing	37.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D77	1st	S	54.9	30	24.9	30	-5.1	25	Standard thermal glazing	41.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D77	1st	W	53.2	30	23.2	30	-6.8	23	Standard thermal glazing	40.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D77	1st	N	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D78	1st	E	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D78	1st	N	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D78	1st	W	54	30	24	30	-6	24	Standard thermal glazing	41	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D78	1st	S	53.5	30	23.5	30	-6.5	24	Standard thermal glazing	40.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D79	1st	W	55.7	30	25.7	30	-4.3	26	Standard thermal glazing	42.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D79	1st	N	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D79	1st	E	53.6	30	23.6	30	-6.4	24	Standard thermal glazing	40.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D79	1st	S	53.8	30	23.8	30	-6.2	24	Standard thermal glazing	40.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D80	1st	E	54.4	30	24.4	30	-5.6	24	Standard thermal glazing	41.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D80	1st	S	57.8	30	27.8	30	-2.2	28	Standard thermal glazing	44.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D80	1st	W	55.6	30	25.6	30	-4.4	26	Standard thermal glazing	42.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D80	1st	N	47.2	30	17.2	30	-12.8	17	Standard thermal glazing	34.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D81	1st	E	53.2	30	23.2	30	-6.8	23	Standard thermal glazing	40.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D81	1st	S	58	30	28	30	-2	28	Standard thermal glazing	45	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D81	1st	W	56.2	30	26.2	30	-3.8	26	Standard thermal glazing	43.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D81	1st	N	47.5	30	17.5	30	-12.5	18	Standard thermal glazing	34.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D82	1st	W	55.6	30	25.6	30	-4.4	26	Standard thermal glazing	42.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D82	1st	N	47.6	30	17.6	30	-12.4	18	Standard thermal glazing	34.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D82	1st	E	52.7	30	22.7	30	-7.3	23	Standard thermal glazing	39.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D82	1st	S	57.9	30	27.9	30	-2.1	28	Standard thermal glazing	44.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D83	1st	W	55.5	30	25.5	30	-4.5	26	Standard thermal glazing	42.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D83	1st	N	47.5	30	17.5	30	-12.5	18	Standard thermal glazing	34.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D83	1st	E	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D83	1st	S	57.8	30	27.8	30	-2.2	28	Standard thermal glazing	44.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D84	1st	N	47.6	30	17.6	30	-12.4	18	Standard thermal glazing	34.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D84	1st	W	55.3	30	25.3	30	-4.7	25	Standard thermal glazing	42.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D84	1st	S	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D84	1st	E	51.4	30	21.4	30	-8.6	21	Standard thermal glazing	38.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D85	1st	W	56.1	30	26.1	30	-3.9	26	Standard thermal glazing	43.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D85	1st	S	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D85	1st	E	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D85	1st	N	47	30	17	30	-13	17	Standard thermal glazing	34	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D86	1st	N	47.3	30	17.3	30	-12.7	17	Standard thermal glazing	34.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D86	1st	W	57	30	27	30	-3	27	Standard thermal glazing	44	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D86	1st	S	56.7	30	26.7	30	-3.3	27	Standard thermal glazing	43.7	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D86	1st	E	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D87	1st	S	53.8	30	23.8	30	-6.2	24	Standard thermal glazing	40.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D87	1st	W	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D87	1st	N	47.7	30	17.7	30	-12.3	18	Standard thermal glazing	34.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D87	1st	E	48.2	30	18.2	30	-11.8	18	Standard thermal glazing	35.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D88-89	1st	E	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D88-89	1st	S	54	30	24	30	-6	24	Standard thermal glazing	41	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D88-89	1st	W	50	30	20	30	-10	20	Standard thermal glazing	37	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D88-89	1st	N	48	30	18	30	-12	18	Standard thermal glazing	35	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D90	1st	N	48.2	30	18.2	30	-11.8	18	Standard thermal glazing	35.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D90	1st	SW	50.7	30	20.7	30	-9.3	21	Standard thermal glazing	37.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D90	1st	SE	54.9	30	24.9	30	-5.1	25	Standard thermal glazing	41.9	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D90	1st	E	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D91-92	1st	SW	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D91-92	1st	SE	53.6	30	23.6	30	-6.4	24	Standard thermal glazing	40.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D91-92	1st	NE	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D91-92	1st	NW	47.8	30	17.8	30	-12.2	18	Standard thermal glazing	34.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D93	1st	NE	51	30	21	30	-9	21	Standard thermal glazing	38	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D93	1st	SE	53.8	30	23.8	30	-6.2	24	Standard thermal glazing	40.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D93	1st	SW	52.9	30	22.9	30	-7.1	23	Standard thermal glazing	39.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D93	1st	NW	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D94	1st	SW	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D94	1st	SE	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D94	1st	NE	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D94	1st	NW	47.5	30	17.5	30	-12.5	18	Standard thermal glazing	34.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D95	1st	NE	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D95	1st	SE	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D95	1st	SW	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D95	1st	NW	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D96-99	1st	E	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D96-99	1st	S	55.4	30	25.4	30	-4.6	25	Standard thermal glazing	42.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D96-99	1st	W	54.3	30	24.3	30	-5.7	24	Standard thermal glazing	41.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D96-99	1st	N	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D100-101	1st	E	50.6	30	20.6	30	-9.4	21	Standard thermal glazing	37.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D100-101	1st	S	56.1	30	26.1	30	-3.9	26	Standard thermal glazing	43.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D100-101	1st	W	54.6	30	24.6	30	-5.4	25	Standard thermal glazing	41.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D100-101	1st	N	48	30	18	30	-12	18	Standard thermal glazing	35	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D102	1st	W	57.5	30	27.5	30	-2.5	28	Standard thermal glazing	44.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D102	1st	N	48.2	30	18.2	30	-11.8	18	Standard thermal glazing	35.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D102	1st	E	51.9	30	21.9	30	-8.1	22	Standard thermal glazing	38.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D102	1st	S	56.3	30	26.3	30	-3.7	26	Standard thermal glazing	43.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D103-104	1st	S	53.3	30	23.3	30	-6.7	23	Standard thermal glazing	40.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D103-104	1st	W	57.8	30	27.8	30	-2.2	28	Standard thermal glazing	44.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D103-104	1st	N	48.1	30	18.1	30	-11.9	18	Standard thermal glazing	35.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D103-104	1st	E	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D105-106	1st	E	54.2	30	24.2	30	-5.8	24	Standard thermal glazing	41.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D105-106	1st	S	59.7	30	29.7	30	-0.3	30	Standard thermal glazing	46.7	Yes	Yes	ADF System 4	MVHR without T.V
Plot D105-106	1st	W	58.3	30	28.3	30	-1.7	28	Standard thermal glazing	45.3	Yes	Yes	ADF System 4	MVHR without T.V
Plot D105-106	1st	N	48.3	30	18.3	30	-11.7	18	Standard thermal glazing	35.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D107-109	1st	E	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D107-109	1st	N	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D107-109	1st	W	58	30	28	30	-2	28	Standard thermal glazing	45	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D107-109	1st	S	59.6	30	29.6	30	-0.4	30	Standard thermal glazing	46.6	Yes	Yes	ADF System 4	MVHR without T.V
Plot D110-112	1st	W	55.6	30	25.6	30	-4.4	26	Standard thermal glazing	42.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D110-112	1st	S	59.2	30	29.2	30	-0.8	29	Standard thermal glazing	46.2	Yes	Yes	ADF System 4	MVHR without T.V
Plot D110-112	1st	E	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D110-112	1st	N	48.9	30	18.9	30	-11.1	19	Standard thermal glazing	35.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D113-114	1st	W	57.1	30	27.1	30	-2.9	27	Standard thermal glazing	44.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D113-114	1st	S	59.3	30	29.3	30	-0.7	29	Standard thermal glazing	46.3	Yes	Yes	ADF System 4	MVHR without T.V
Plot D113-114	1st	E	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D113-114	1st	N	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D115	1st	SE	58.8	30	28.8	30	-1.2	29	Standard thermal glazing	45.8	Yes	Yes	ADF System 4	MVHR without T.V
Plot D115	1st	SW	55.3	30	25.3	30	-4.7	25	Standard thermal glazing	42.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D115	1st	NW	49	30	19	30	-11	19	Standard thermal glazing	36	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D115	1st	NE	54	30	24	30	-6	24	Standard thermal glazing	41	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D116-118	1st	SE	54.3	30	24.3	30	-5.7	24	Standard thermal glazing	41.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D116-118	1st	SW	53.4	30	23.4	30	-6.6	23	Standard thermal glazing	40.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D116-118	1st	NW	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D116-118	1st	NE	51.6	30	21.6	30	-8.4	22	Standard thermal glazing	38.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D119-120	1st	NE	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D119-120	1st	SE	51.9	30	21.9	30	-8.1	22	Standard thermal glazing	38.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D119-120	1st	SW	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D119-120	1st	NW	48	30	18	30	-12	18	Standard thermal glazing	35	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D121	1st	NE	51.1	30	21.1	30	-8.9	21	Standard thermal glazing	38.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D121	1st	SE	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D121	1st	SW	52	30	22	30	-8	22	Standard thermal glazing	39	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D121	1st	NW	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D122-123	1st	E	53.3	30	23.3	30	-6.7	23	Standard thermal glazing	40.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D122-123	1st	S	58.7	30	28.7	30	-1.3	29	Standard thermal glazing	45.7	Yes	Yes	ADF System 4	MVHR without T.V
Plot D122-123	1st	W	52.3	30	22.3	30	-7.7	22	Standard thermal glazing	39.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D122-123	1st	N	49.4	30	19.4	30	-10.6	19	Standard thermal glazing	36.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D124	1st	S	58.8	30	28.8	30	-1.2	29	Standard thermal glazing	45.8	Yes	Yes	ADF System 4	MVHR without T.V
Plot D124	1st	W	56.5	30	26.5	30	-3.5	27	Standard thermal glazing	43.5	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D124	1st	N	49.3	30	19.3	30	-10.7	19	Standard thermal glazing	36.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D124	1st	E	53.2	30	23.2	30	-6.8	23	Standard thermal glazing	40.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D125-126	1st	NE	52.4	30	22.4	30	-7.6	22	Standard thermal glazing	39.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D125-126	1st	SE	55.8	30	25.8	30	-4.2	26	Standard thermal glazing	42.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D125-126	1st	SW	54.3	30	24.3	30	-5.7	24	Standard thermal glazing	41.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D125-126	1st	NW	49.6	30	19.6	30	-10.4	20	Standard thermal glazing	36.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D127-128	1st	SW	53.1	30	23.1	30	-6.9	23	Standard thermal glazing	40.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D127-128	1st	SE	52.7	30	22.7	30	-7.3	23	Standard thermal glazing	39.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D127-128	1st	NE	51.7	30	21.7	30	-8.3	22	Standard thermal glazing	38.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D127-128	1st	NW	48.6	30	18.6	30	-11.4	19	Standard thermal glazing	35.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D129-130	1st	NE	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D129-130	1st	SE	51.9	30	21.9	30	-8.1	22	Standard thermal glazing	38.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D129-130	1st	SW	53.2	30	23.2	30	-6.8	23	Standard thermal glazing	40.2	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D129-130	1st	NW	51.2	30	21.2	30	-8.8	21	Standard thermal glazing	38.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D131-132	1st	NE	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D131-132	1st	SE	53.1	30	23.1	30	-6.9	23	Standard thermal glazing	40.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D131-132	1st	SW	53.6	30	23.6	30	-6.4	24	Standard thermal glazing	40.6	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D131-132	1st	NW	48.4	30	18.4	30	-11.6	18	Standard thermal glazing	35.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6

Date: 27th November 2024

Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

Plot D133	1st	SW	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D133	1st	SE	51.5	30	21.5	30	-8.5	22	Standard thermal glazing	38.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D133	1st	NE	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D133	1st	NW	48.9	30	18.9	30	-11.1	19	Standard thermal glazing	35.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D134-136	1st	SW	51.8	30	21.8	30	-8.2	22	Standard thermal glazing	38.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D134-136	1st	SE	52.2	30	22.2	30	-7.8	22	Standard thermal glazing	39.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D134-136	1st	NE	50.2	30	20.2	30	-9.8	20	Standard thermal glazing	37.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D134-136	1st	NW	47.6	30	17.6	30	-12.4	18	Standard thermal glazing	34.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D137	1st	NE	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D137	1st	SE	53.1	30	23.1	30	-6.9	23	Standard thermal glazing	40.1	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D137	1st	SW	52.9	30	22.9	30	-7.1	23	Standard thermal glazing	39.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D137	1st	NW	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D138-139	1st	NE	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D138-139	1st	NW	49	30	19	30	-11	19	Standard thermal glazing	36	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D138-139	1st	SW	53	30	23	30	-7	23	Standard thermal glazing	40	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D138-139	1st	SE	50.8	30	20.8	30	-9.2	21	Standard thermal glazing	37.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D140	1st	SW	52.1	30	22.1	30	-7.9	22	Standard thermal glazing	39.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D140	1st	SE	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D140	1st	NE	50.2	30	20.2	30	-9.8	20	Standard thermal glazing	37.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D140	1st	NW	48.8	30	18.8	30	-11.2	19	Standard thermal glazing	35.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D141	1st	NE	50.3	30	20.3	30	-9.7	20	Standard thermal glazing	37.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D141	1st	SE	50.9	30	20.9	30	-9.1	21	Standard thermal glazing	37.9	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D141	1st	SW	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D141	1st	NW	49.1	30	19.1	30	-10.9	19	Standard thermal glazing	36.1	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D142	1st	NE	49.8	30	19.8	30	-10.2	20	Standard thermal glazing	36.8	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D142	1st	SE	53.8	30	23.8	30	-6.2	24	Standard thermal glazing	40.8	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D142	1st	SW	52.7	30	22.7	30	-7.3	23	Standard thermal glazing	39.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D142	1st	NW	48.2	30	18.2	30	-11.8	18	Standard thermal glazing	35.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	1st	NE	50.4	30	20.4	30	-9.6	20	Standard thermal glazing	37.4	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	1st	SE	53.3	30	23.3	30	-6.7	23	Standard thermal glazing	40.3	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D143	1st	SW	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	1st	NW	48.7	30	18.7	30	-11.3	19	Standard thermal glazing	35.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D142	1st	SW	52.6	30	22.6	30	-7.4	23	Standard thermal glazing	39.6	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D142	1st	NW	48.2	30	18.2	30	-11.8	18	Standard thermal glazing	35.2	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	1st	NE	50.5	30	20.5	30	-9.5	21	Standard thermal glazing	37.5	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	1st	SE	53.4	30	23.4	30	-6.6	23	Standard thermal glazing	40.4	Yes	Yes	ADF System 3	MEV System & Acoustic-grade 'T.V.'
Plot D143	1st	SW	51.3	30	21.3	30	-8.7	21	Standard thermal glazing	38.3	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.
Plot D143	1st	NW	48.7	30	18.7	30	-11.3	19	Standard thermal glazing	35.7	Yes	Yes	ADF Systems 1 or 2	Acoustic-grade T.V.

Reference: 21.105.1.R6
Date: 27th November 2024
Project: Proposed Residential Development – Land South of Cowm Top Lane, Castleton

APPENDIX 11: EXAMPLE ALTERNATIVE VENTILATION SYSTEMS

System	Description	Example Product*
1 / 2	Window-frame mounted trickle ventilator.	Greenwoods DN Vent Can be used where a sound reduction performance of up to 36dB Rw +Ctr is required. Greenwoods Acoustic Trickle Ventilator EAQ42W. Can be used where a sound reduction performance of up to 42dB Rw +Ctr is required.
	Through-wall ventilator.	Greenwoods Wall Ventilator MA3051. Provides a sound reduction performance of 55dB D_{n,e,w} +C_{tr} in its open position. Highest performing acoustic wall ventilator in the UK - the MA3051 is ideal for new build applications where noise planning restrictions are in place. Providing up to 55dB reduction and suitable for wall thicknesses of 140mm and above
3	Continuous Mechanical Extract Ventilation (MEV) system. Centralised Mechanical Extract Ventilation (cMEV) is a whole-house extract system should be installed in conjunction with acoustic trickle ventilators which provide the air inlet.	Greenwoods CMEV.4e/CMEV.4eHT The low energy continuously running whole house extract system is ideal for apartments and houses. The HT model is available with additional SMART technology for humidity and timer sensor controls.
	Positive Input Ventilation (PIV) system. De-centralised PIV system is a room-by-room (bedroom / living room) wall mounted ventilation input fan. Can be installed in conjunction with acoustic trickle ventilators which provide air expulsion.	Blauberg Fresher 50 PIV Self-contained. low energy, acoustic positive input filtered supply air ventilation input fan. The unit provides a sound reduction performance of 41dB(A) with an internal (motor) noise level of 29dB(A) at 1m.
4	Mechanical Ventilation Heat Recovery (MVHR).	Zehnder ComfoAir Q350 ST Wall or floor mounted mechanical supply and extract ventilation with heat recovery (MVHR) with humidity sensor. Nuaire MRXBOXAB-ECO2B
*Example products detailed; other products are available.		

APPENDIX 12: EXAMPLE SAINT GOBAIN THERMAL GLAZING SOUND REDUCTION SPECIFICATIONS

Glazing Configuration					Sound Reduction Performance (dB)		
Glass Type	Thickness (mm)	Cavity (mm)	Glass Type	Thickness (mm)	Rw	Rw +C (rail traffic noise)	Rw +Ctr (road traffic noise)
PLANICLEAR	6	10	PLANICLEAR	4	33	32	30
PLANICLEAR	4	12	PLANICLEAR	8	36	34	31
PLANICLEAR	4	10	PLANICLEAR	10	36	35	32
PLANICLEAR	4	6	PLANICLEAR	10	36	35	33
PLANICLEAR	6	12	PLANICLEAR	10	37	36	34
PLANICLEAR	6	16	STADIP SILENCE	8.8	42	40	35
PLANICLEAR	6	15	STADIP SILENCE	12.4	42	40	36
PLANICLEAR	10	15	STADIP SILENCE	8.8	42	40	37
PLANICLEAR	10	12	STADIP SILENCE	8.8	42	41	38
PLANICLEAR	12	15	STADIP SILENCE	8.8	43	42	39
PLANICLEAR	10	16	STADIP SILENCE	12.8	44	43	40
STADIP	14.4	24	STADIP SILENCE	8.4	47	46	41
STADIP SILENCE	12.8	16	STADIP SILENCE	8.8	48	46	42