



Azymuth Acoustics UK

Professional Acoustic Services

Noise Impact Assessment

Ref: AA0545

Apartment Conversion

19-21 Bamford Road

Heywood

On behalf of

AJ Cocker Associates

c/o Armstrong Building &

Maintenance Ltd

Phoenix House, Green Lane

Heywood

Lancashire

OL10 2EP



Azymuth Acoustics UK

Viridor House

No.3 Bolholt Terrace

Bury/Gtr Manchester

BL8 1PP

Tel: +44 (0)161-762 1055

Fax: +44 (0)161-761 1094

Matthew@acousticsuk.com

www.acousticsuk.com

Document Status – Final

Ref: AA0545	Signature:	Name:	Date:
Produced by:		James Gibson BEng (Hons)	02/08/24
Checked by:		Dominic McCann, BEng (Hons), MIOA, Director	28/08/24
Approved by:		Matthew Gibson, BEng (Hons), CEng, CEnv, Director	28/08/24

Disclaimer

This report has been prepared by Azymuth Acoustics UK with all reasonable skill, care and diligence within the terms of the Contract with the client, incorporating our Standard Terms and Conditions of Business and taking into account the resources devoted to it by agreement with the Client.

We disclaim any responsibility to the client and others in respect of any matters outside the scope of the above.

This report is confidential to the client and we accept no responsibility of whatsoever nature to third parties to whom this report, or any part thereof, is made known. Any such party relies on the report at their own discretion and risk.



Contents

1.0	Introduction	4
2.0	Baseline Noise Survey	5
2.1	Measurement Procedures	5
2.2	Summary of Measurements	6
2.3	Description of Noise Climate	6
3.0	Assessment Criteria	7
3.1	ProPG: Planning and Noise - May 2017	7
3.2	National Planning Policy Framework (NPPF) 2023	7
3.3	British Standard 8233: 2014	8
3.4	World Health Organisation Environmental Noise Guidelines (ENG) 2018	8
3.5	British Standard 4142:2014+A1:2019	9
3.6	IOA Guide to Approved Document O 2022	9
3.7	Acoustics Ventilation and Overheating Residential Design Guide 2020	10
3.8	Recommended Noise Assessment Criteria	10
4.0	Assessment of Results	11
4.1	Assessment of Noise Risk	11
4.2	SoundPLAN Model	11
5.0	Recommendations for Noise Mitigation.....	14
5.1	Recommended Glazing Specification	15
5.2	Recommended Ventilation Specification	15
5.3	Mitigation Specifications.....	16
5.4	Other Elements of Building Envelope.....	16
6.0	Summary.....	17
	Appendix A – Glossary of Acoustic Terms.....	18
	Appendix B – Noise Survey Data	19

1.0 Introduction

Azymuth Acoustics UK (henceforth Azymuth) has been contracted by Armstrong Building & Maintenance Ltd to perform a Noise Impact Assessment (NIA) in relation to the conversion and extension of the upper floors above a retail unit into 2no. new apartments located at 19-21 Bamford Road, Heywood.

The site is located in Heywood town centre and as such shall be subject to noise from traffic along the A58.

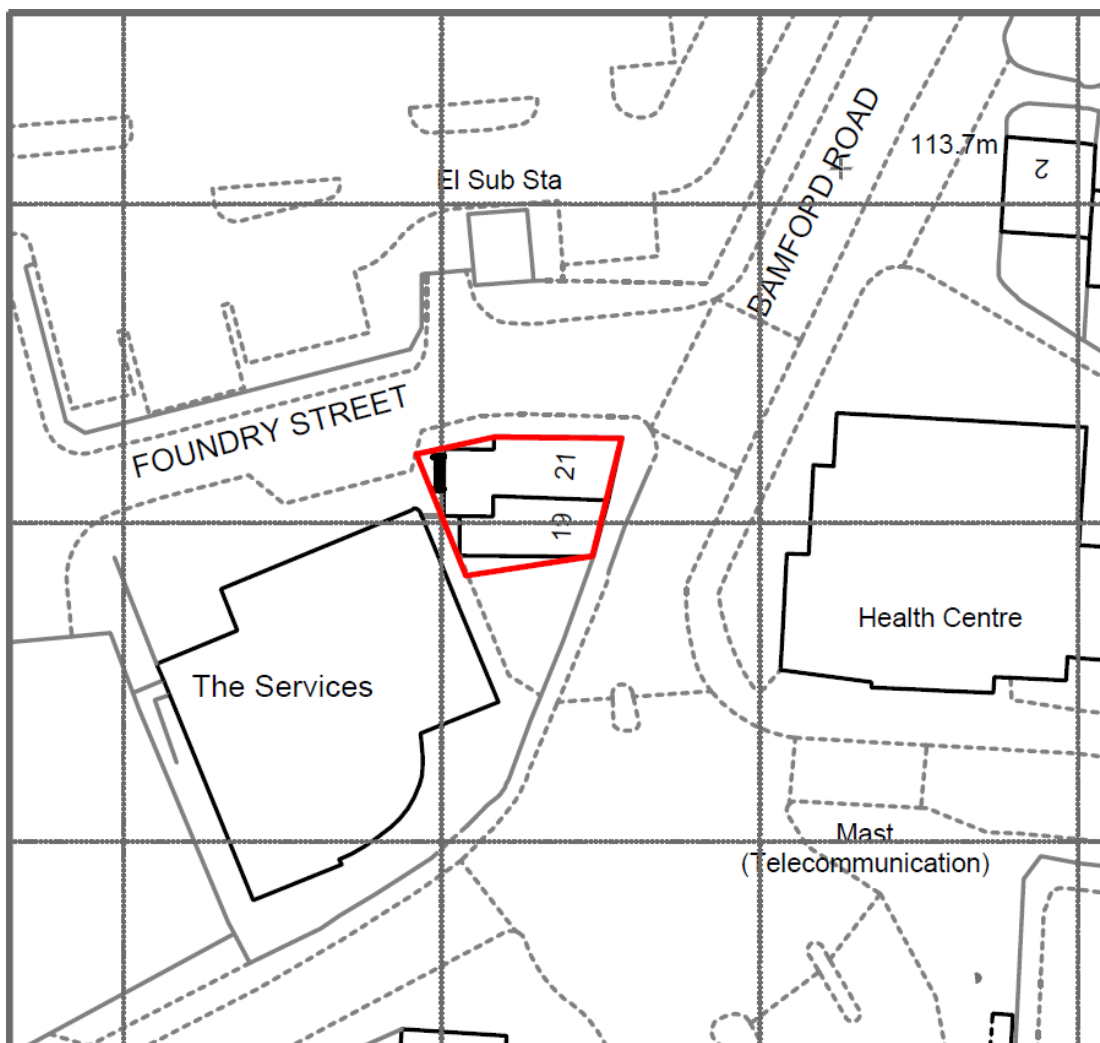


Figure 1 – Site Plan for 19-21 Bamford Road, Heywood

This noise impact assessment is intended to provide information relating to potential noise levels affecting the site in order to support the detailed planning application for the residential development. In particular, the report sets out the following details:

- The results of a baseline noise survey undertaken in the vicinity of 19-21 Bamford Road
- The appropriate assessment criteria and guidance relating to noise in the environment as associated with this kind of development
- Recommendations to meet the targets as set out by the assessment criteria

It is assumed that all drawings and information provided by the client is up to date and correct.

2.0 Baseline Noise Survey

2.1 Measurement Procedures

The instrumentation used for the NIA consisted of a SvanTek 977 and SvanTek 971 type 1 precision sound level meter. The equipment was calibrated before and after measurements. The sound level meter measured A-weighted (fast response) noise levels as well as octave bands noise levels for all measurement record.

Daytime noise level measurements were undertaken between 15:17hrs and 16:19hrs on Wednesday 31st July 2024. The night-time measurements were undertaken between 23:00hrs and 07:00hrs on Tuesday 30th July 2024 to Wednesday 31st July 2024.

The noise measurements were undertaken using the sound level meter at the position(s) shown in Figure 2 below:

- Position 1: Foundry Street Next beside the entrance to the apartments (1m from the road).
- Position 2a: Measurements outside the east façade of the building onto Bamford Road 0.5m from road.
- Position 2b: 24hr data recorded from the first storey window of the living room in plot 19 on the East façade of the Bamford Road site.

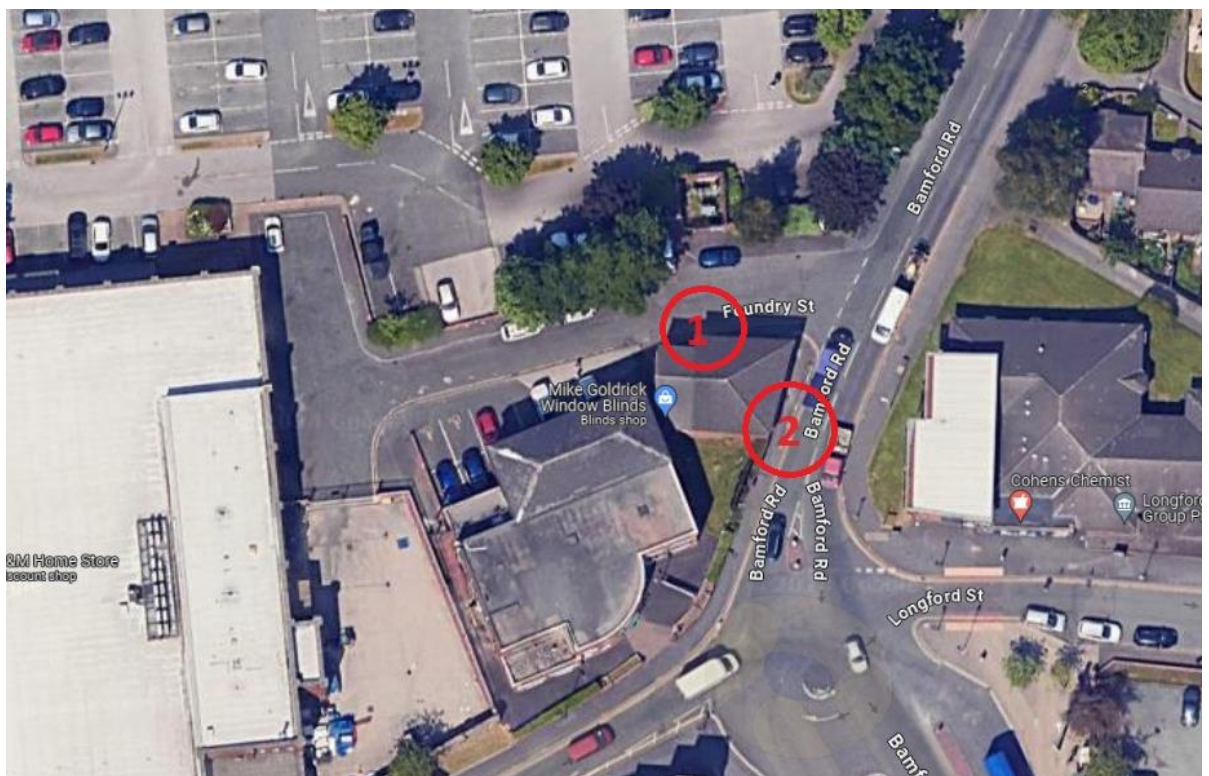


Figure 2 – Noise measurement positions for 19-21 Bamford Road.

2.2 Summary of Measurements

2.2.1 Noise Survey

The following table summarises the results of the noise measurements undertaken at the proposed site in terms of the average daytime and night-time noise levels.

Location	Period	L _{AFmax}	L _{Aeq}	L _{A10}	L _{A50}	L _{A90}
1) Foundry Street	Day	82.3	62.5	63.6	56.6	50.0
2a) Bamford Road	Day	89.7	73.4	75.0	66.5	60.5
2b) Bamford Road 24hr Data	Day	88.9	71.5	70.5	63.8	58.2
2b) Bamford Road 24hr Data	Night	82.2	61.8	59.4	46.6	40.4

Table 1 – Summary of noise measurements

Azymuth assumes that all noise levels measured on-site during the baseline noise survey are typical of the site.

Full results of the noise levels recorded during the course of the survey are included in Appendix B and Appendix B1 of this report.

2.2.2 Assessment of Night-time L_{Amax} Data

Azymuth has carried out an assessment of the available night-time L_{Amax} noise level data for the Bamford Road site (referenced to ~3m from the roadside). The measured L_{Amax} values varied between 75 dB and 98dB (around the 23:15 to 23:45hrs 1/2hr period). The duration of the overall night-time survey covered the entire 8 hours of one night. The highest single L_{Amax} event was most likely to be an emergency vehicle siren. However, based on a statistical analysis of the measured data it is estimated that the 10th highest L_{Amax} value over the entire 8hr night-time period is likely to be around 88dB or slightly lower.

2.3 Description of Noise Climate

Weather when visiting the site was dry and warm both days with wind speeds not exceeding 5mph. The noise climate at this site is dominated by road traffic noise. The site is close to Heywood town centre and the Times Retail Park and as such the traffic is dominated by cars accessing the retail park which includes the B&M and Morrisons stores.

3.0 Assessment Criteria

In order to assess the extent of any measures required in order to comply with suitable conditions relating to potential noise sources, Azymuth Acoustics UK has reviewed various guidance documents and standards, these include:

- ProPG: Professional Practice Guidance on Planning and Noise (New residential development)
- National Planning Policy Framework (NPPF 2023)
- British Standard 8233:2014
- World Health Organisation Guidelines on Community Noise
- British Standard 4142:2014+A1:2019
- IOA Guide to Noise Requirements of Approved Document O 2022
- Acoustics Ventilation and Overheating Residential Design Guide 2020

3.1 ProPG: Planning and Noise - May 2017

This Professional Practice Guidance on Planning and Noise (ProPG) has been produced to provide practitioners with guidance on a recommended approach to the management of noise within the planning system in England. The National Planning Policy Framework (NPPF) encourages improved standards of design. The CIEH, IOA and the ANC have worked together to produce this guidance which encourages better acoustic design for new residential development and aims to protect people from the harmful effects of noise.

The Professional Practice Guidance on Planning and Noise States 'The recommended approach is intended to give the developer, noise practitioner, and decision maker an early indication of the likely initial suitability of the site for new residential development from a noise perspective and the extent of acoustic issues that would be faced'. It is important that acoustic design is reviewed at an early stage of the development process.

3.2 National Planning Policy Framework (NPPF) 2023

The NPPF provides guidance to local authorities taking into account noise in making planning decisions. Paragraph 185 of the National Planning Policy Framework (NPPF) states that planning policies and decisions should aim to:

- Mitigate and reduce to a minimum to a minimum potential adverse impacts resulting from new development – and avoid noise giving rise to significant adverse impacts on health and quality of life,
- Identify and protect tranquil areas which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason;

The NPPF states that the planning system should distinguish between the hierarchy of international, national and locally designated sites; allocate land with the least environmental or amenity value, where consistent with other policies in this Framework. In addition, NPPF states that the planning system should 'prevent both new and existing development from contributing to or being put at unacceptable risk from, or being adversely affected by unacceptable levels of soil, air, water or noise pollution or land instability'.

3.3 British Standard 8233: 2014

BS 8233 provides a code of practice for the sound insulation of a variety of building types affected by general environmental noise. It provides recommendations for control of noise in and around buildings and suggests appropriate internal ambient noise level criteria / limits for a variety of different situations including residential properties.

The following table summarises the noise limits suggested by BS 8233 applying to residential properties:

Activity	Room	Good Design Range $L_{Aeq,T}$ dB	
		07:00-23:00hrs	23:00-07:00hrs
Resting	Living Room	35	-
Dining	Dining Room / Area	40	-
Sleeping (daytime resting)	Bedroom (at night)	35	30

Table 2 – Noise Limits for Residential Properties Suggested in BS 8233

BS 8233 also states that traditional external areas that are used for amenity space, such as gardens and patios, it is desirable that the external noise level does not exceed 50dB $L_{Aeq,T}$, with an upper guideline value of 55dB $L_{Aeq,T}$, which would be acceptable in noisier environments.

3.4 World Health Organisation Environmental Noise Guidelines (ENG) 2018

The main purpose of the 2018 WHO guidelines is to provide recommendations for protecting human health from exposure to environmental noise originating from the following sources: transportation (road traffic, railway and aircraft), wind turbines and leisure activities.

The guidelines set out to define recommended exposure levels for environmental noise in order to protect population health. Exposure limits are average levels defined over a period of one year, measured outdoors in free field at the most exposed façade. It should be noted that the document does not provide guideline limit values for multiple noise sources in combination.

The 2018 guidelines supersede the Community Noise Guidelines from 1999. Nevertheless, the document recommends that all CNG indoor guideline values and any values not covered by the current guidelines should remain valid. As such, the following guidance would remain appropriate:

For protection against sleep disturbance inside dwellings, night-time noise levels should not exceed 30dB L_{Aeq} for continuous noise and 45dB L_{Amax} for typical single sound events (which are exceeded 15 times or more per night – see ProPG Appendix A.12 for more details).

To protect the majority of people from being seriously annoyed during the daytime, the outdoor sound level from steady, continuous noise (interpreted as noise from all sources combined) should not exceed 55dB L_{Aeq} on balconies, terraces and in outdoor living areas.

It should be noted that exposure levels defined in ENG and CNG are for guidance purposes as relates potential adverse health impacts and should not be interpreted as absolute limits or regulations.

3.5 British Standard 4142:2014+A1:2019

“Methods for assessing and rating industrial sound” describes methods for rating and assessing sound of an industrial and/or commercial nature. The methods described in this British Standard use outdoor sound levels to assess the likely effects of sound on people who might be inside or outside a dwelling or premises used for residential purposes upon which sound is incident.

- Typically, the greater the difference between background sound and industrial/commercial noise, the greater the magnitude of the impact.
- The lower the rating level is relative to the measured background sound level, the less likely it is that the specific sound source will have an adverse impact or a significant adverse impact. Where the rating level does not exceed the background sound level, this is an indication of the specific sound source having a low impact, depending on the context.
- A difference of around +5dB is likely to be an indication of an adverse impact, depending on the context.
- A difference of around +10dB or more is likely to be an indication of a significant adverse impact, depending on the context.

BS 4142 notes that: “Adverse impacts include, but are not limited to, annoyance and sleep disturbance. Not all adverse impacts will lead to complaints and not every complaint is proof of an adverse impact.”

3.6 IOA Guide to Approved Document O 2022

Approved Document O ‘Overheating’ was released in December 2021 and came into effect in England on 15th June 2022. It introduces requirements for various types of residential premises to limit unwanted solar gains in summer and provide an adequate means to remove heat from the indoor environment (Requirement O1 (1)). Requirement O1(2)(a) of the regulation requires that account must be taken of the safety of an occupant, and their reasonable enjoyment of the residence. There is also a requirement (O2(b)) that mechanical cooling may only be used where sufficient heat cannot be removed from the indoor environment without it.

The guide aims to set out a method to demonstrate compliance to the Building Control Body of the noise constraints in Approved Document O. This guide provides clarity for practitioners and regulators so that assessments can be carried out consistently, and the outcome is repeatable and reliable.

Paragraph 3.3 of Approved Document O states that windows are likely to be closed during sleeping hours if noise within bedrooms exceeds the following limits:

- 40dB $L_{Aeq,T}$, averaged over 8 hours (between 11pm and 7am)
- 55dB L_{AFmax} , more than 10 times a night (between 11pm and 7am)

3.7 Acoustics Ventilation and Overheating Residential Design Guide 2020

The Acoustics, Ventilation and Overheating Guide (AVO) is intended to be used by acoustic practitioners as well as all those involved in the planning, development, design and commissioning of new dwellings.

It recommends an approach to acoustic assessments for new residential developments that take due regard of the interdependence of provisions for acoustics, ventilation and overheating. Application of the AVO Guide is intended to demonstrate good acoustic design as described in the ProPG, when considering internal noise level guidelines.

3.8 Recommended Noise Assessment Criteria

Based on the guidance above it is recommended that the following criteria would be reasonable with the aim of minimising the impact of the environmental noise on the proposed new residential accommodation:

- Daytime noise levels not to exceed 35dB $L_{Aeq, 16hr}$ in living rooms / bedrooms
- Daytime noise levels not to exceed 40dB $L_{Aeq, 16hr}$ in dining room / kitchen
- Night-time noise levels in bedrooms not to exceed 30dB $L_{Aeq, 8hr}$
- Night-time single sound events in bedrooms not to exceed 45dB L_{Amax} more than 15 times a night
- Noise levels in external amenity spaces to not exceed 50dB $L_{Aeq, T}$, with an upper guideline of 55dB $L_{Aeq, T}$ in noisier environments

Table 4, Note 5 of BS 8233:2014 states: 'If relying on closed windows to meet the guide values, there needs to be an appropriate alternative ventilation that does not compromise the façade insulation or the resulting noise level. If applicable, any room should have adequate ventilation (e.g. trickle ventilators should be open) during assessment.'



4.0 Assessment of Results

4.1 Assessment of Noise Risk

The following noise and overheating risk assessment highlights the level of risk of an adverse effect based on the guidance from the ProPG and AVO guidance documents.

Location	Time of Day	Free-field Noise Levels (dBA)	ProPG Risk of Adverse Effect	AVO Guide Risk (overheating) Category
Foundry Street Façade	Daytime $L_{Aeq, 16hr}$	63dB	Medium	Medium/high
	Night-time $L_{Aeq, 8hr}$	54dB (Calculated)	Medium	Medium
Bamford Road Façade (1 st floor)	Daytime $L_{Aeq, 16hr}$	71dB	High	High
	Night-time $L_{Aeq, 8hr}$	62dB	High	High

Table 3 – Noise risk assessment for 19-21 Bamford Road.

As shown above, the façades facing directly onto Bamford Road would represent the most significant risk in terms of potential adverse impact. In this case it is the East elevation and as such would indicate that there is an elevated risk of overheating requiring enhanced ventilation that would normally be offered by opening windows, however, the noise risk assessment indicates that relying on opening windows would result in significant noise intrusion, thus disrupting normal sleep.

The AVO guide gives the following example outcomes for noise that may be perceived as present and disruptive:

“Having to keep windows closed most of the time because of the noise. Potential for sleep disturbance resulting in difficulty in getting to sleep, premature awakening and difficulty in getting back to sleep. Quality of life diminished due to change in acoustic character of the area.”

It should be noted that ProPG does not account for daytime L_{Amax} instances that may arise from passing traffic. These instances may cause annoyance during the day to the potential residents. As such, extra mitigation has been recommended in order to minimise noise complaints to the premises.

4.2 SoundPLAN Model

Azymuth has undertaken acoustic modelling with the SoundPLAN noise modelling software to predict and visualise the impact of noise on the 19-21 Bamford Street site.

4.2.1 Grid Noise Map (GNM)

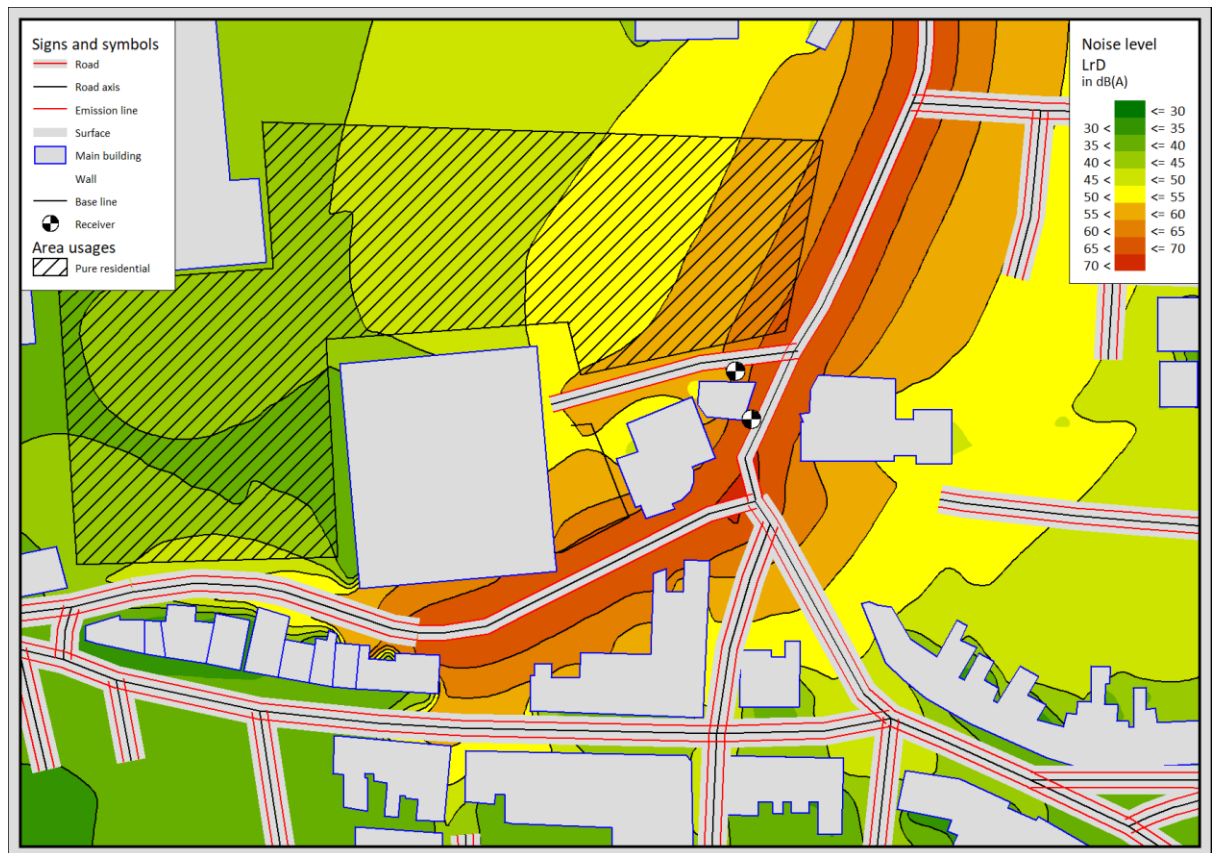


Figure 3 – GNM showing the propagation of road noise around the Bamford road site.

4.2.2 Façade Noise Map (FNM)

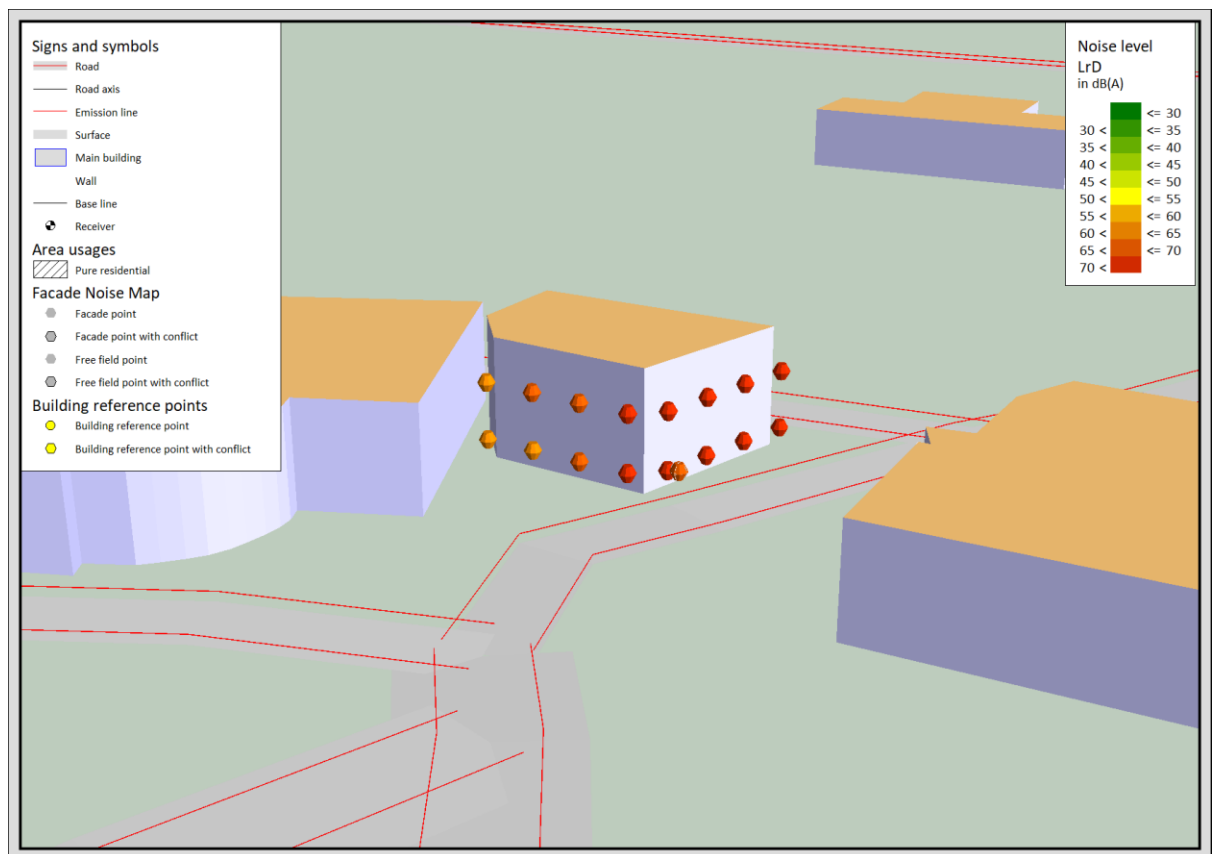


Figure 4 – FNM(1) showing the façade noise levels the Bamford road site.

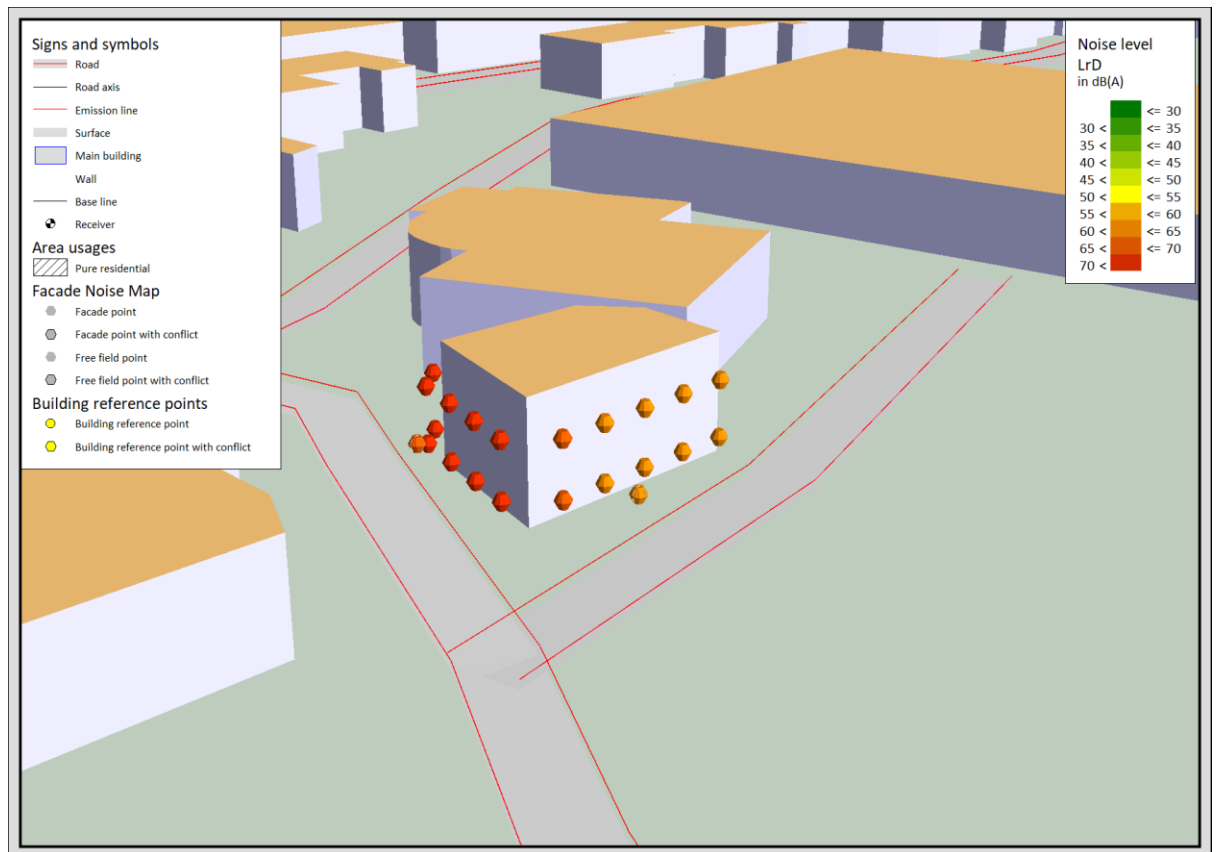


Figure 5 – FNM(2) showing the façade noise levels the Bamford road site.

5.0 Recommendations for Noise Mitigation

Based on survey data and the predicted noise levels derived from SoundPLAN, Azymuth have produced the following recommendations in order to mitigate the effects of noise within the proposed development. If these recommendations are followed, noise levels within the development will satisfy the criteria as set out in Section 5.

NB all recommended mitigation specifications are subject to good workmanship and for materials to be installed as the manufacturer intends. Any poor workmanship may lead to weaknesses in the sound attenuation provided by the building elements.



5.1 Recommended Glazing Specification

The table 4 below outlines the minimum glazing specifications Azymuth would recommend in order to achieve the specified internal ambient noise level targets.

Location (Habitable Spaces)	Glazing Specification	Appropriate Glazing Types
Bamford Street elevation – Apartment 1	Acoustically rated glazing and frame with min. 40dB R_w and 35dB R_w+C_{tr}	Acoustic glazing e.g 6/16 argon/8.8mm Optiphon double glazed units
All other locations	Any building regulations approved min. 35dB R_w and 29dB R_w+C_{tr}	Acoustic glazing e.g 8/16/6mm acoustic double glazed units

Table 4– Azymuth recommended glazing specification for 19-21 Bamford Road

5.2 Recommended Ventilation Specification


Table 5 outlines the minimum recommended ventilation that should be paired with the glazing specifications to ensure the appropriate sound insulation targets are met. With reference to the AVO and ProPG guidance, Azymuth recommends the following ventilation specification to ensure sufficient air flow to dwellings whilst also achieving internal noise level targets.

Location (Habitable Spaces)	Ventilation Specification	Appropriate Ventilation Types
Bamford Street elevation – Apartment 1	MEV + Acoustic Grade Air-brick Ventilation 44dB $D_{n,e,w}$	Greenwood AAB Acoustic Airbrick
All other locations	MEV + Acoustic Grade Trickle Ventilation 37dB $D_{n,e,w}$	Greenwood L Vent slot vent

Table 5 – Azymuth recommended ventilation specification for 19-21 Bamford Road

5.3 Mitigation Specifications

19-21 Bamford Road Heywood
SKETCH PROPOSAL

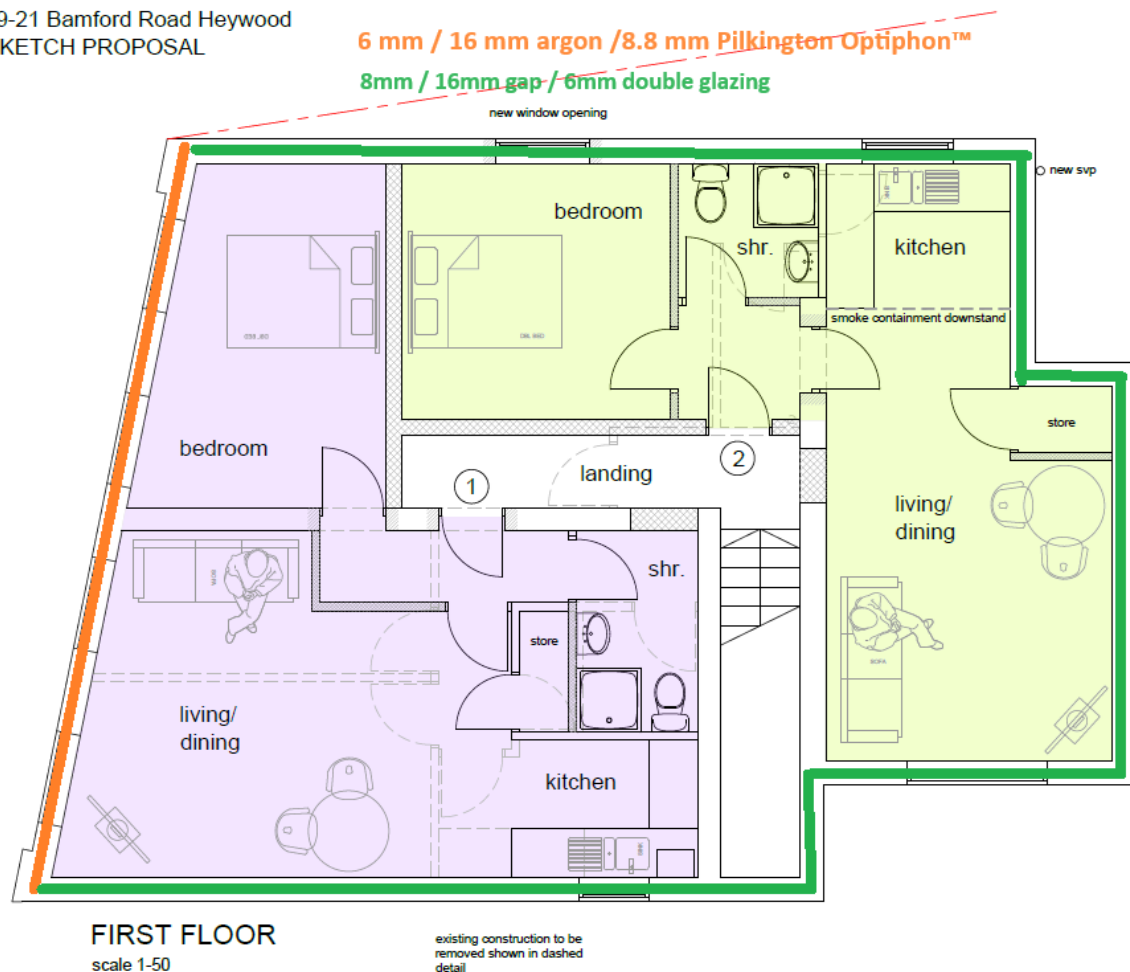

ACCOMMODATION SCHEDULE

FLAT1	45.5sq.m
FLAT2	39.5sq.m

aj cocker associates
t. 01708 784 880
w. ajcockerassociates.co.uk

Figure 6 – plan showing areas of noise mitigation to cross reference with Tables 4 and 5

5.4 Other Elements of Building Envelope

Other elements of the building envelope should have the following sound insulation performance:

- External Walls: minimum sound insulation 55dB R_w . This minimum is likely to be significantly exceeded by a normal brickwork façade. The Existing External wall is suitable and will provide enough acoustic insulation for the proposed site.
- Roof: minimum sound insulation 45dB R_w . This minimum would likely be exceeded with a traditional slate or tile roof with mineral wool loft insulation above plasterboard ceilings or by a suitably insulated concrete roof or composite flat roof. In this instance the pitched roof will be satisfactory subject to the inclusion of mineral wool insulation for thermal and acoustic insulation.

6.0 Summary

Azymuth has undertaken a Noise Impact Assessment (NIA) at a proposed new build development site located on 19-21 Bamford Road Heywood. The main sources of noise affecting the site originate from continuous road traffic along Bamford Road as well as the A58 that runs in close proximity to the site.

A baseline noise survey has been undertaken in the vicinity of the site. Daytime ambient noise levels were measured to be between 61-74dB $L_{Aeq,16hr}$, the night-time noise levels were measured to be between 59-61dB $L_{Aeq,8hr}$.

The development generally possesses a medium to high risk of adverse noise effect and overheating as per the ProPG and AVO guidance documents respectively.

Azymuth have produced a noise model in SoundPLAN 8.2 to better predict and visualise the effect of noise from both traffic and events on the development.

As such, Azymuth have provided the following recommendations to mitigate the effects of external noise in the internal areas of the development.

Glazing

- 6 mm / 16 mm argon / 8.8 mm Pilkington Optiphon™ (40dB R_w and 35dB R_w+C_{tr}) for the Bamford Road (East Elevation)
- 8 mm / (6 - 16 mm) / 6 mm (35dB R_w and 29dB R_w+C_{tr}) for all other locations.

Ventilation

- Greenwood AAB Acoustic Airbrick or Equivilant 44dB $D_{n,e,w}$ for the Bamford Road Elevation
- Greenwood L Vent slot vent 37dB $D_{n,e,w}$ for all other locations

Other Elements of Building Envelope

- External walls: min. 55dB R_w
- Roof: min. 45dB R_w

If the recommendations are to be adhered to then the internal noise levels shall satisfy the assessment criteria contained within Section 3

Appendix A – Glossary of Acoustic Terms

Decibel (dB)

This is the unit used to measure sound. The human ear has an approximately logarithmic response to acoustic pressure over a very large dynamic range (typically 20 micro Pascal to 100 Pascal).

dB (A)

This is a measure of the overall noise level of sound across the audible spectrum with a frequency weighting (i.e. A-weighting) to compensate for the sensitivity of the human ear to sound of different frequencies. The A-weighting curve is implemented in sound level meters using an electronic filter that approximately corresponds to the frequency response of the ear.

Octave Band Noise Level

The human ear is sensitive to sound over a range of frequencies between approximately 20Hz to 20kHz. The ear is also generally more sensitive to medium and high frequencies than to low frequencies. In order to define the frequency content of a noise, the spectrum can be divided into frequency bands. The most commonly used frequency bands are octave bands, in which the mid-frequency of each band is twice that of the band below it.

L_{Aeq}

This is the equivalent steady sound level in dB(A) containing the same acoustic energy as the actual fluctuating sound level over a given time period.

Reverberation Time (RT or sometimes T_{30} or T_{60})

This is the time taken for the reverberant sound energy in an enclosure to decay one millionth of its equilibrium value, i.e. by 60dB, after the source has been switched off. The reverberation time is frequency dependent and it is customary to measure its value in octave or one-third octave bands. Reverberation occurs when sound waves are repeatedly reflected from each surface of the room.

Sound Reduction Index (SRI)

Difference measured between the amount of energy flowing towards the wall in the source room and the total amount of energy entering the receiving room (usual range 100 - 3150Hz for one third octave band values). The SRI varies with frequency and is measured in a laboratory in either octave or one-third octave bands.

$SRI = L_1 - L_2 + 10 \log (S/A)$, where:

L_1 = Noise level in the source room

L_2 = Noise levels in the receiving room

S = Surface area of test specimen

A = Equivalent acoustic absorption area in the receiving room

Weighted Sound Reduction Index (R_w)

This is a weighted single figure descriptor of the sound insulation performance of a partition measured under laboratory conditions. The procedure used to quantify the R_w is to compare the sound reduction index (SRI) in each of the one-third octave bands from 100Hz to 3150Hz against a set of standard reference curves.



Appendix B – Noise Survey Data

Start	Position	Time	L _{Amax}	L _{Aeq}	L _{A10}	L _{A50}	L _{A90}
Position 1- 31/07/2024							
15:22:00	1	05:00	78	59.9	63.2	56	52.1
15:27:00	1	05:00	80.8	58.9	61.1	54.8	49.9
15:32:00	1	05:00	91.9	67.1	63.4	56.3	50.1
15:37:00	1	05:00	78.7	60.8	64.6	56.4	47.5
15:42:00	1	05:00	84.1	62.3	63.1	56.9	48.8
15:47:00	1	05:00	82.1	61.2	62.8	55.7	49.4
15:52:00	1	05:00	79.7	60.1	62.4	55.9	51.2
15:57:00	1	05:00	87.5	63.4	65.6	59.3	50.5
16:02:00	1	05:00	78.1	62.4	66.1	57.8	50.5
Position 2a- 31/07/2024							
16:09:00	2a	05:00	91.5	74.2	77	67.5	61.4
16:14:00	2a	05:00	88.2	72.7	75.6	65.6	59.3
16:19:00	2a	05:00	89.4	73.1	72.5	66.4	60.8
Position 2b- 30/07/2024 to 31/07/2024							
16:45:00	2b	30:00	89.3	69	72.2	66.2	61.5
17:15:00	2b	30:00	78.2	67.7	71.6	65.2	60.7
17:45:00	2b	30:00	87	69	72.3	66.3	61.7
18:15:00	2b	30:00	96.9	70.5	72.1	65.4	60.7
18:45:00	2b	30:00	96.4	69.5	72.1	65.6	60.3
19:15:00	2b	30:00	98.2	69.5	72.1	65.3	59.4
19:45:00	2b	30:00	85.5	67.7	71.3	64.3	57.8
20:15:00	2b	30:00	101.5	72.6	71.8	64	57.8
20:45:00	2b	30:00	113.8	81.3	70.7	62.6	54.7
21:15:00	2b	30:00	82.4	65.4	69.2	61.1	53.9
21:45:00	2b	30:00	82.6	65.2	69.1	60.3	51.2
22:15:00	2b	30:00	79.1	64	68	58.9	50.9
22:45:00	2b	30:00	81.2	62.7	66.3	56.1	46
23:15:00	2b	30:00	98	66.1	64.8	54.4	44.1
23:45:00	2b	30:00	85.5	62.3	63.5	53.2	41.9
00:15:00	2b	30:00	78.5	59.5	61.1	48.7	40.6
00:45:00	2b	30:00	78.7	58.5	60.7	47.4	40
01:15:00	2b	30:00	75.7	53.5	54.7	40.2	36
01:45:00	2b	30:00	78.4	56.6	58	41.8	38.2
02:15:00	2b	30:00	74.6	53.1	54.1	39.5	35.6
02:45:00	2b	30:00	75.2	50.9	53.8	40.2	37
03:15:00	2b	30:00	78.2	52.2	48.7	38.4	35.6
03:45:00	2b	30:00	97.4	66.6	52.5	39.8	37.2
04:15:00	2b	30:00	79.3	56.8	58.2	40.6	36
04:45:00	2b	30:00	77.9	56	57.1	40.9	38
05:15:00	2b	30:00	78.8	57	59.6	45.1	39.7
05:45:00	2b	30:00	83.2	62.2	65.4	54.9	45.9
06:15:00	2b	30:00	87.6	64.6	68.1	58	47.1
06:45:00	2b	30:00	87.9	67	70.2	62.1	54.1
07:15:00	2b	30:00	114	80.6	71.8	64.2	57.1
07:45:00	2b	30:00	83.8	68.5	72.4	65.5	59.6



Start	Position	Time	L _{Amax}	L _{Aeq}	L _{A10}	L _{A50}	L _{A90}
08:15:00	2b	30:00	92.6	69.2	72.7	65.9	60.5
08:45:00	2b	30:00	86.2	68.6	71.8	65.8	60.5
09:15:00	2b	30:00	82.7	67.9	71.7	65.1	60.1
09:45:00	2b	30:00	89.7	67.6	71.1	64.2	59.2
10:15:00	2b	30:00	106.8	73.8	70.8	64.8	59.5
10:45:00	2b	30:00	90.1	66.5	69.5	63.7	59.2
11:15:00	2b	30:00	85.6	66.8	70	63.8	59.1
11:45:00	2b	30:00	81.7	66.4	70	63.8	59.1
12:15:00	2b	30:00	90.2	66.7	69.9	63.5	58.4
12:45:00	2b	30:00	80.4	65.5	69.1	63.1	58.6
13:15:00	2b	30:00	83.8	66.1	69.4	63.6	59.4
13:45:00	2b	30:00	86.8	65.7	68.5	62.6	58.2
14:15:00	2b	30:00	87.8	66.2	69.3	63.1	58.7
14:45:00	2b	30:00	81.5	66.8	70.5	64.2	59.8
15:15:00	2b	30:00	84.1	66.9	70	64	59.9
15:45:00	2b	30:00	84	66.6	69.8	63.7	59.1
16:15:00	2b	30:00	81.7	66.8	70.4	64.4	59.7

Table B1 – Fully tabulated noise measurement results