


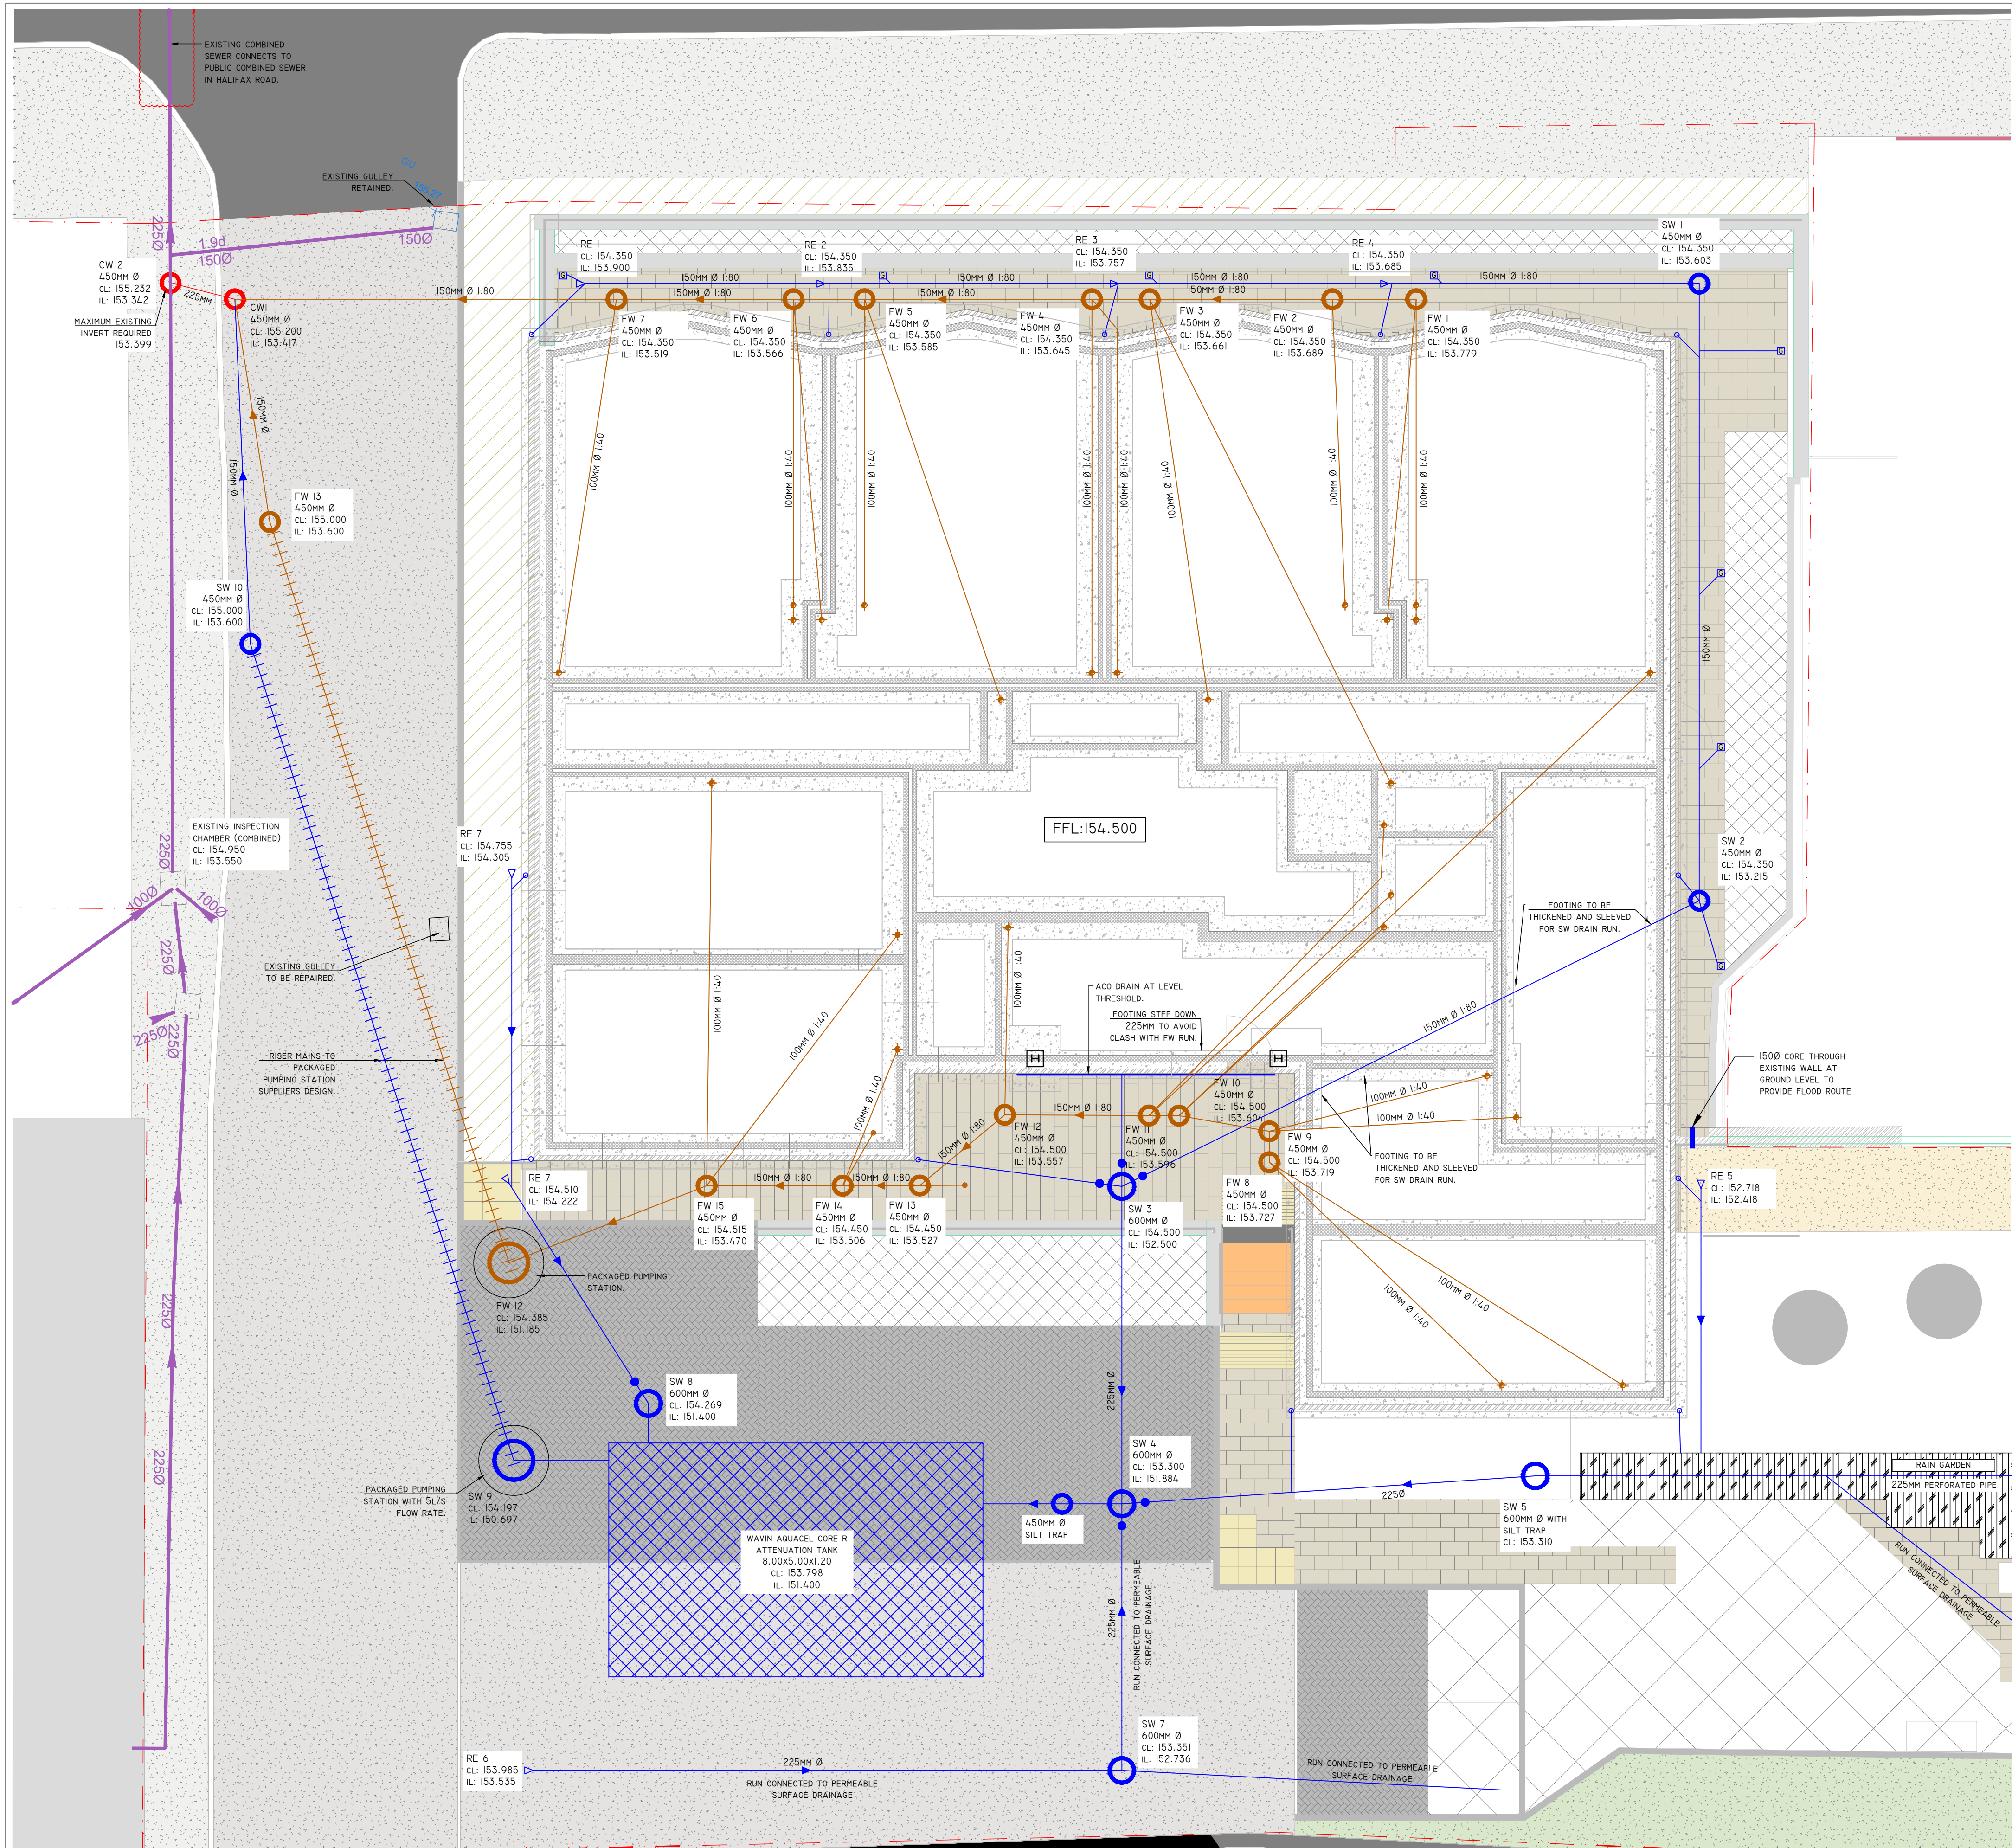

Drainage Layout
1:75 @ A1
1:150 @ A3

- REQUIREMENT FOR ACO SLOT DRAINS AT THRESHOLDS TBC BY ARCHITECT.
- ALL EXISTING & PROPOSED COVER LEVELS & INVERT LEVELS TO BE CONFIRMED PRIOR TO COMMENCING WORKS
- ALL POSITIONS OF PROPOSED DRAINAGE & MANHOLES/RODDING EYES TO BE CONFIRMED AS ACCEPTABLE BY LANDSCAPE ARCHITECT PRIOR TO COMMENCING WORKS
- ALL TEMPORARY WORKS FOR CONSTRUCTION OF DRAINAGE TO CONTRACTORS DESIGN AND DETAILS
- ALL EXTERNAL LEVELS TBC BY LANDSCAPE ARCHITECT
- CLIENT TO INVESTIGATE EXISTING DRAINS ON-SITE TO DETERMINE WHETHER ANY CLASHES OCCUR WITH THE PROPOSALS AND WHETHER ANY LEGAL EASEMENTS EXIST
- THIS SCHEME IS TO BE CONSIDERED PRELIMINARY UNTIL SUCH TIME AS THE LOCAL COUNCIL (LLFA), ENVIRONMENT AGENCY, PLANNING DEPARTMENT AND THIRD PARTY LAND OWNERS GIVE TECHNICAL APPROVAL, AND THE CLIENT OR CONTRACTOR UNDERTAKES INVESTIGATION WORKS (E.G. CONFIRMATION OF LAND OWNERSHIP, SURVEY OF SERVICES AND CONNECTION POINTS) TO CONFIRM THE PROPOSED ROUTES OFFSITE ARE VIABLE. ANY WORKS, OR ORDERING OF MATERIALS, PRIOR TO APPROVALS FROM THE ABOVE MENTIONED BODIES IS DONE SO AT THE CONTRACTORS RISK IN ITS ENTIRETY. BMC WILL ACCEPT NO RESPONSIBILITY FOR ANY ABORTIVE WORKS / MATERIAL COSTS.
- CLIENT TO PROVIDE LEVELS AND OBTAIN THIRD PARTY APPROVALS (INCLUDING APPROVALS FROM THIRD PARTY LAND OWNERS) IN ORDER TO PROVE ADEQUACY OF SCHEME - UNTIL SUCH MEASURES ARE IN PLACE THE SCHEME IS INDICATIVE ONLY
- SURFACE WATER NETWORK DESIGNED FOR NO FLOODING IN THE FOLLOWING CONDITIONS:
1:100 YEAR RETURN PERIOD STORMS + 45% CLIMATE CHANGE.
- ALL PPIC TO BE WAVIN 'RANGE' AND PROVIDED WITH RESTRICTED ACCESS CAPS WHERE OVER 1.2M DEEP

PUBLIC OR PRIVATE UTILITY NOTES

THE CONTRACTOR SHALL CONTACT ALL UTILITY COMPANIES TO VERIFY LOCATION AND EXTENT OF THEIR APPARATUS AND HAVE IT MARKED OUT ON SITE PRIOR TO COMMENCING ON SITE. DETAILS AND COSTS TO BE PROVIDED BY CONTRACTOR. TRIAL HOLES SHALL BE UNDERTAKEN BY HAND TO LOCATE ANY BURIED APPARATUS IF EXCAVATION WORKS OR LEVEL REDUCTIONS ARE TO BE UNDERTAKEN IN THE GENERAL AREA.

CONTRACTORS OWN RISK ASSESSMENTS AND SAFE METHODS OF WORKING ADJACENT TO UTILITIES SHALL BE EMPLOYED AT EVERY STAGE OF THE WORK. NO RESPONSIBILITY AS TO THE ACCURACY OF THIS PLAN IS GIVEN BY BELL MUNRO CONSULTING LIMITED AND NO LIABILITY WHAT SO EVER IS ACCEPTED BY THE COMPANY FOR THE USE OF THE INFORMATION ON THIS PLAN. IT IS INTENDED FOR GENERAL REFERENCE ONLY.

CONTRACTOR SHALL UPDATE THIS PLAN UP WITH SITE INFORMATION WHEN APPARATUS CAN BE ACCURATELY LOCATED ON SITE AND RETURNED TO BELL MUNRO CONSULTING LIMITED FOR THE DRAWING TO BE UPDATED AND RE-ISSUED.

ALLOW FOR USING TRENCH BOXES / SHORED TRENCHES TO CONSTRUCT DRAINAGE IN PROXIMITY TO EXISTING STRUCTURES / HIGHWAYS / BOUNDARIES.

Legend:

- Denotes proposed foul water drain.
- Denotes proposed surface water drain.
- Denotes proposed combined drain.
- Denotes foul water manhole.
- Denotes surface water manhole.
- Denotes combined manhole.
- Denotes gully.
- Denotes backdrop connection.

RAINWATER HARVESTING TO BE PROVIDED IN THE FORM OF WATER BUTTS

ALL NEW HARVESTING TO CAR PARK, ACCESS AND SHARED GARDEN TO BE FORMED IN PERMEABLE PAVING WITH LAND DRAINS CONNECTED TO SURFACE WATER RUNS AS SHOWN - SILT TRAPS AT THE END OF EACH LAND DRAIN RUN.

DRAINAGE HIERARCHY AS PER SUSTAINABLE DRAINAGE ASSESSMENT 80754.00.01R1

- USE INFILTRATION TECHNIQUES, SUCH AS POROUS SURFACES IN NON-CLAY AREAS - CLAY STRATA BELOW MADE GROUND SO UNFEASIBLE.
- ATTENUATE RAINWATER IN PONDS OR OPEN WATER FEATURES FOR GRADUAL RELEASE - NO OPEN WATER FEATURES POSSIBLE ON URBAN SITE.
- ATTENUATE RAINWATER BY STORING IN TANKS OR SEALED WATER FEATURES FOR GRADUAL RELEASE - WATER STORED IN ATTENUATION CRATES.
- DISCHARGE RAINWATER DIRECT TO A WATERCOURSE - NO WATERCOURSE WITHIN SITE BOUNDARY.
- DISCHARGE RAINWATER TO A SURFACE WATER SEWER / DRAIN. NO SURFACE WATER DRAIN WITHIN SITE BOUNDARY OR IN ADJACENT ROAD.
- DISCHARGE RAINWATER TO THE COMBINED SEWER - SURFACE WATER DISCHARGED TO COMBINED SEWER AT 5L/S AS PER PLANNING CONDITION.

- NOTES:
- THIS DRAWING IS COPYRIGHT AND THE PROPERTY OF BELL MUNRO CONSULTING LTD. THE DRAWING MUST NOT BE REPRODUCED IN PART OR IN WHOLE WITHOUT PRIOR WRITTEN AUTHORITY.
 - THIS DRAWING MUST NOT BE SCALED BY EITHER CONTRACTORS OR OTHER CONSULTANTS ANY DIMENSIONAL OR SETTING - OUT DISCREPANCIES ARE TO BE REPORTED TO BELL MUNRO CONSULTING PRIOR TO CONSTRUCTION / FABRICATION COMMENCING.
 - THIS DRAWING MUST BE READ IN CONJUNCTION WITH THE RELEVANT BMC SPECIFICATIONS TOGETHER WITH THE APPROPRIATE ARCHITECTS AND SERVICES CONSULTANTS DRAWINGS AND SPECIFICATIONS.
 - ALL EXISTING DRAINAGE TO BE CONFIRMED PRIOR TO CONSTRUCTION COMMENCING.
 - ALL NEW PIPEWORK TO BE WAVIN OSMADRAIN OR WAVIN ULTRARIB UPVC UNLESS NOTED OTHERWISE.
 - ALL PIPEWORK AT COVER LEVELS LESS THAN 900MM IN TRAFFICKED AREAS AND 400MM IN OTHER AREAS SHALL BE ENCASED IN CONCRETE (CLASS 2 BEDDING).
 - ALL OTHER PIPEWORK TO BE IN CLASS 5 BEDDING.
 - PIPEWORK PASSING THROUGH BUILDING WALLS SHALL BE FITTED WITH ROCKER PIPES AS PER STANDARD DETAIL.
 - ALL EXTERNAL MANHOLE COVERS TO BE TO EN124/1994 - TRAFFICKED AREAS GRADE D400 AND OTHER AREAS GRADE A14.
 - ALL INTERNAL MANHOLES TO BE SAINT-GOBAIN BRADSTEL TRIPLE SEALED RECESSED COVERS.
 - ANY UNLABELLED FOUL BRANCH PIPEWORK TO BE 1000 PIPEWORK AT MINIMUM 1:4.0 FALL. ALL MAIN FOUL WATER PIPEWORK TO BE 1500 AT 1:8.0 FALL.
 - ANY UNLABELLED STORM WATER BRANCH PIPEWORK TO BE 1000 AT MINIMUM 1:4.0 FALL.
 - ALL RWP AND THRESHOLD DRAIN LOCATIONS AND NUMBERS ARE TO BE CONFIRMED BY ARCHITECT PRIOR TO COMMENCING CONSTRUCTION.
 - EXACT SVP AND GULLY LOCATIONS TO BE CONFIRMED FROM SERVICES ENGINEERS' DRAWINGS AND DETAILS.
- GEOSMART SUSTAINABLE DRAINAGE ASSESSMENT 80754.01R1 (DESKTOP STUDY) PROPOSES SOAKAWAY INFILTRATION SUBJECT TO INFILTRATION TESTING & PERMEABLE PAVING.
- GE02 PHASE 1/11 CONTAMINATED LAND SITE ASSESSMENT 23/1382.1.1 FOUND GROUND CONDITIONS TO BE MADE DRAIN OVERLYING CLAY STRATA AND THEREFORE UNSUITABLE FOR INFILTRATION BUT EQUIVALENT SUDS FEATURES WILL BE PROVIDED.
- SURFACE WATER DISCHARGE RATE LIMITED TO 5L/S IN ACCORDANCE WITH ROCHDALE COUNCIL PLANNING CONDITION.

- GEOSMART FLOODRISK ASSESSMENT 80754.00.01R1 PROPOSES FOLLOWING MEASURES IN MITIGATION OF GROUND WATER FLOOD RISK:
- MINIMUM FINISHED FLOOR LEVEL 0.3M ABOVE ADJACENT GROUND LEVELS - NOT POSSIBLE OVER FULL FOOTPRINT DUE TO SITE SLOPE.
 - WATERPROOF TANKING OF THE GROUND FLOOR/BASEMENT - GROUND FLOOR TO BE TANKED BY SPECIALIST.
 - INTERCEPTOR DRAINS - INTERCEPTOR DRAINS NOT PRACTICABLE.
 - AUTOMATIC SUMP TO EXTRACT FLOOD WATER - SUMP NOT REQUIRED AS GROUND WATER IS NOT CONTAINED IN SUB-FLOOR VOID - REAR WALLS AND LOWER INTERNAL GROUND LEVEL WILL ALLOW GROUND WATER MOVEMENT OUT OF BUILDING.
 - NON-RETURN FLAP VALVES ON THE PROPOSED FOUL AND SURFACE WATER SEWER LINES - NON-RETURN FLAPS TO BE INCLUDED.

PRELIMINARY

REV	DATE	BY	DESCRIPTION
C	03/07/25	WR	UPDATED TO COMMENTS - RAIN GARDEN ADDED
B	09/06/25	WR	PIPPS MOVED TO SUIT CONTRACTORS COMMENTS
A	24/03/25	WR	REVISED TO SUIT ARCHITECTS LAYOUT CHANGES
---	20/01/25	WR	INITIAL ISSUE

BMC

BELL MUNRO CONSULTING LTD

CONSULTING CIVIL & STRUCTURAL ENGINEERS
TURNING HOUSE
5 ARCHWAY
MANCHESTER
M15 5RL
TEL: 0161 2098032 FAX: 0161 2098033
EMAIL: CONSULTING@BELLMUNRO.CO.UK WWW.BELLMUNRO.CO.UK

CLIENT: POSSIBILITIES

PROJECT: WUERDLE STREET, ROCHDALE

TITLE: DRAINAGE GENERAL ARRANGEMENT

DATE	SCALE	CHECKED BY	DRAWN BY
01/25	1:75	SJB	WR

REVISION: C

DRAWING NUMBER: J8426/D01