


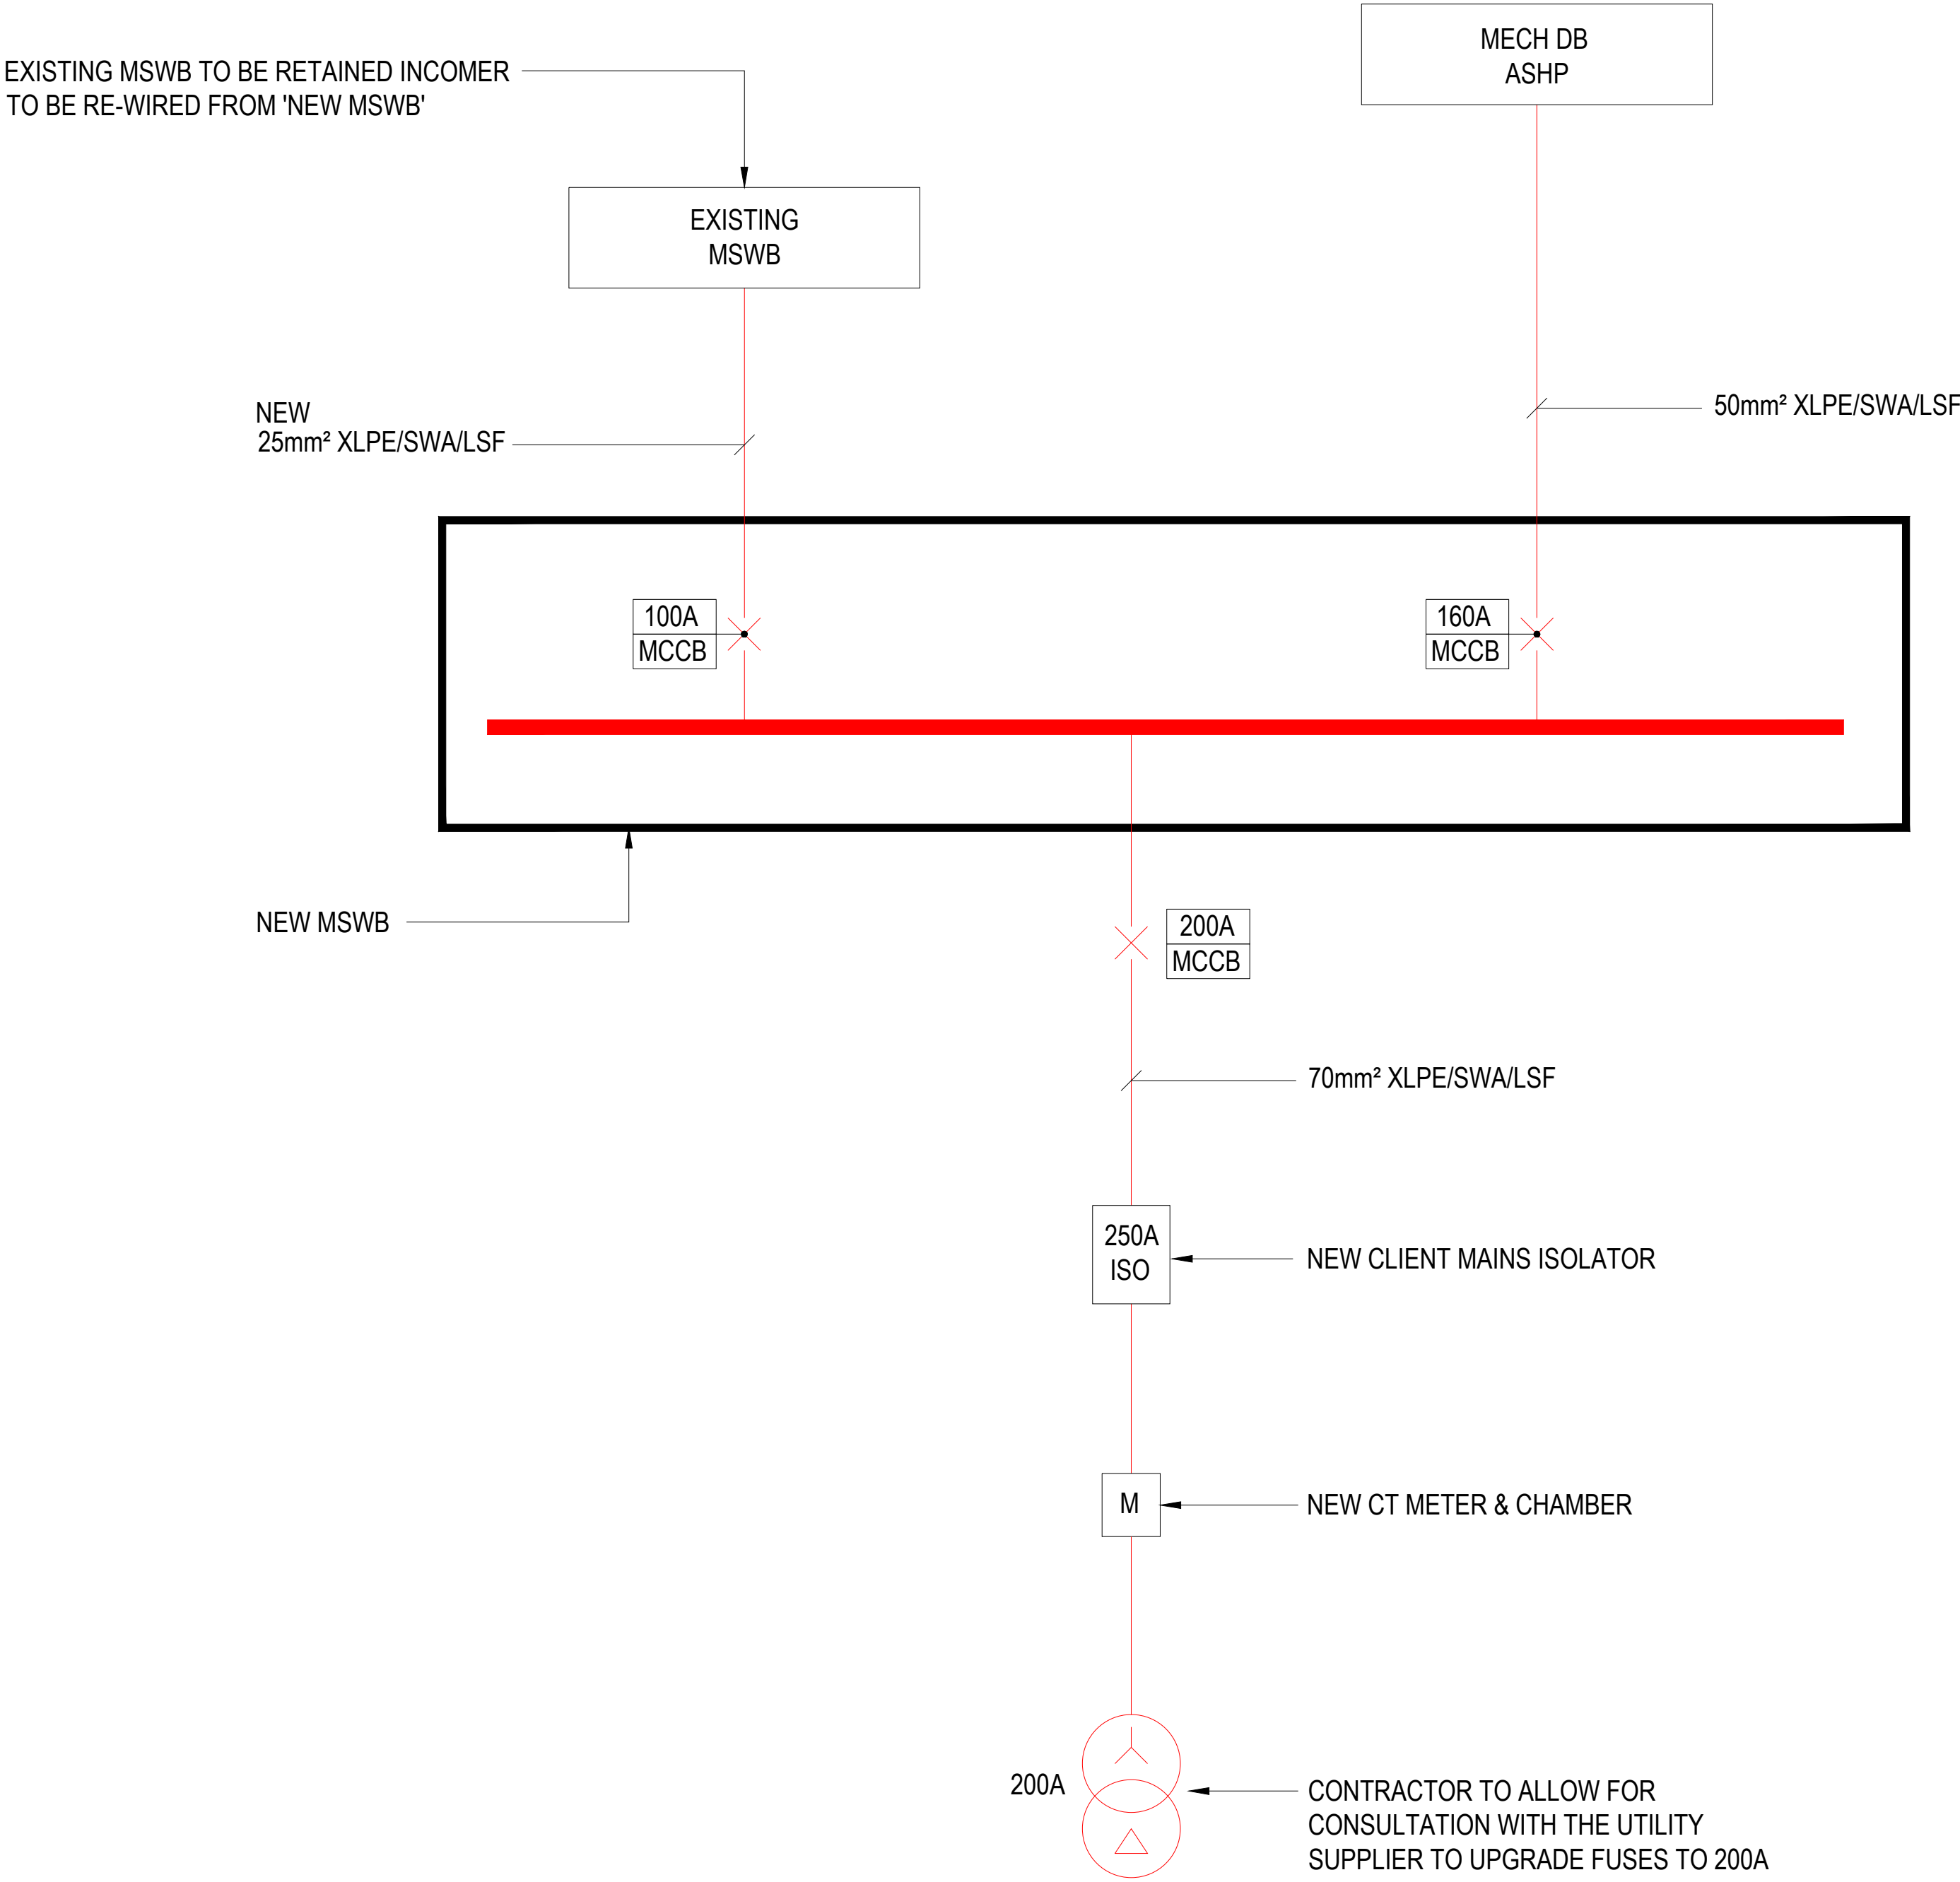

DO NOT SCALE. All dimensional details are to be checked against actual site dimensions before any of the work is executed. This drawing is copyright.

NOTES

- NOTES (ELECTRICAL)
- THE CONTRACTOR SHALL DISCUSS WITH THE DNO AND FULLY CO-ORDINATE & APPLY FOR THE FOLLOWING.
 - G99 PROCESS & EQUIPMENT
 - DNO UPGRADE OF SUPPLIES & FUSES
 - DNO UPGRADE OF CT METERS
 - ALL ELECTRICAL WORK TO BE FULLY CO-ORDINATED, INCLUDING NEW INCOMING CABLES, CT METERING POSITIONS AND ALLOW FOR RELOCATION OF DISTRIBUTION EQUIPMENT TO SUIT.
 - THE EXISTING MSWB INCOMER SHALL BE REPLACED, ALL NEW CABLING INSTALLED ON CABLE TRAY.
 - ALL WORKS IN ACCORDANCE WITH BS7671 WIRING REGULATIONS.

C1	CONSTRUCTION ISSUE	10/02/2026
Rev.	Description.	Date.

STATUS DISCRPTION
CONSTRUCTION

PURPOSE OF ISSUE
FOR INSTALLATION



Suites 3 & 4
Fortwilliam House
Edgewater Road
Belfast
BT3 9JQ
Tel: 0333 202 7725
Web: www.parr-fm.com

PROJECT
**GMFRS CARBON 4
ROCHDALE COMMUNITY
FIRE STATION**

TITLE
**PROPOSED ELECTRICAL
SCHEMATIC**



DRAWN BY	CHECKED BY	DATE
SS	BL	10/02/2026
SCALE	PROJECT No.	REV.
NTS@A1		C1

DRAWING NUMBER
GMFRS-ROC-PARR-XX-00-DR-ME-7001