


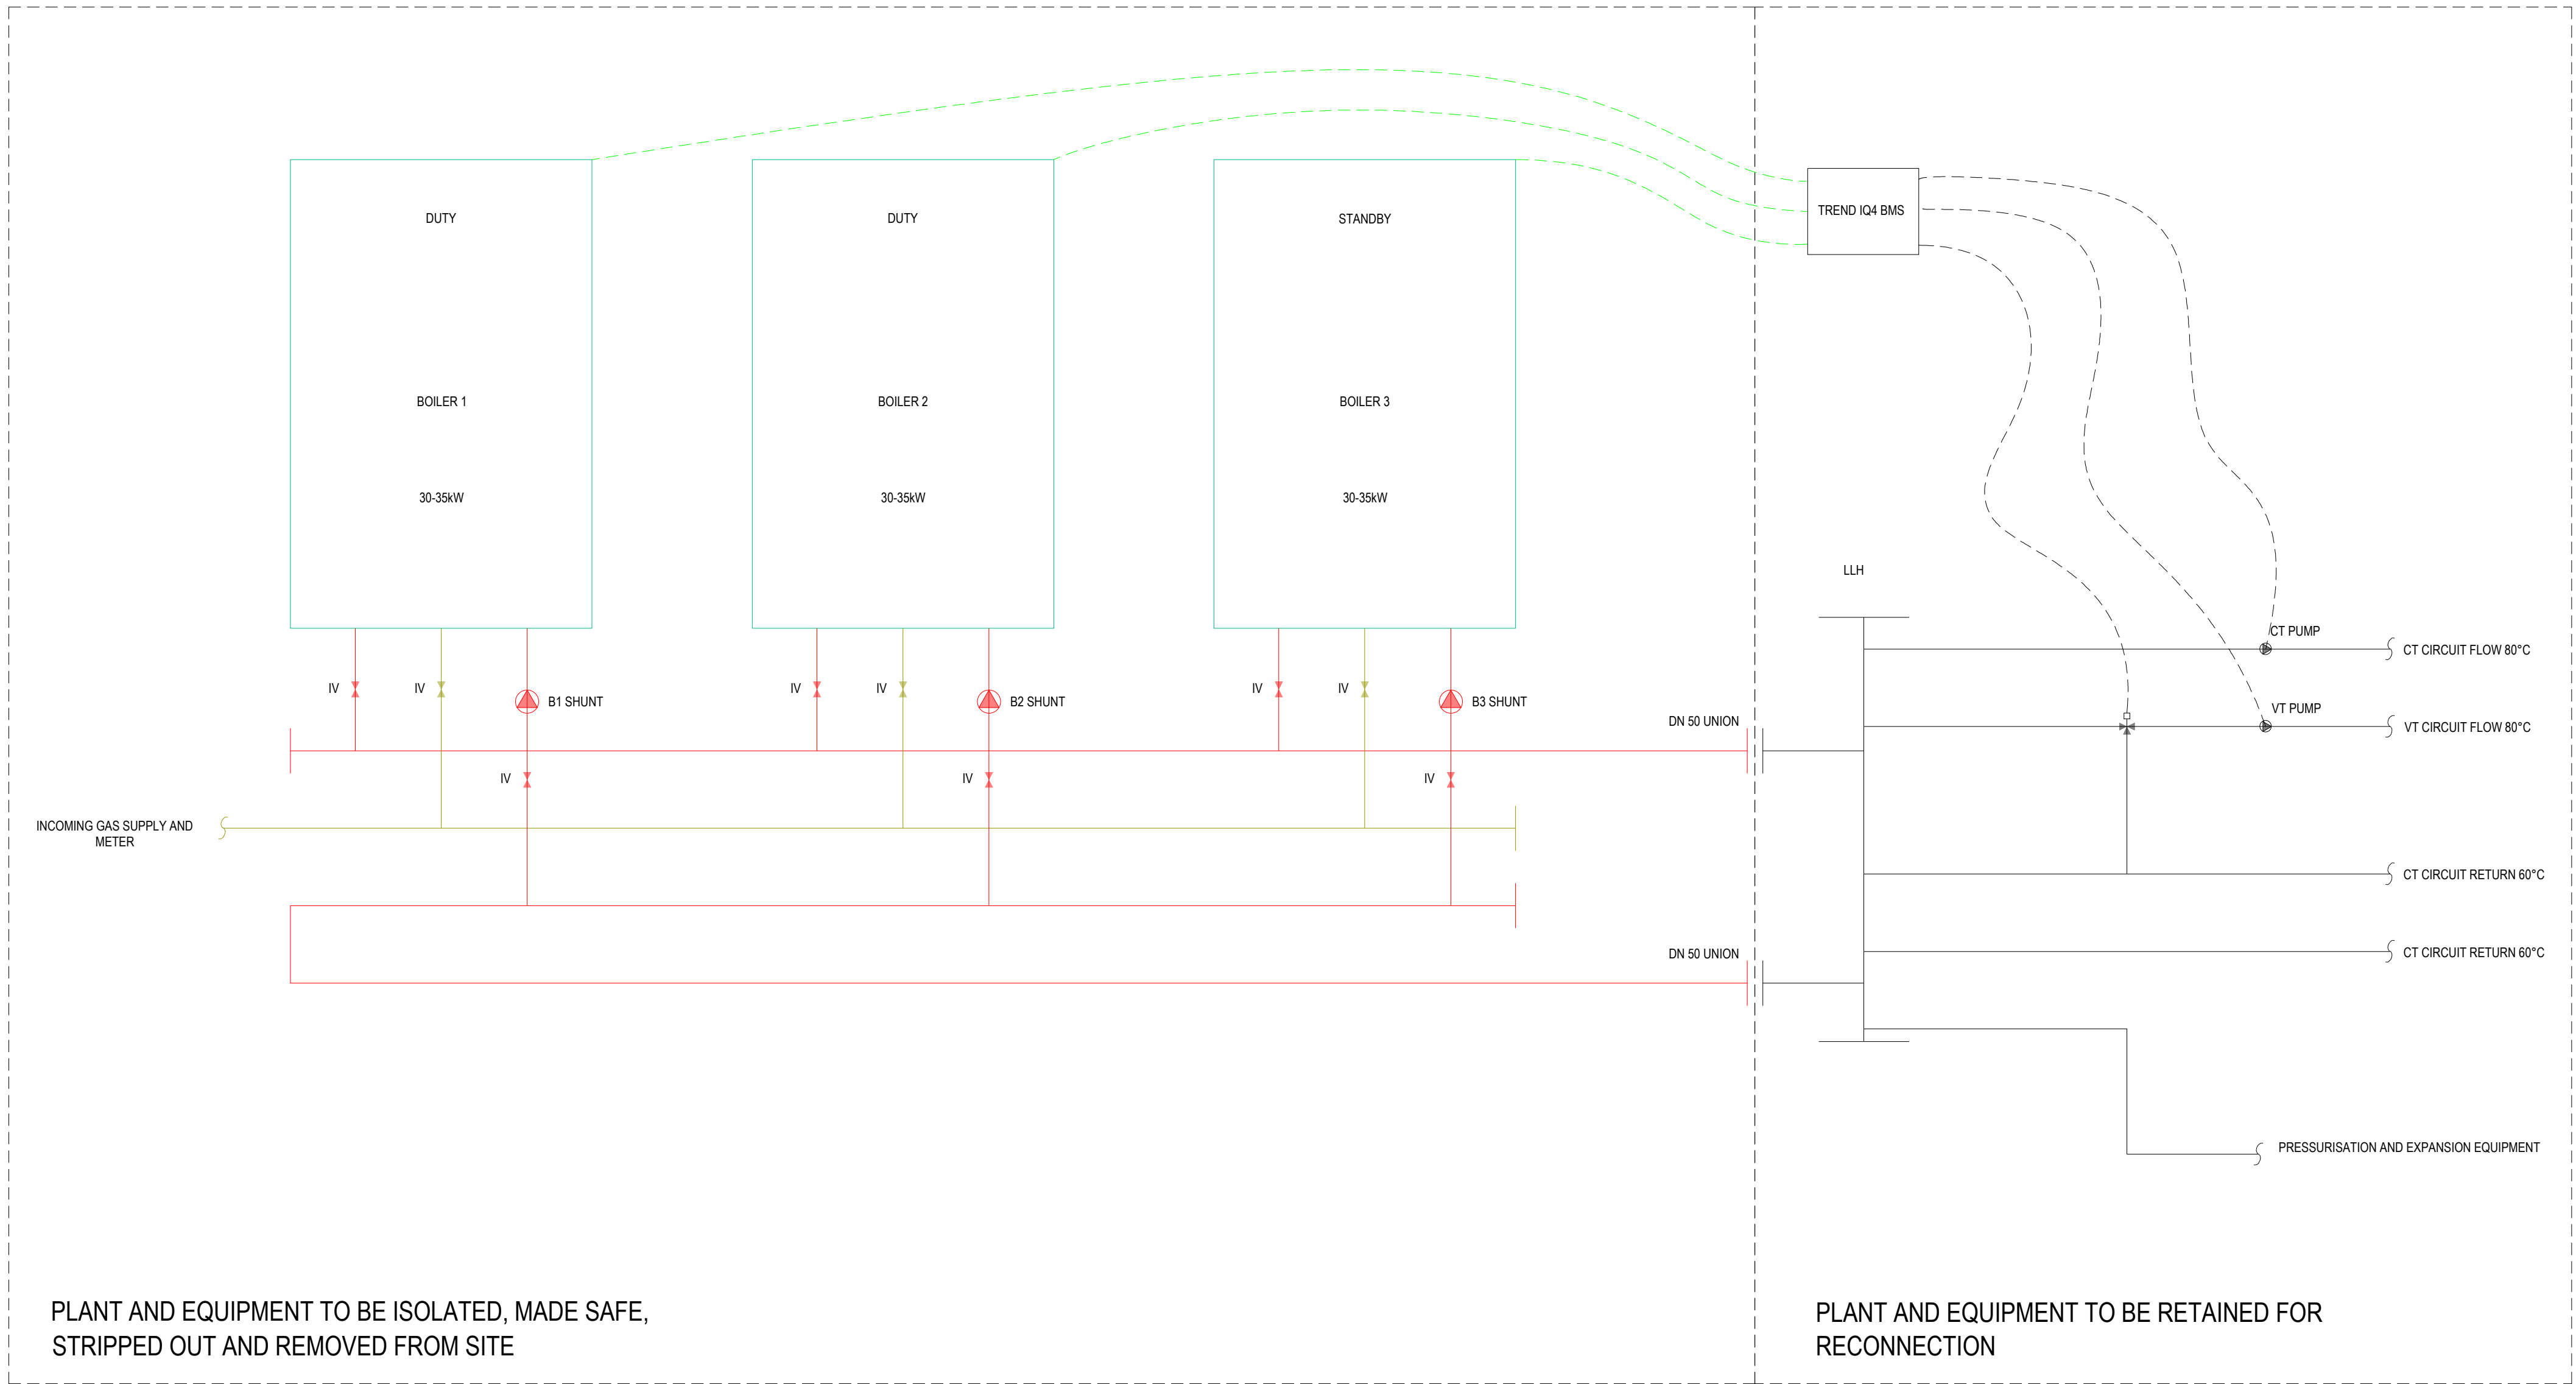

| LEGEND |                                     |
|--------|-------------------------------------|
| -----  | PIPEWORK IN CEILING VOID            |
| -----  | PIPEWORK AT HIGH LEVEL              |
| -----  | PIPEWORK AT LOW LEVEL               |
| -----  | PIPEWORK BELOW FINISHED FLOOR LEVEL |
| CV     | = CEILING VOID                      |
| FA     | = FROM ABOVE                        |
| TA     | = TO ABOVE                          |
| FB     | = FROM BELOW                        |
| TB     | = TO BELOW                          |
| HL     | = HIGH LEVEL                        |
| LL     | = LOW LEVEL                         |
| IV     | = ISOLATING VALVE                   |
| SV     | = STOP VALVE                        |
| BV     | = 1/2 TURN BALL VALVE               |
| LSV    | = LOCKSHIELD VALVE                  |
| NRV    | = NON RETURN VALVE                  |
| DCVA   | = DOUBLE CHECK VALVE                |
| DOC    | = DRAIN-OFF COCK                    |

DO NOT SCALE. All dimensional details are to be checked against actual site dimensions before any of the work is executed. This drawing is copyright.

- NOTES
- NOTES (MECHANICAL)
1. STRIP OUT OF DENOTED EQUIPMENT, PLANT & DISTRIBUTION TO INCLUDE ALL MISC ASSOCIATED SERVICES, INCLUDING BUT NOT LIMITED TO BRACKETS / CLIPS, HANGERS, SECONDARY / SUPPORT STEELWORK, SCREWED RODS FIXINGS, SCREWS / NUTS / BOLTS / WASHERS, THERMAL OR ACOUSTIC INSULATION.
  2. ANY EQUIPMENT, PLANT & DISTRIBUTION WHICH IS TO REMAIN IN SITU TO BE ADEQUATELY RE-SUPPORTED IF ALL OR PART OF SYSTEM HAS BEEN SUPPORTED FROM SERVICES WHICH ARE TO BE REMOVED.
  3. ANY SUPPORT SYSTEM WHICH HAS BEEN MADE UNSAFE THROUGH THE DENOTED STRIP OUT SHALL BE MODIFIED AS NECESSARY TO ENSURE THEY ARE SAFE.
  4. ALL HOLING THROUGH FIRE BARRIER & BUILDING FABRIC DUE TO REMOVAL OF SYSTEM TO BE REPAIRED BY APPROVED SPECIALISTS.
  5. ENSURE ALL DEAD ENDS AS PART OF WORKS ARE STRIPPED OUT AS FAR BACK AS PRACTICALLY POSSIBLE & SUITABLY CAPPED.

| C1   | CONSTRUCTION ISSUE | 10/02/2026 |
|------|--------------------|------------|
| Rev. | Description.       | Date.      |

STATUS DISCRPTION

CONSTRUCTION

PURPOSE OF ISSUE

FOR INSTALLATION

**parr**  
facilities management

Suites 3 & 4  
Fortwilliam House  
Edgewater Road  
Belfast  
BT3 9JQ  
Tel: 0333 202 7725  
Web: www.parr-fm.com

PROJECT

GMFRS CARBON 4  
ROCHDALE COMMUNITY  
FIRE STATION

TITLE

LTHW SYSTEM -  
PROPOSED STRIP OUT  
SCHEMATIC

CLIENT

**GREATER MANCHESTER**  
FIRE AND RESCUE SERVICE

|          |             |            |
|----------|-------------|------------|
| DRAWN BY | CHECKED BY  | DATE       |
| SS       | BL          | 10/02/2026 |
| SCALE    | PROJECT No. | REV.       |
| NTS@A1   |             | C1         |

DRAWING NUMBER

GMFRS-ROC-PARR-XX-00-DR-ME-5001