



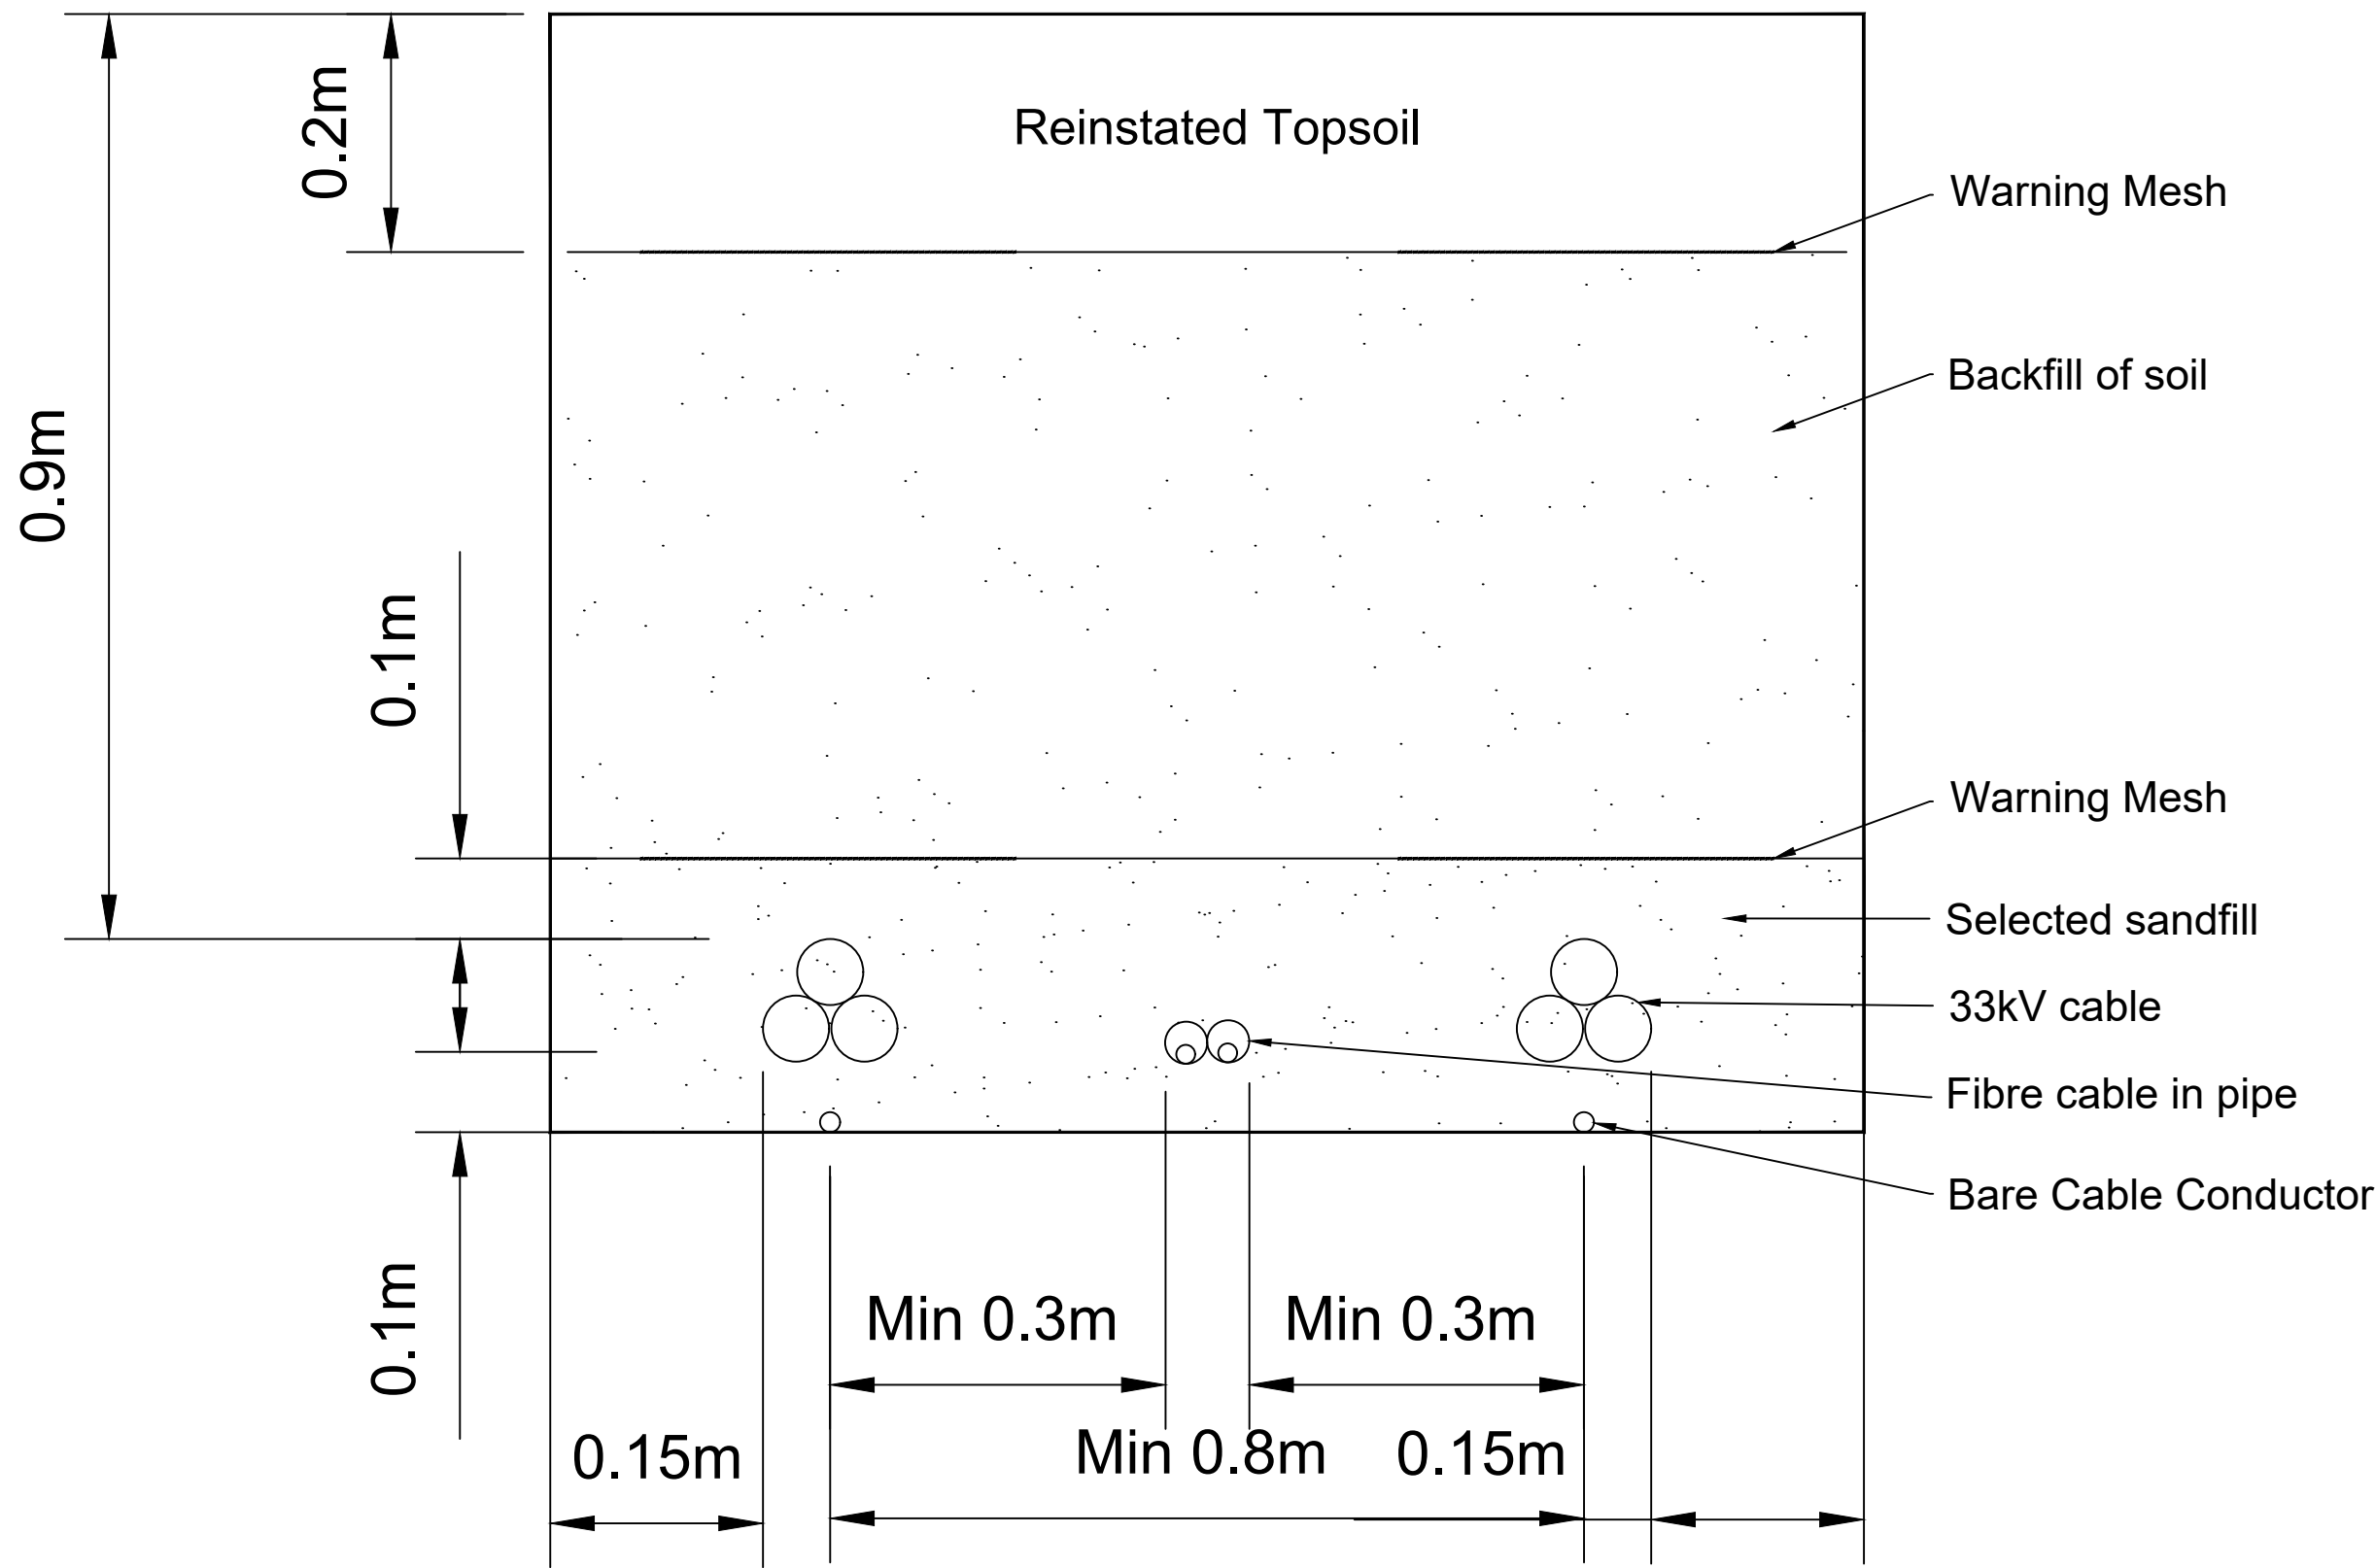

Typical 33kV Cable Trench

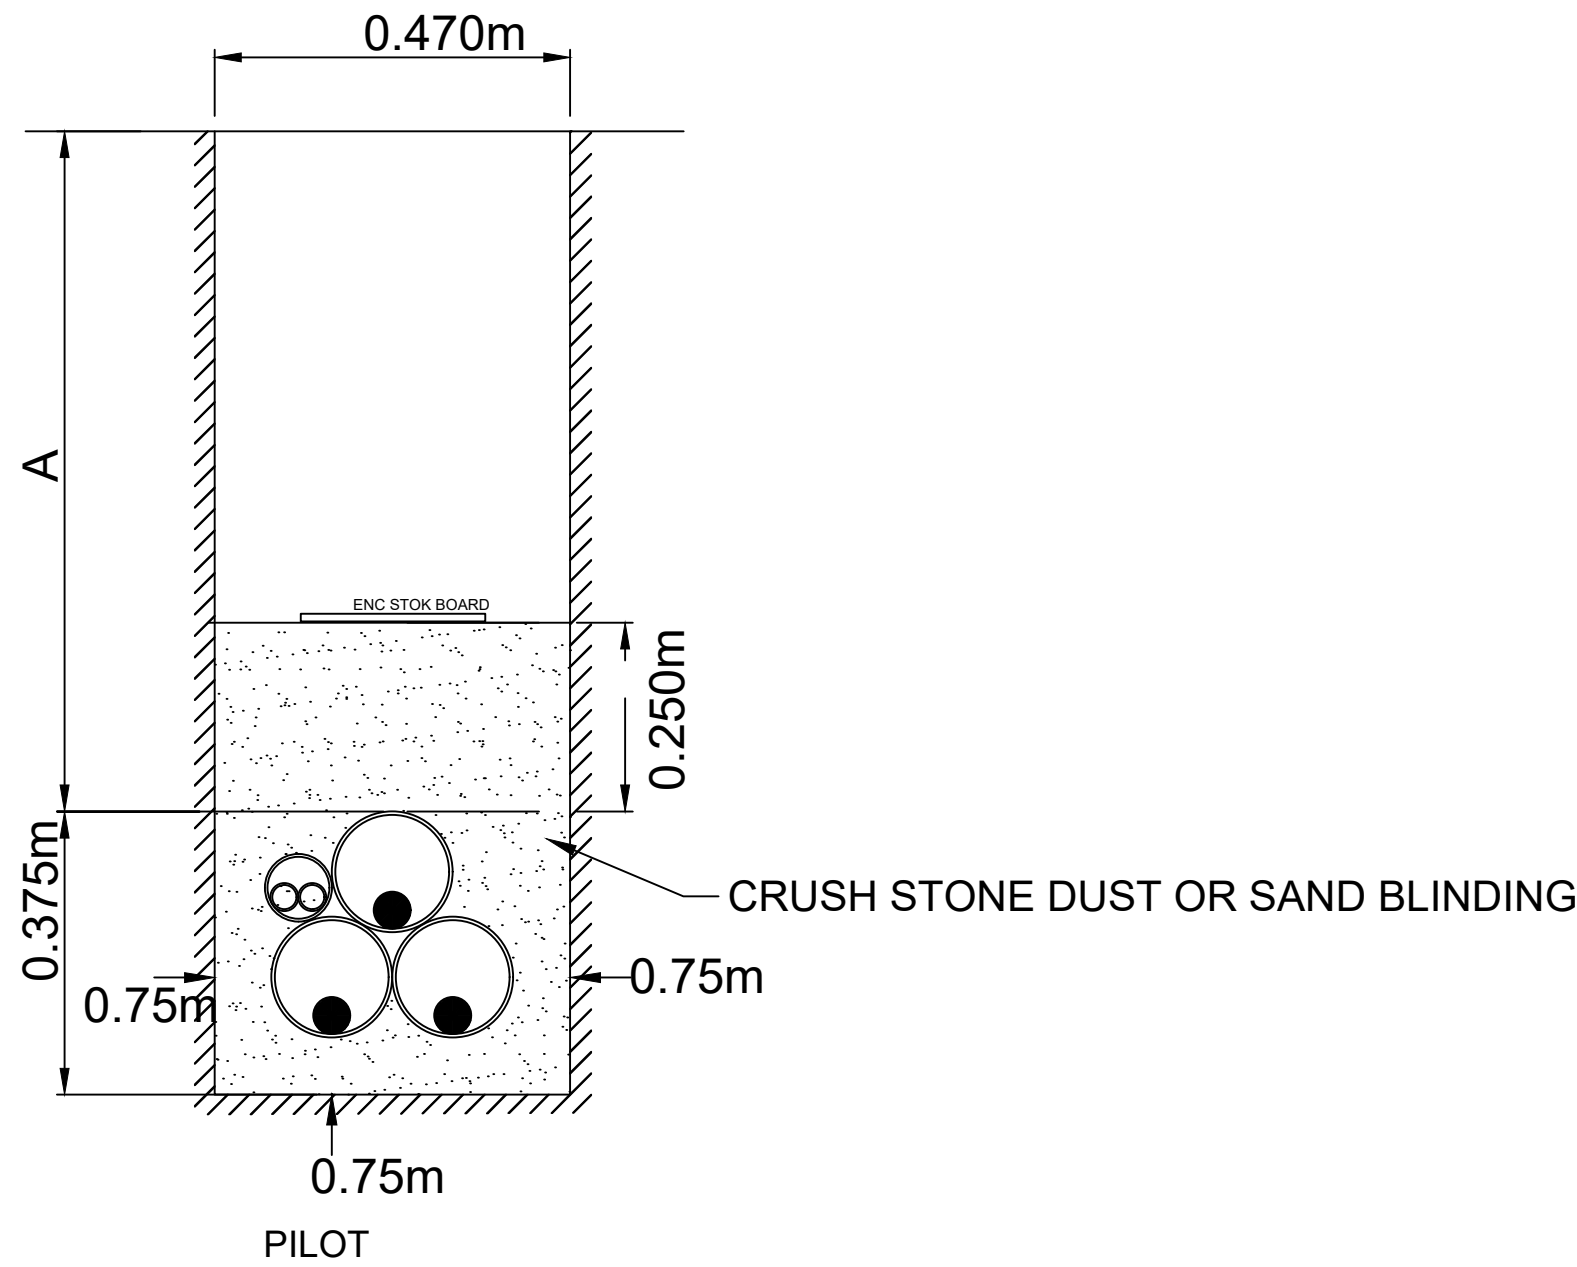

Typical 132kV Cable Trench

Duct Specification	OD/ID
132kV Ducts	160/150
Pilot Ducts	88.9/82.9
Pilot Sub Ducts	37/32

Surface Type	Depth (A)
Verge	900
Footway	900
Carriageway	900
Agriculture	1050
Agriculture - Deep Plowing	1200

- NOTE:
1. ALL DRAWINGS ARE TO BE READ IN CONJUNCTION WITH THE SPECIFICATION FOR HIGHWAY WORKS AND THE TURBINE MANUFACTURERS STANDARDS AND ALL RELEVANT DRAWINGS WITHIN THE PROJECT DESIGN PACKAGE.
 2. ALL WORKS TO BE EXECUTED IN ACCORDANCE WITH THE DMRB, THE MANUAL OF CONTRACT DOCUMENTS FOR HIGHWAY WORKS, DESIGN MANUAL FOR ROADS AND BRIDGES, AND TRAFFIC SIGNS MANUAL.
 3. ALL DIMENSIONS ARE IN METRES UNLESS STATED OTHERWISE. ALL LEVELS ARE IN METRES AND RELATE TO ORDNANCE DATUM.
 4. DO NOT SCALE FROM ANY DRAWING. WORK TO FIGURED DIMENSIONS ONLY. ANY DISCREPANCIES IN DIMENSIONS ARE TO BE REFERRED TO THE DESIGNER BEFORE WORK IS PUT TO HAND.
 5. ALL DIMENSIONS AND LEVELS ARE TO BE CHECKED ON SITE BY THE CONTRACTOR PRIOR TO PREPARING ANY WORKING DRAWINGS OR COMMENCING ON SITE.
 6. ALL WORKS BY THE CONTRACTOR MUST BE CARRIED OUT IN SUCH A WAY THAT ALL REQUIREMENTS UNDER THE HEALTH AND SAFETY AT WORK ACT ARE SATISFIED.
 7. ALL WORKS ARE TO BE CARRIED OUT IN COMPLIANCE WITH THE REQUIREMENT OF THE STATUTORY AUTHORITIES AND CONSTRUCTION DESIGN MANAGEMENT REGULATIONS.

KEY:



Pell Frischmann

93 GEORGE STREET, EDINBURGH, EH2 3ES

Tel: +44 (0)131 240 1270
Email: pfedinburgh@pellfrischmann.com
www.pellfrischmann.com

Client

CUBICO UK DEVELOPMENT
(WIND 1) LIMITED

Project

SCOUT MOOR II WIND FARM

Drawing Title

TYPICAL CABLE TRENCH DETAILS

	Name	Date	Scale
Designed	CN	22.04.2026	NTS @ A1
Checked	SCM	22.04.2026	260422 Scout Moor Construction Details
			Drawing Status PLANNING

Drawing No.	Revision
SK09	5