


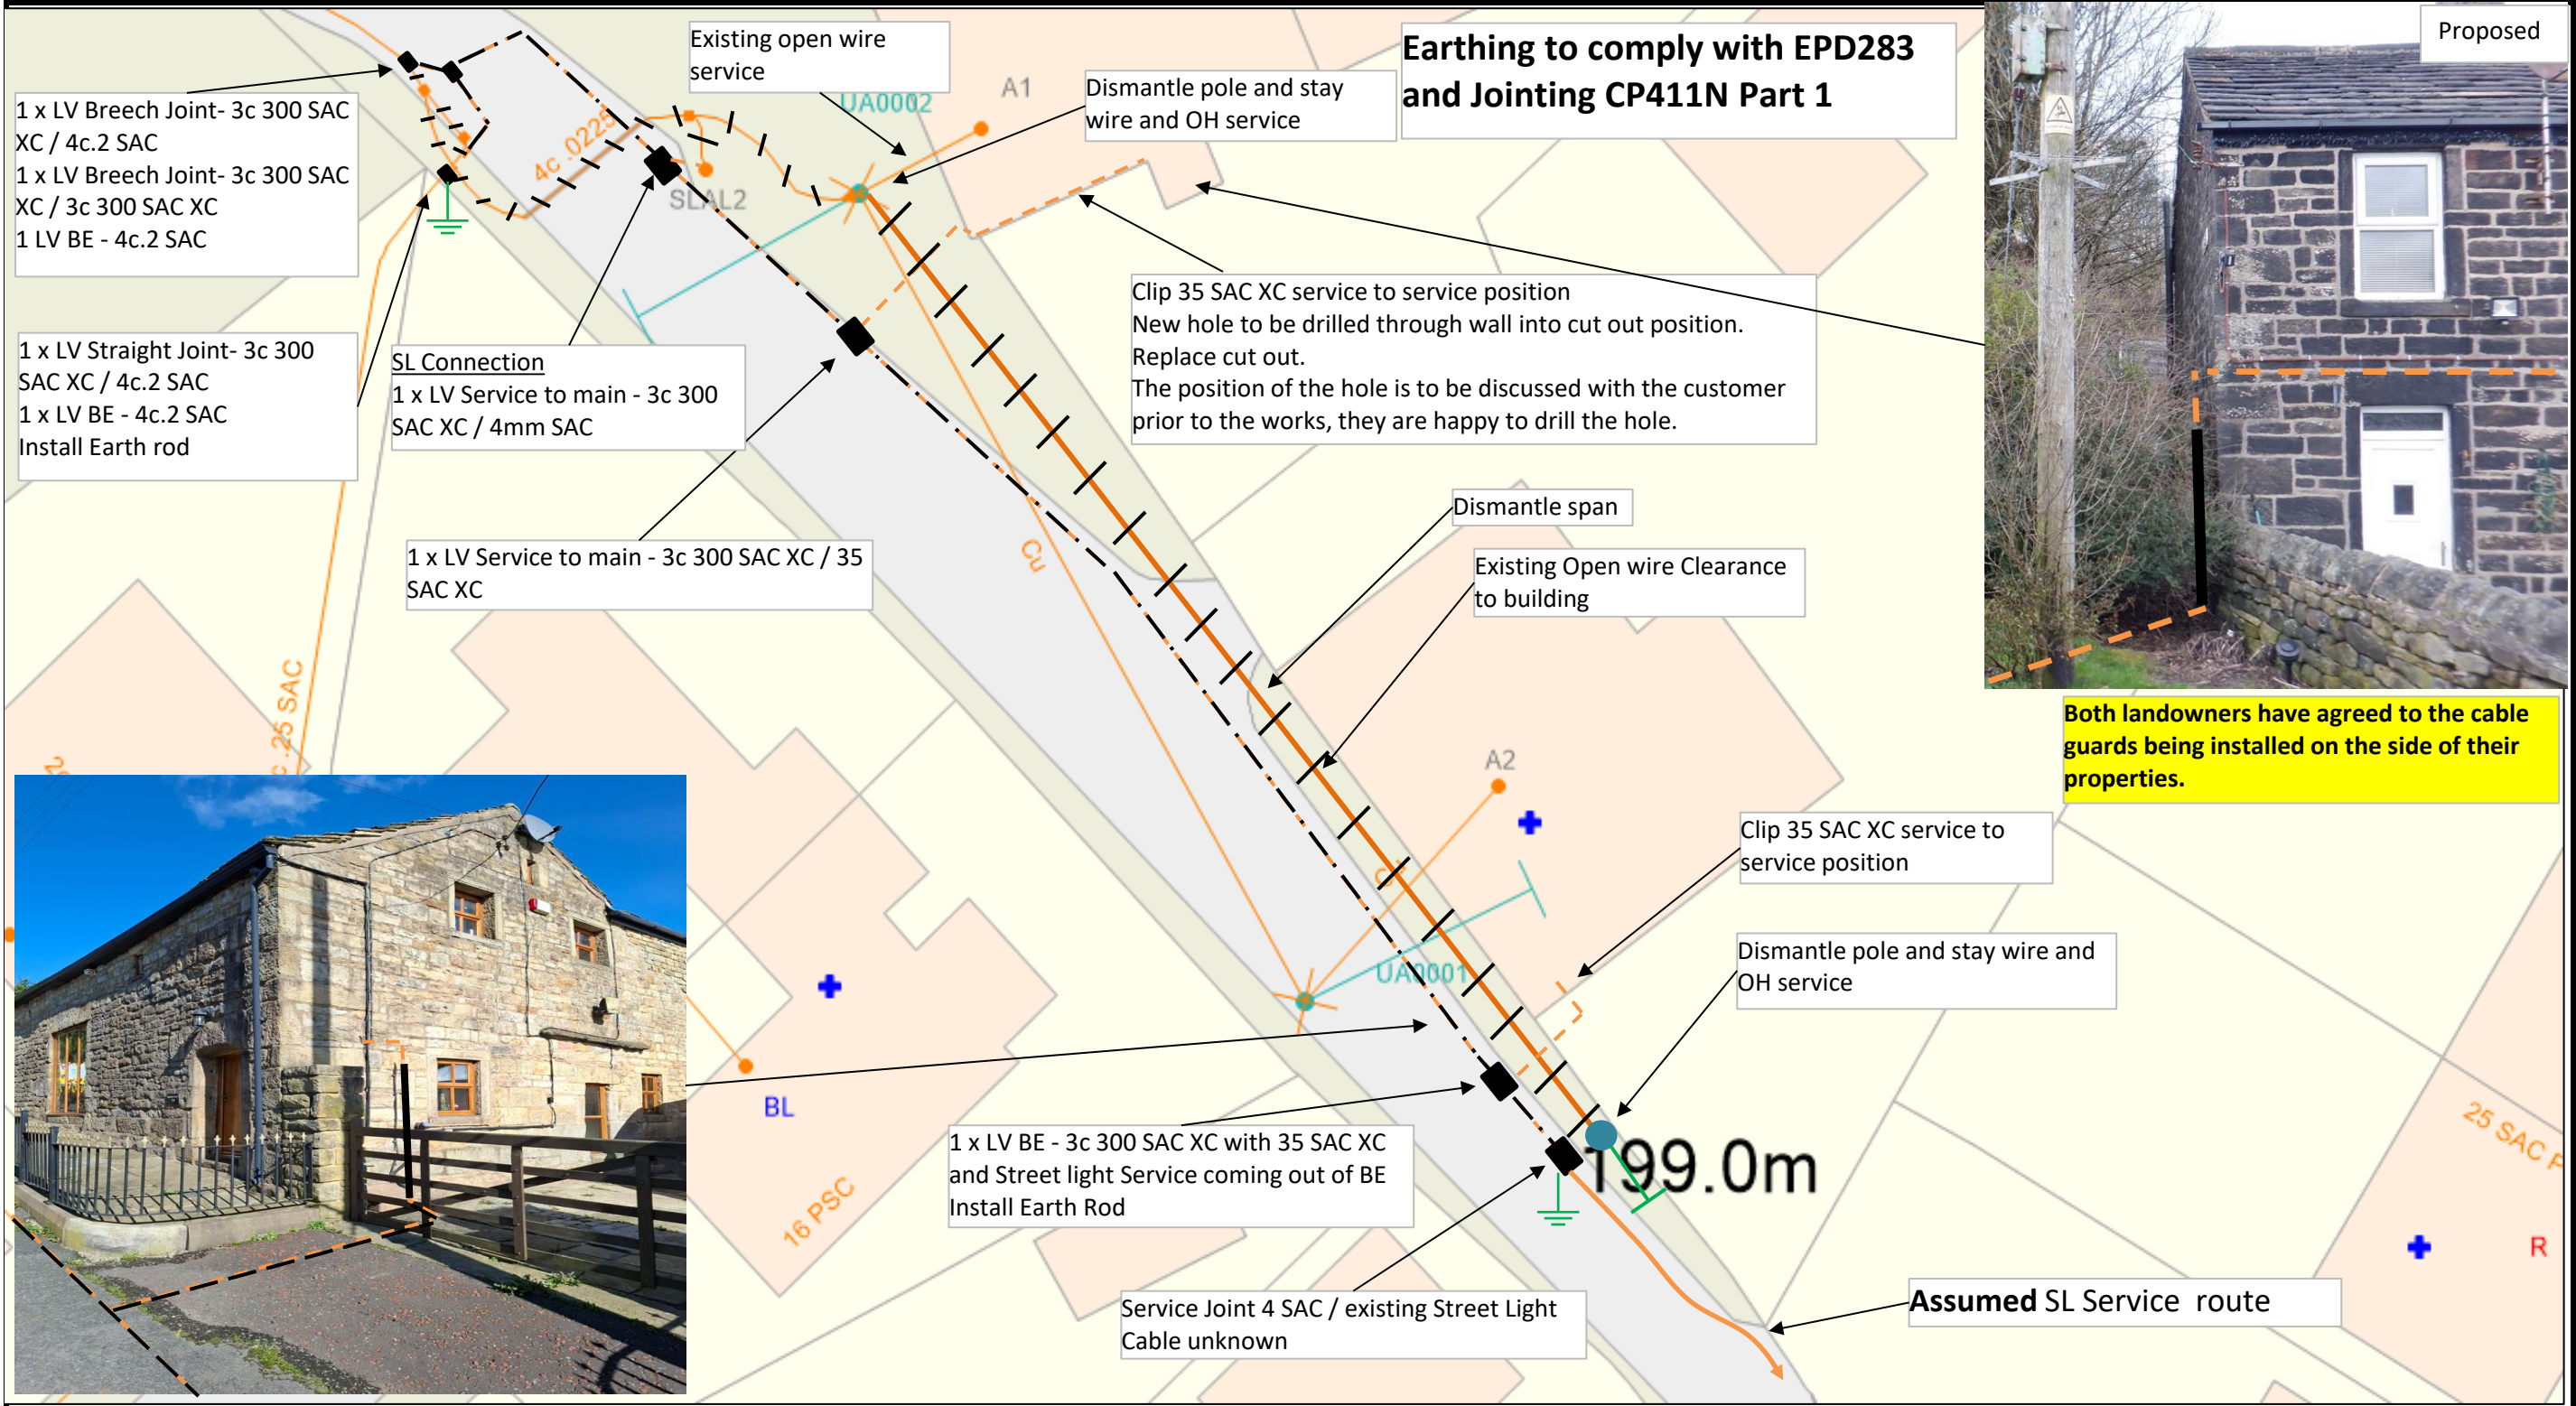

Both landowners have agreed to the cable guards being installed on the side of their properties.

This plan is issued by Electricity North West Limited. Unless otherwise indicated Electricity North West Limited cables are laid at depths in accordance with NJUG 2 (typically 450mm for Low Voltage & 600mm for 11kV cables in footpaths). 33kV/132kV cables are laid at depths as marked. The depths and positions of Electricity North West Limited equipment was accurate as shown when the equipment was installed. However, third parties may have altered the surface level & other reference data.

Therefore Electricity North West Limited accept no responsibility for the position of Electricity North West Limited equipment being different from that shown.

No person, body or company, shall be relieved from liability for damage caused to Electricity North West Limited equipment by reason of being located differently to the indications on this drawing. Service cables are not necessarily shown but must be assumed to exist to all premises, streetlights and signs. There may be other Electricity North West Limited apparatus in the vicinity which is not indicated in the cable records. Other apparatus may also be present which is owned by a third party other than Electricity North West Limited.

Reproduced from or based upon Ordnance Survey's map with the permission of the controller of Her Majesty's Stationery Office. Crown Copyright Reserved. LICENCE No 100017892. Unauthorised reproduction infringes Crown Copyright and may lead to prosecution or civil proceedings. Reference should be made to HSE guidance HS(G)47 "Avoiding Danger from Underground Services" and GS6 "Avoidance of Danger from Overhead Power Lines".

Electricity North West Limited, registered number 2366949, registered in England and Wales, registered office: 304 Bridgewater Place, Birchwood

Existing 33kV U/G cable	—————
Existing 11kV U/G cable	—————
Existing 6.6kV U/G cable	—————
Existing LV U/G cable	—————
Prop. 33kV U/G cable	- - - - -
Prop. 11kV U/G cable	- - - - -
Prop. 6.6kV U/G cable	- - - - -
Prop. LV U/G cable	- - - - -
Existing 33kV O/H line	—————
Existing 11kV O/H line	—————
Existing 6.6kV O/H line	—————
Existing LV O/H line	—————
Prop. 33kV O/H line	- - - - -
Prop. 11kV O/H line	- - - - -
Prop. 6.6kV O/H line	- - - - -
Prop. LV O/H line	- - - - -
Prop. HV earth wire	—————
Pilot/Tele Cable	—————
Proposed Duct	—————
Assets etc. to be abandoned	

Project Reference Number:	Designer	Checked by
60006675	M Lee	
Project:	Drawn By	Grid Ref:
Open Wire Services South - Mawrode Fm, Temple Lane, Littleborough OL15 9QH	M Lee	X Y
Status:	Scale	Sheet size
Proposed Cable Layout	Scale	A3
	Drawing Number	Date
	60006675-1	08/12/2025
	Revision	
		0



Existing overhead service attached to the property

Existing service cable attached to the property

Existing service cable entry point into the property

Proposed cable guard installed up to 1.8m on the wall to protect the service cable

Proposed underground service cable route

Proposed underground Mains cable route